


FULLY SPRINKLERED

KEY NOTES:


1. EXISTING FOOTING TO BE UNDERPINNED.

UNDERPINNING NOTES:

1. MAXIMUM LENGTH OF EXISTING FOOTING TO BE UNDERPINNED AT ONE TIME SHALL BE NO GREATER THAN 6'-0".
2. UNDERPIN EACH SIDE OF EXISTING COLUMN FOOTINGS FIRST, THEN UNDERPIN INTERMEDIATE SECTIONS AND COLUMN FOOTINGS.

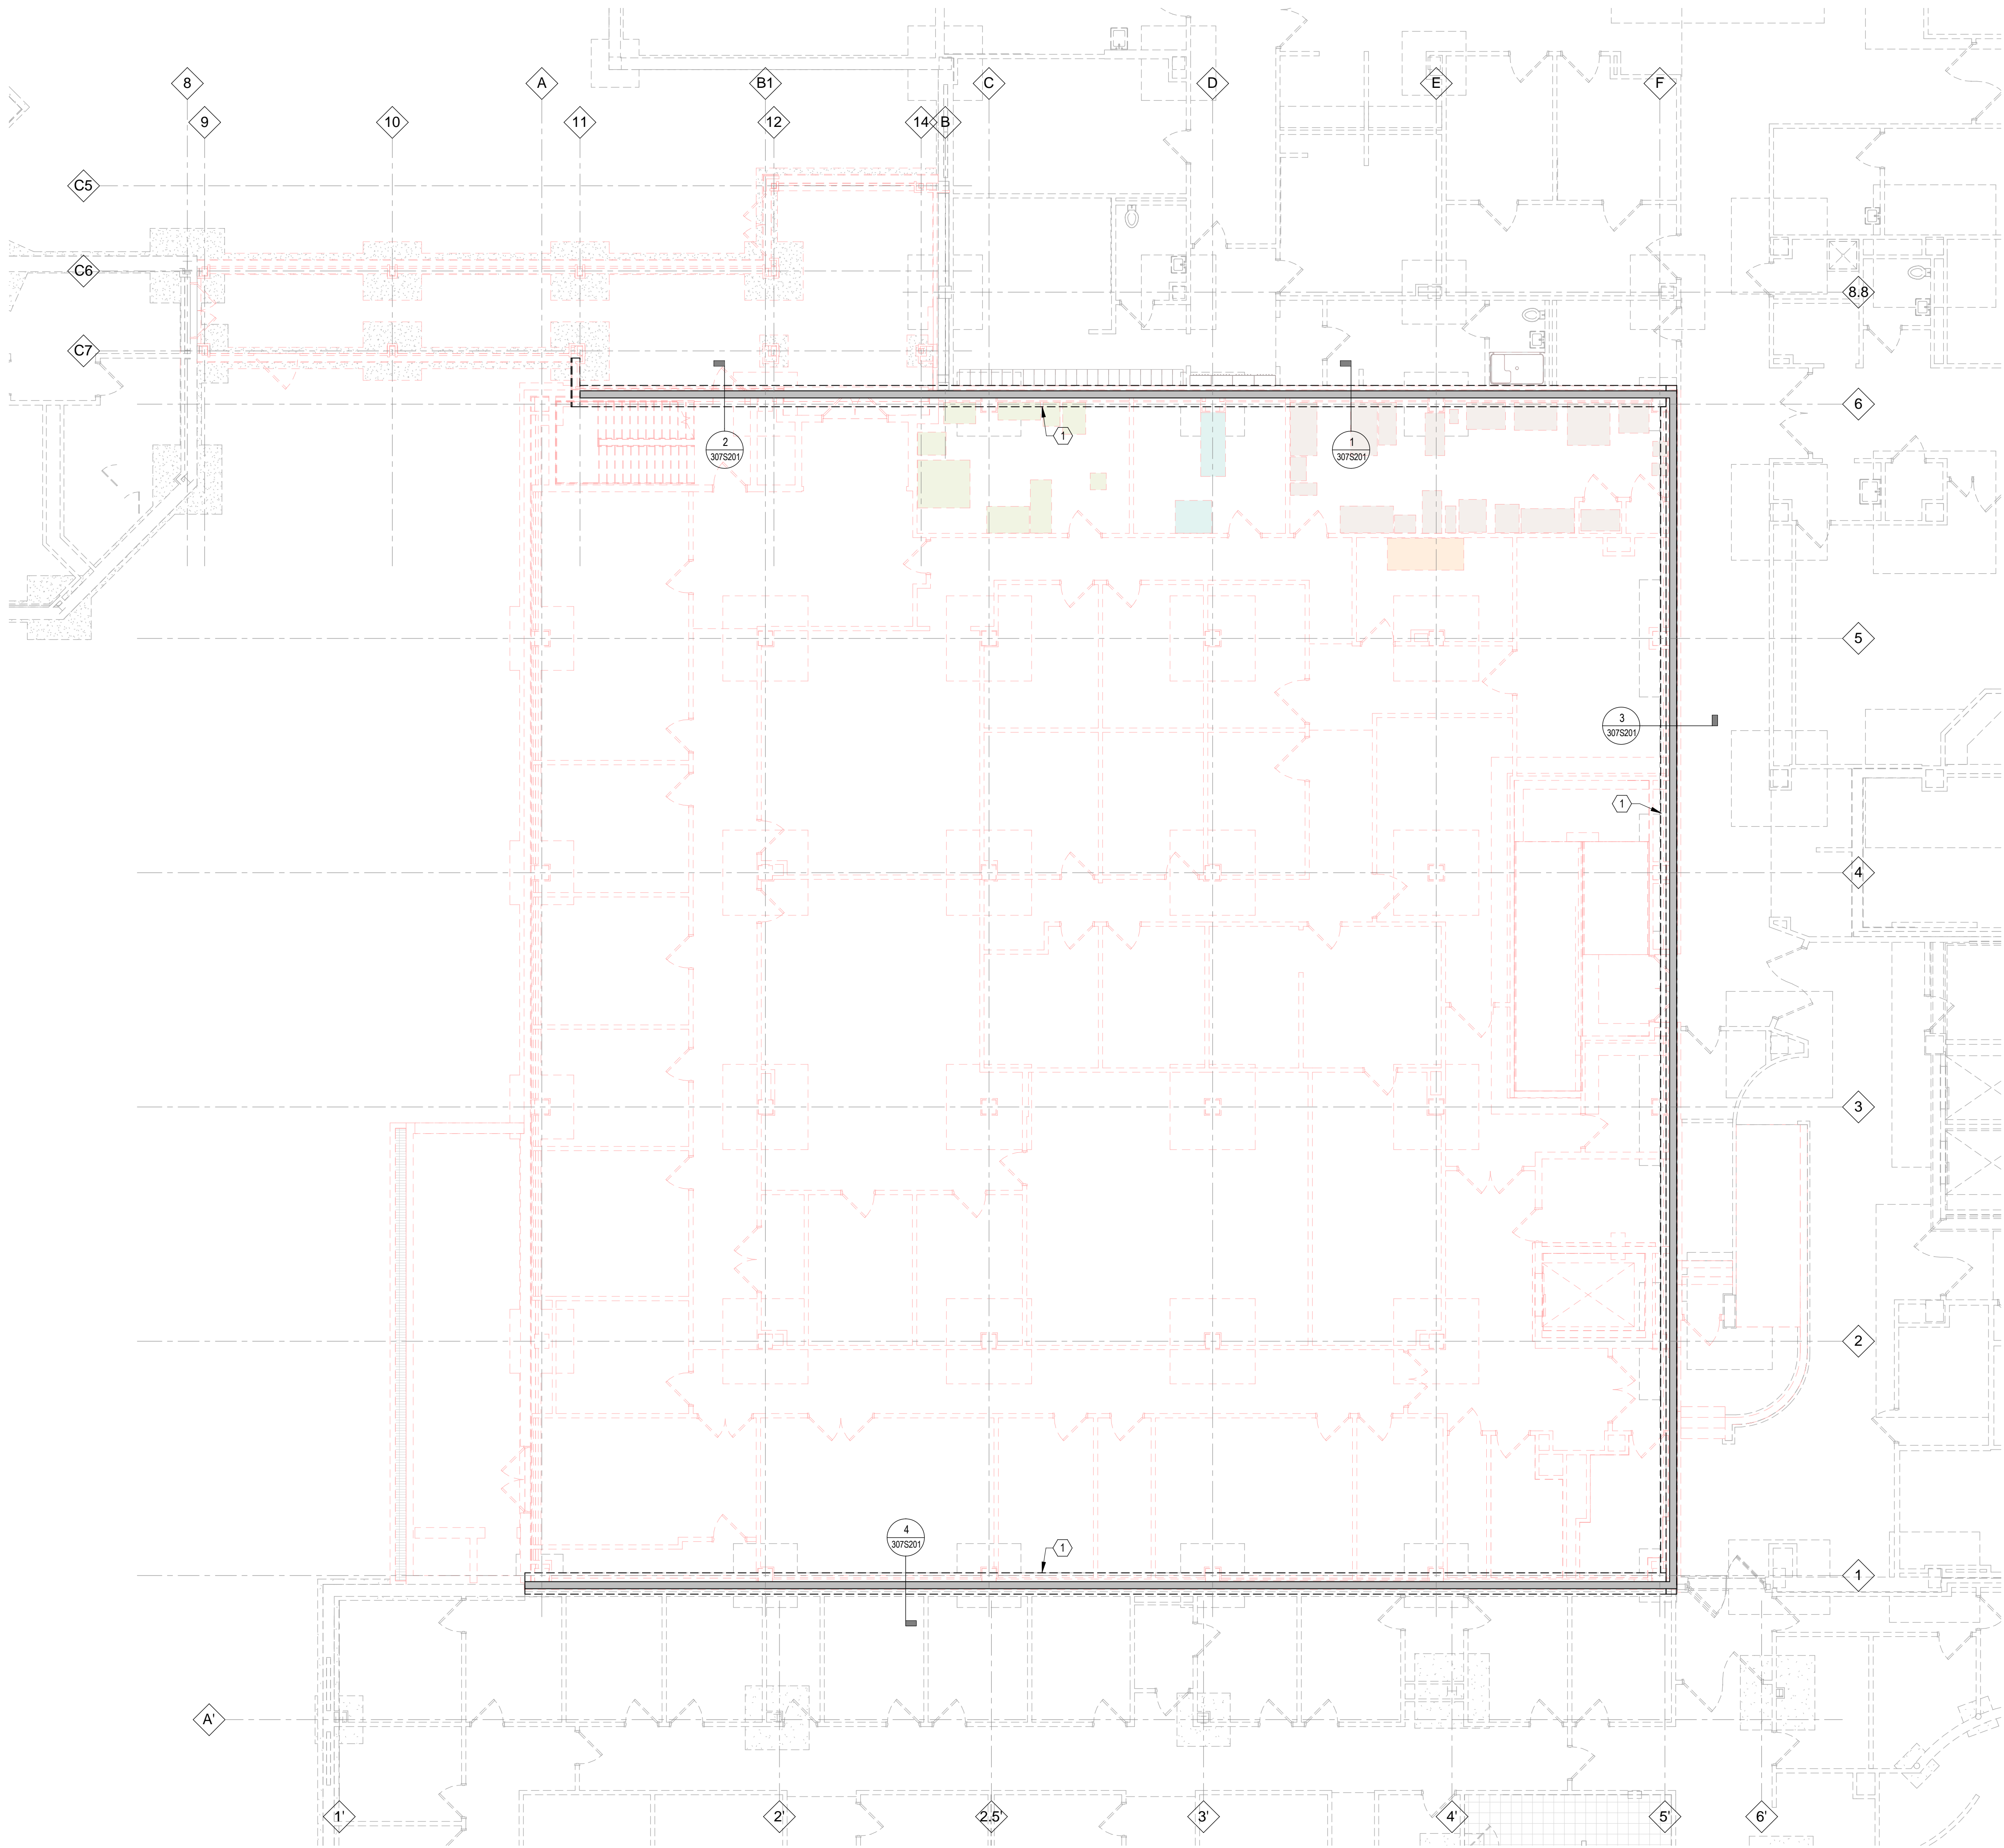

**LEVEL 1 FOUNDATION PLAN**  
1/8" = 1'-0"

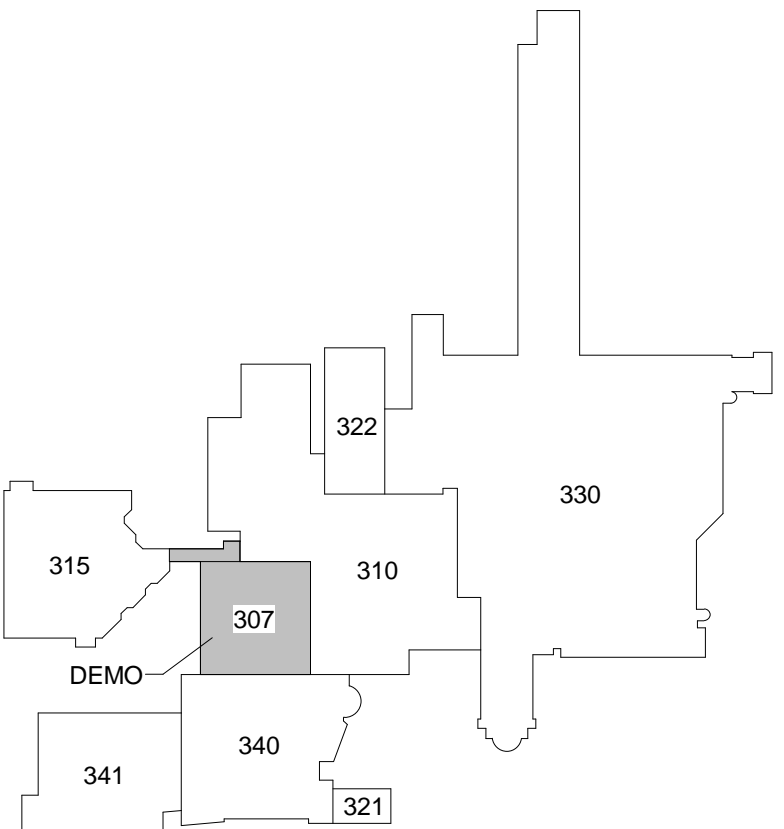

**KEY PLAN**

Scale: N.T.S.

Revisions		Date
1	65% Design Development	04.28.2015
2	95% Owner Review	08.14.2015
3	100% Construction Documents	11.04.2015
4	Bid Set Drawings	05.16.2016

CONSULTANTS:

**THP**

THP Limited, Inc.  
100 East Eighth Street  
Cincinnati, Ohio 45202  
Phone: 513.241.3222  
www.thpltd.com



ARCHITECT/ENGINEERS:

**JOHN POE ARCHITECTS**

3131 NEWMARK DRIVE  
SUITE 200  
MIAMISBURG, OHIO 45342  
937.461.3290 PHONE  
937.461.0260 FAX  
jpa@johnpoe.com

Drawing Title

**FIRST FLOOR PLAN**

Approved: Project Director

Project Title

**RELOCATE PROSTHETICS AND PODIATRY CLINICS**

Location

**Dayton, Ohio**

Date

05.16.2016

Checked

FJE

Drawn

MRB

Project No.

VA Project No. 552-15-502  
JPA Project No. 14006.00

Building Number

**307/315/330**

Drawing Number





**307S101**

Dwg. of




Office of Construction and Facilities Management

Department of Veterans Affairs

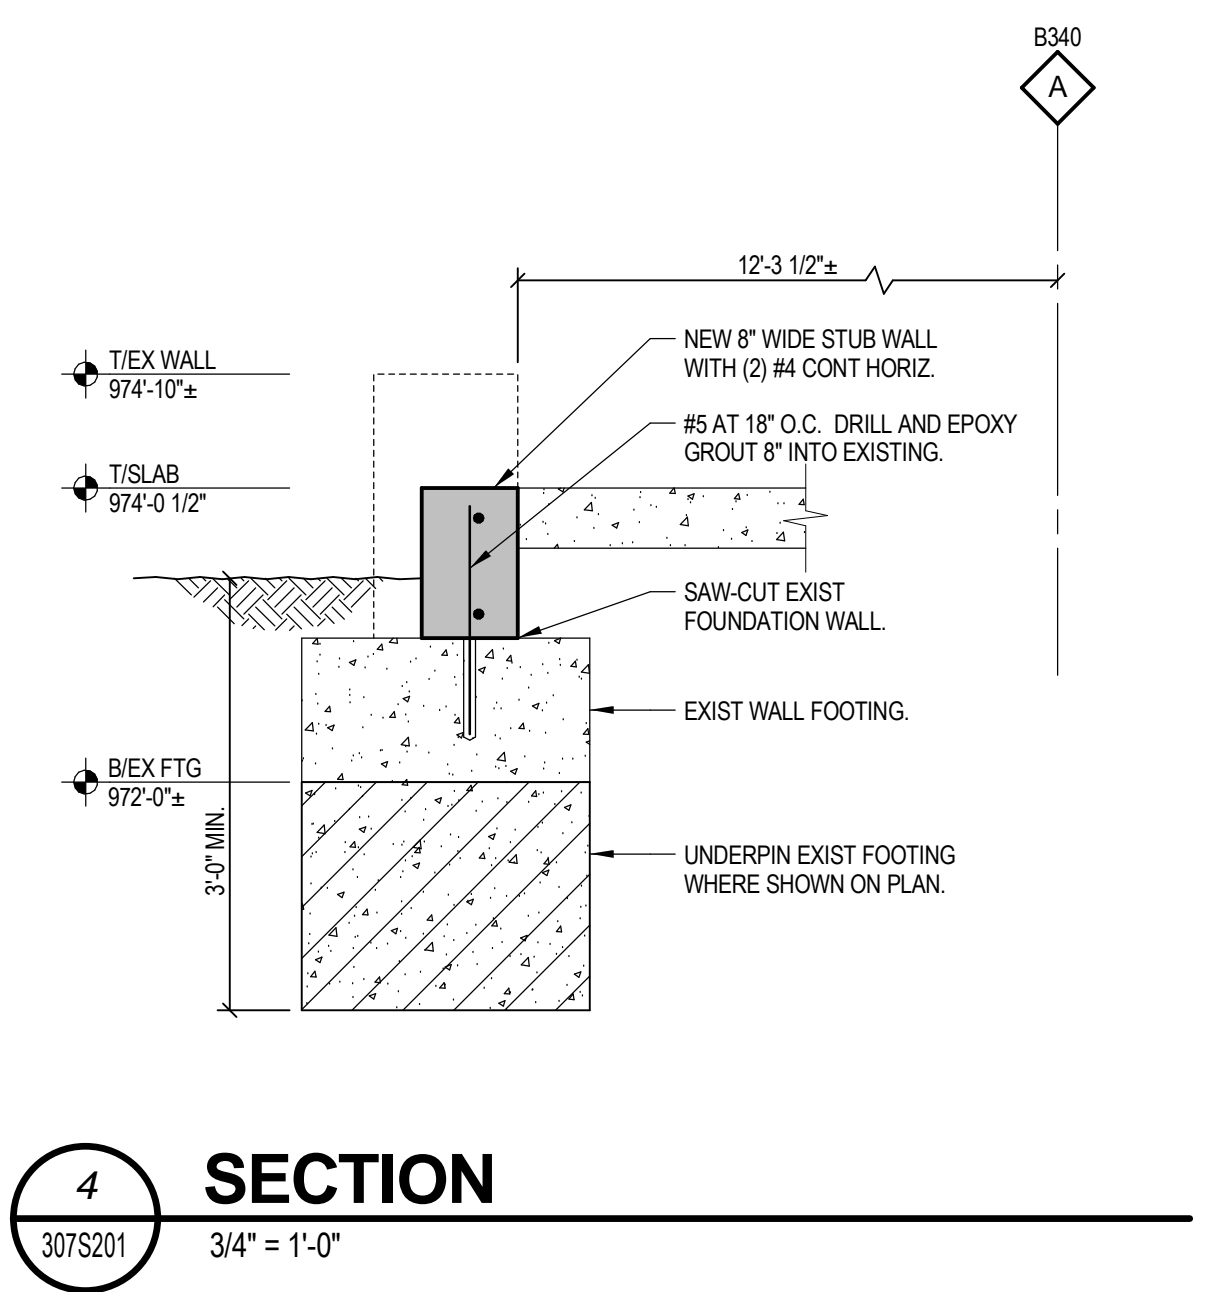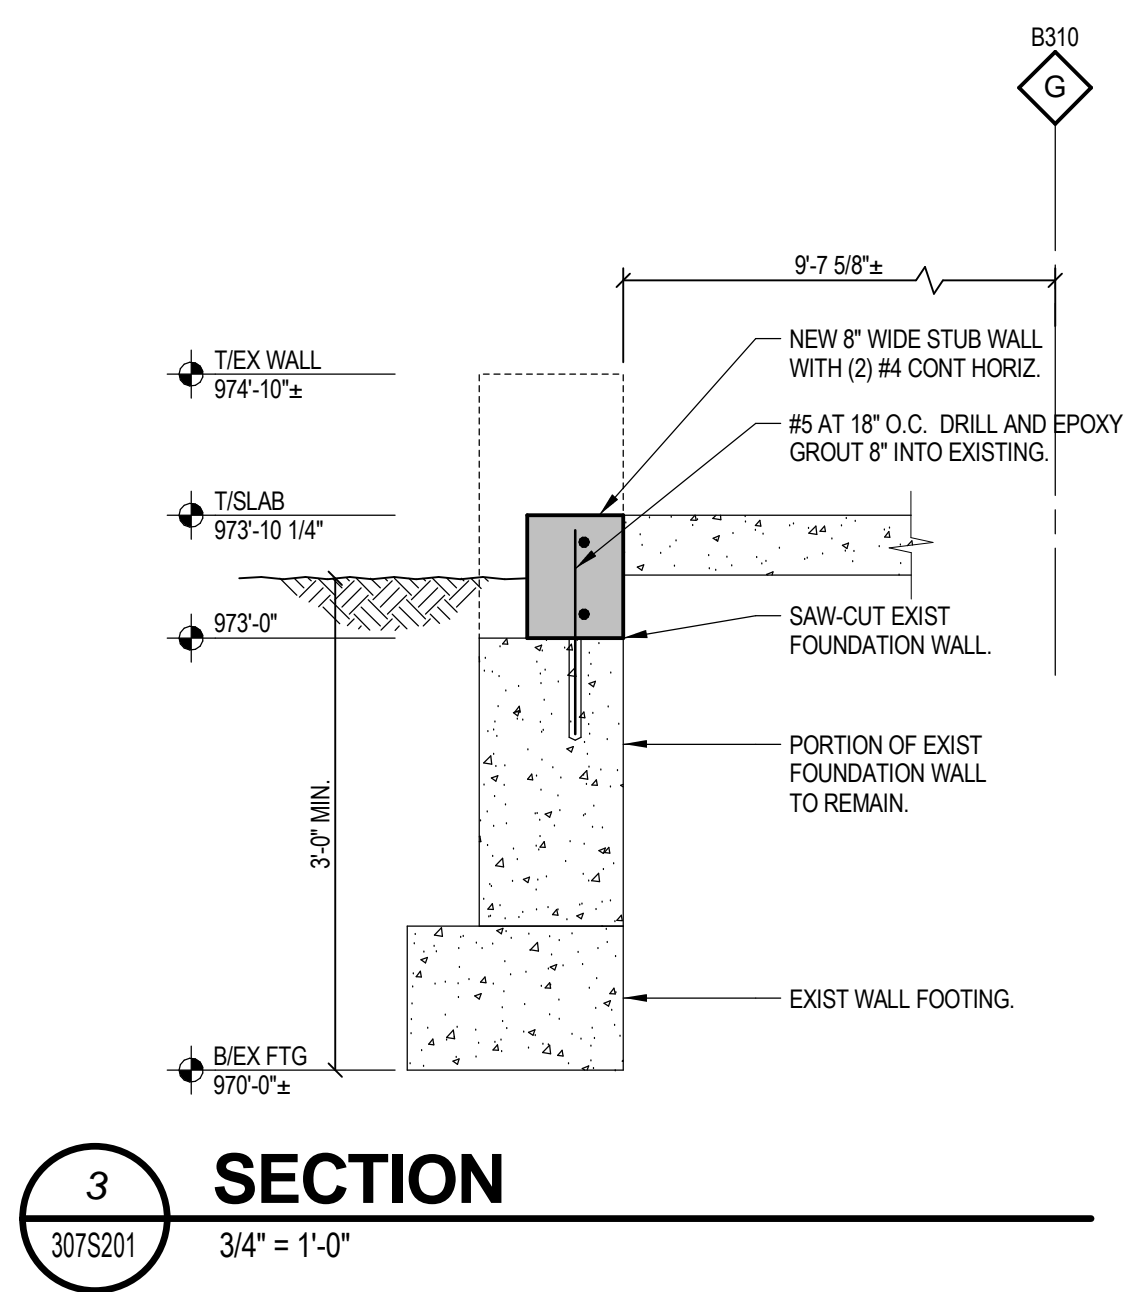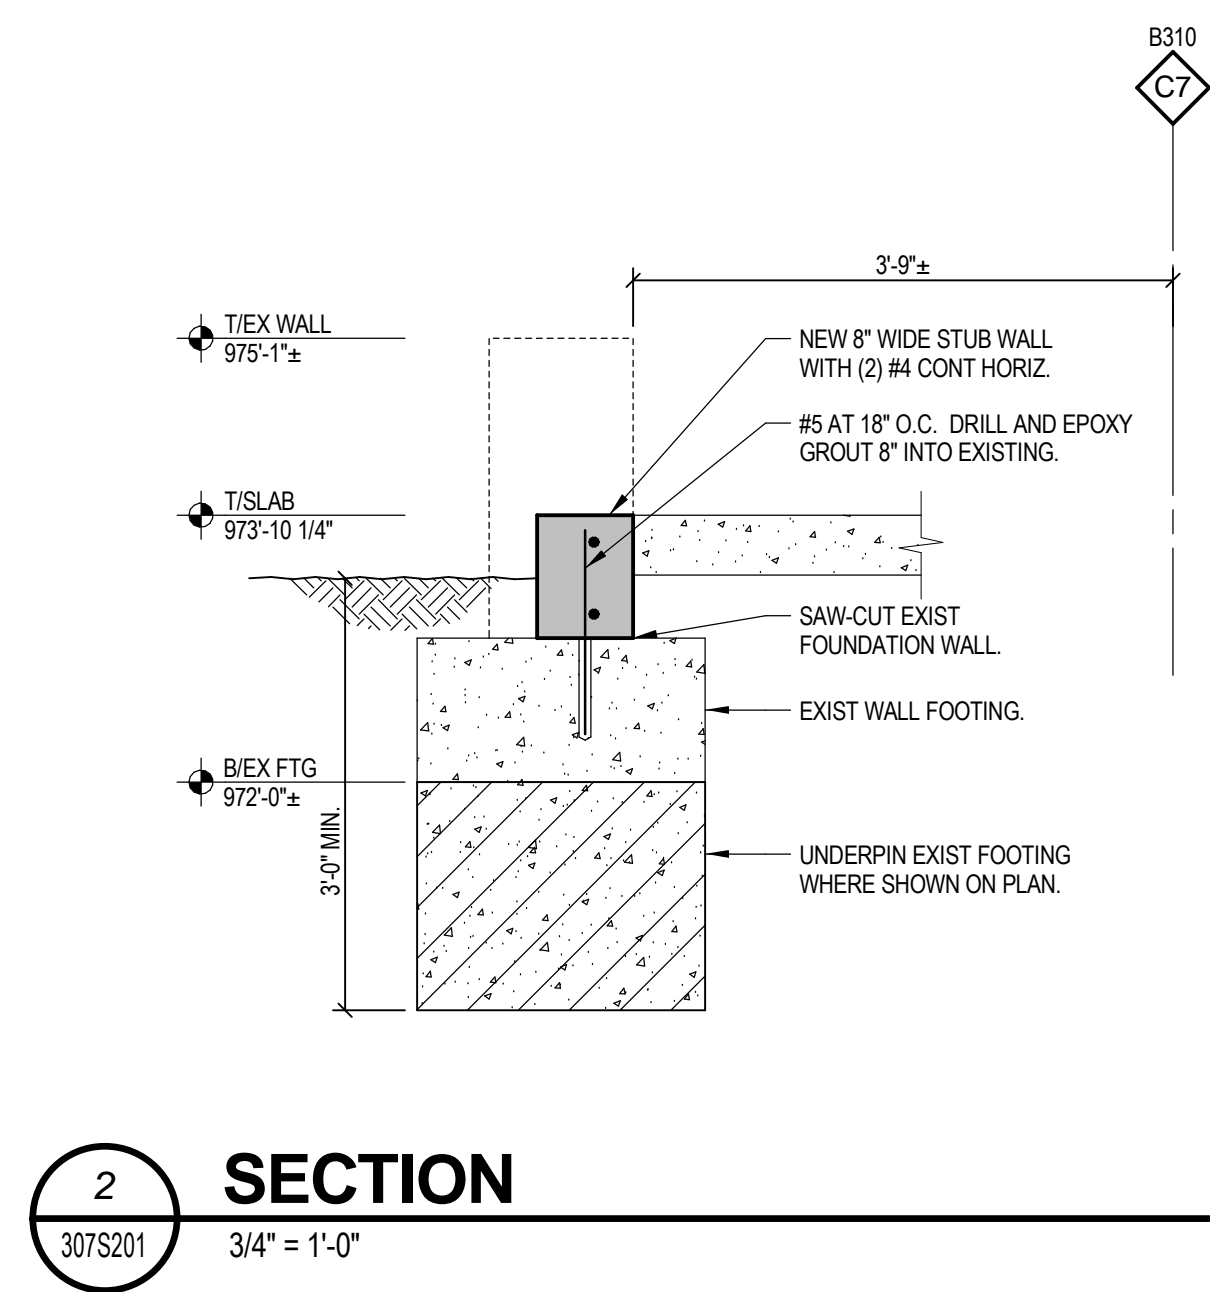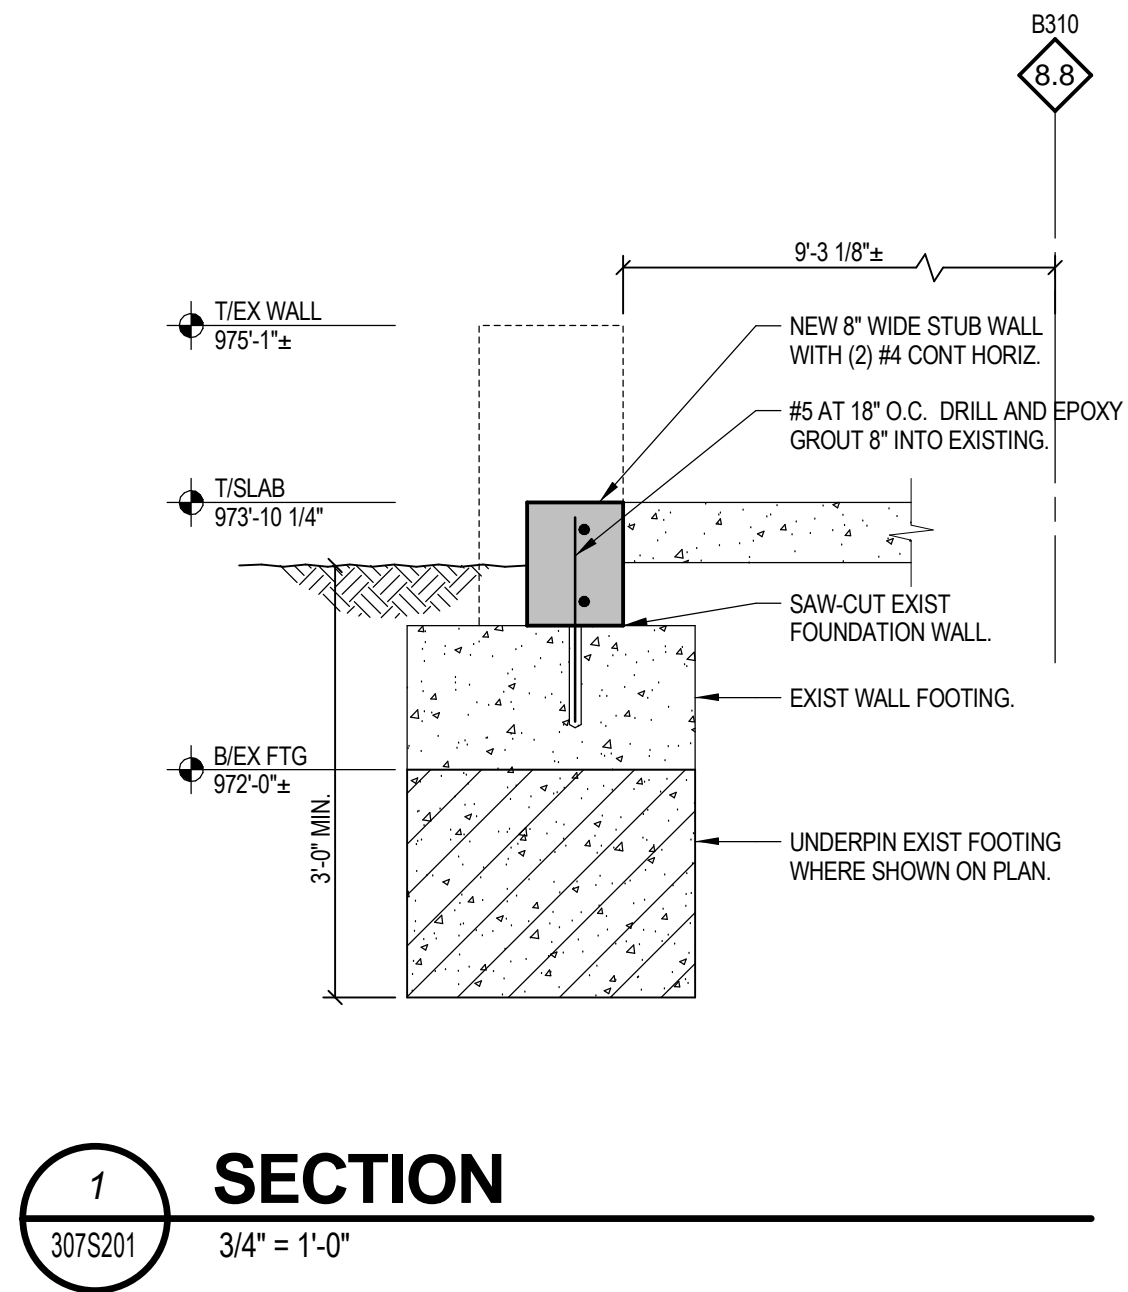one-eighth inch = one foot  
one-quarter inch = one foot  
three-eighths inch = one foot  
one-half inch = one foot  
three-quarters inch = one foot  
one inch = one foot  
one and one-half inches = one foot  
two inches = one foot  
three inches = one foot

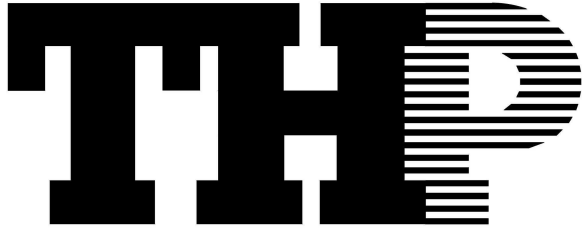

FULLY SPRINKLERED

<table><tr><td>1</td><td>65% Design Development</td><td>04.28.2015</td></tr><tr><td>2</td><td>95% Owner Review</td><td>08.14.2015</td></tr><tr><td>3</td><td>100% Construction Documents</td><td>11.04.2015</td></tr><tr><td>4</td><td>Bid Set Drawings</td><td>05.16.2016</td></tr><tr><td>Revisions</td><td></td><td>Date</td></tr></table>	1	65% Design Development	04.28.2015	2	95% Owner Review	08.14.2015	3	100% Construction Documents	11.04.2015	4	Bid Set Drawings	05.16.2016	Revisions		Date	<p>CONSULTANTS:</p> <div><p><b>THP Limited, Inc.</b> 100 East Eighth Street Cincinnati, Ohio 45202 Phone: 513.241.3222 www.thpltd.com</p></div>	<div><p>FRANK JOSEPH ELLERT E-50492 REGISTERED PROFESSIONAL ENGINEER</p></div>	<p>ARCHITECT/ENGINEERS:</p> <div><p><b>JOHN POE ARCHITECTS</b></p><p>3131 NEWMARK DRIVE SUITE 200 MIAMISBURG, OHIO 45342 937.461.3290 PHONE 937.461.0260 FAX jpa@johnpoe.com</p></div>	<p>Drawing Title</p> <p><b>DETAILS</b></p> <p>Approved: Project Director</p>	<p>Project Title</p> <p><b>RELOCATE PROSTHETICS AND PODIATRY CLINICS</b></p> <p>Location</p> <p><b>Dayton, Ohio</b></p> <p>Date</p> <p>05.16.2016</p> <p>Checked:</p> <p>FJE</p> <p>Drawn:</p> <p>MRB</p>	<p>Project No.</p> <p>VA Project No. 552-15-502 JPA Project No. 14006.00</p> <p>Building Number</p> <p><b>307/315/330</b></p> <p>Drawing Number</p> <p><b>307S201</b></p> <p>Dwg. of</p>	<p>Office of Construction and Facilities Management</p> <p>Department of Veterans Affairs</p>
1	65% Design Development	04.28.2015																				
2	95% Owner Review	08.14.2015																				
3	100% Construction Documents	11.04.2015																				
4	Bid Set Drawings	05.16.2016																				
Revisions		Date																				


FULLY SPRINKLERED

GENERAL NOTES

A REFER TO SHEET FX001 FOR LEGEND, SYMBOLS & INDEX OF DRAWINGS.


PLAN NOTES

- EXISTING TO REMAIN.
- REVISE EXISTING WET PIPE FIRE SUPPRESSION SPRINKLER SYSTEM IN AREA INDICATED TO CONFORM TO NEW LAYOUT.
- TEMPORARY CONSTRUCTION PARTITION. REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION.
- CEILING MAY BE REMOVED, MODIFIED AND RE-INSTALLED AS REQUIRED TO INSTALL TEMPORARY AND PERMANENT PARTITIONS. REVISE EXISTING WET PIPE SPRINKLER SYSTEM IN AREA INDICATED TO ACCOMMODATE NEW OR MODIFIED CEILING.

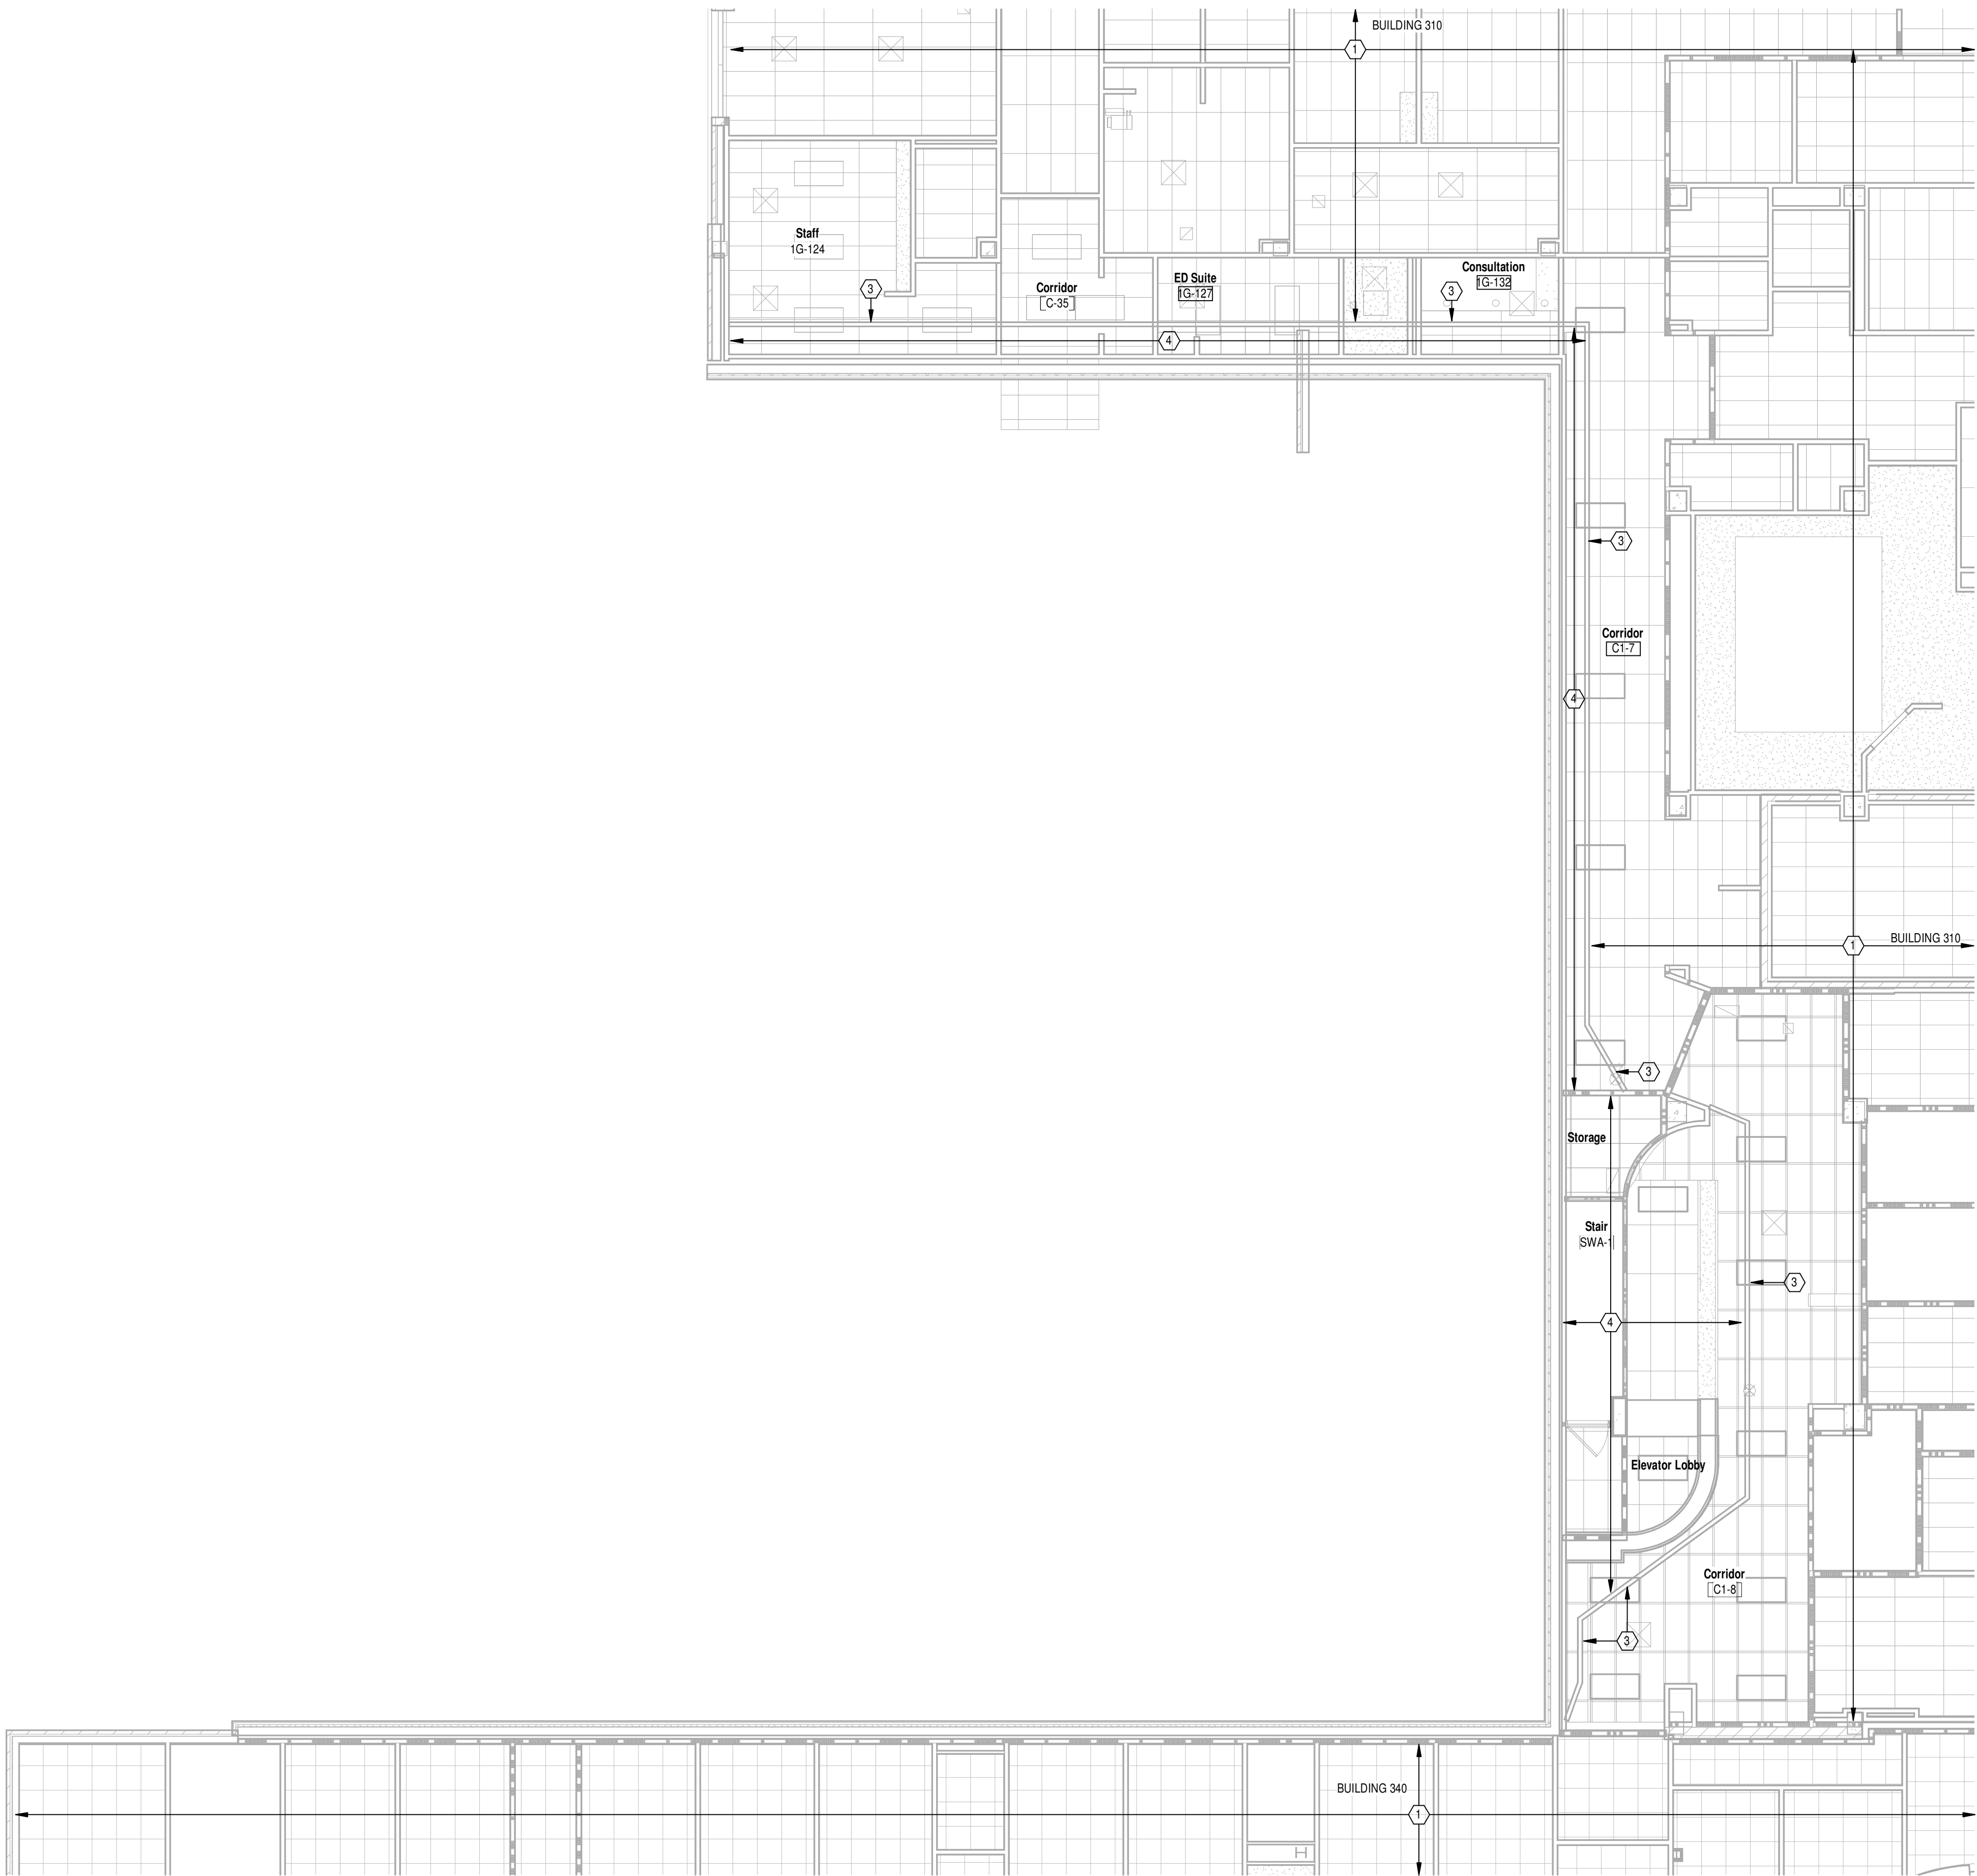

BUILDNG 307 FIRST FLOOR PLAN - FIRE SUPPRESSION

Scale: 1/8" = 1'-0"

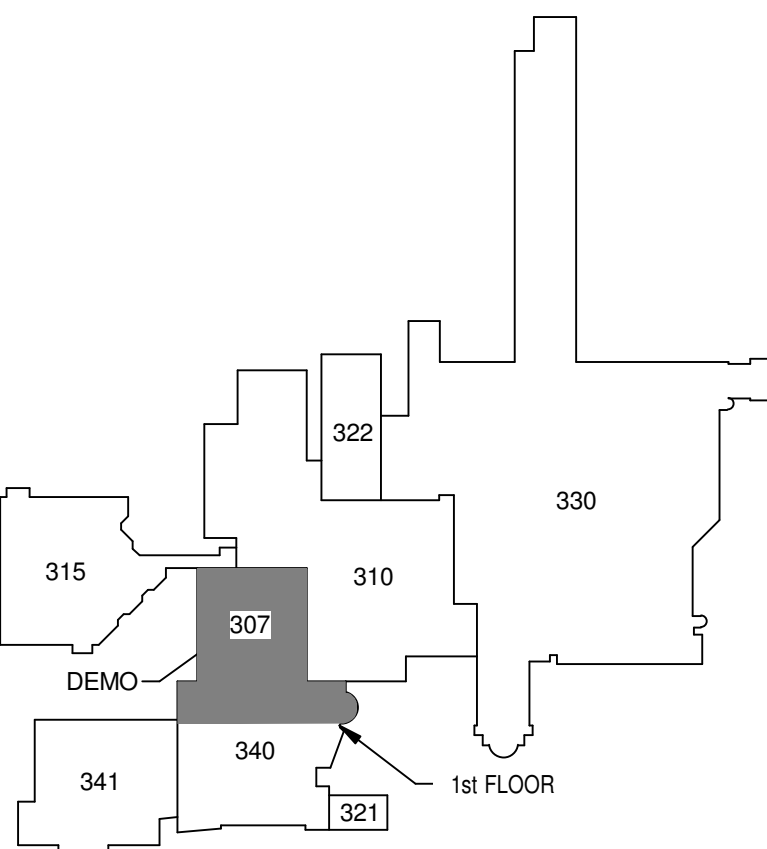

KEY PLAN

Scale: N.T.S.

5/13/2016 12:07:59 PM

Revisions			Date
1	35% Schematic Design	03.05.2015	
2	65% Design Development	04.28.2015	
3	95% Owner Review	08.14.2015	
4	100% Construction Documents	11.04.2015	
5	Bid Set Drawings	01.15.2016	

CONSULTANTS:

Heapy Engineering

MEP Design Technology Planning Commissioning Energy

Nationally Recognized Leader in Sustainability

1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

ARCHITECT/ENGINEERS:

JOHN POE ARCHITECTS

JOHN POE ARCHITECTS

3131 NEWMARK DRIVE,  
SUITE 200  
MIAMISBURG, OHIO 45342  
937 461 3290 PHONE  
jpa@johnpoe.com

Drawing Title

FIRST FLOOR PLAN - FIRE  
SUPPRESSION

Approved: Project Director

Project Title

RELOCATE PROSTHETICS  
AND PODIATRY CLINICS

Location

Dayton, Ohio

Date

05.16.2016

Checked

CSS

Drawn

DPB

Project No.  
VA Project No. 552-15-502  
JPA Project No. 14006.00

Building Number  
307

Drawing Number  
307FX101


Dwg. of

Office of  
Construction  
and Facilities  
Management



FULLY SPRINKLERED

GENERAL NOTES  
A REFER TO SHEET FX001 FOR LEGEND, SYMBOLS & INDEX OF DRAWINGS.

- PLAN NOTES
- EXISTING TO REMAIN.
  - REVISE EXISTING WET PIPE FIRE SUPPRESSION SPRINKLER SYSTEM IN AREA INDICATED TO CONFORM TO NEW LAYOUT.
  - REFER SHEET 315FX102 FOR WORK IN THIS AREA.
  - TEMPORARY CONSTRUCTION PARTITION. REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION.
  - CEILING MAY BE REMOVED, MODIFIED AND RE-INSTALLED AS REQUIRED TO INSTALL TEMPORARY AND PERMANENT PARTITIONS. REVISE EXISTING WET PIPE SPRINKLER SYSTEM IN AREA INDICATED TO ACCOMMODATE NEW OR MODIFIED CEILING.

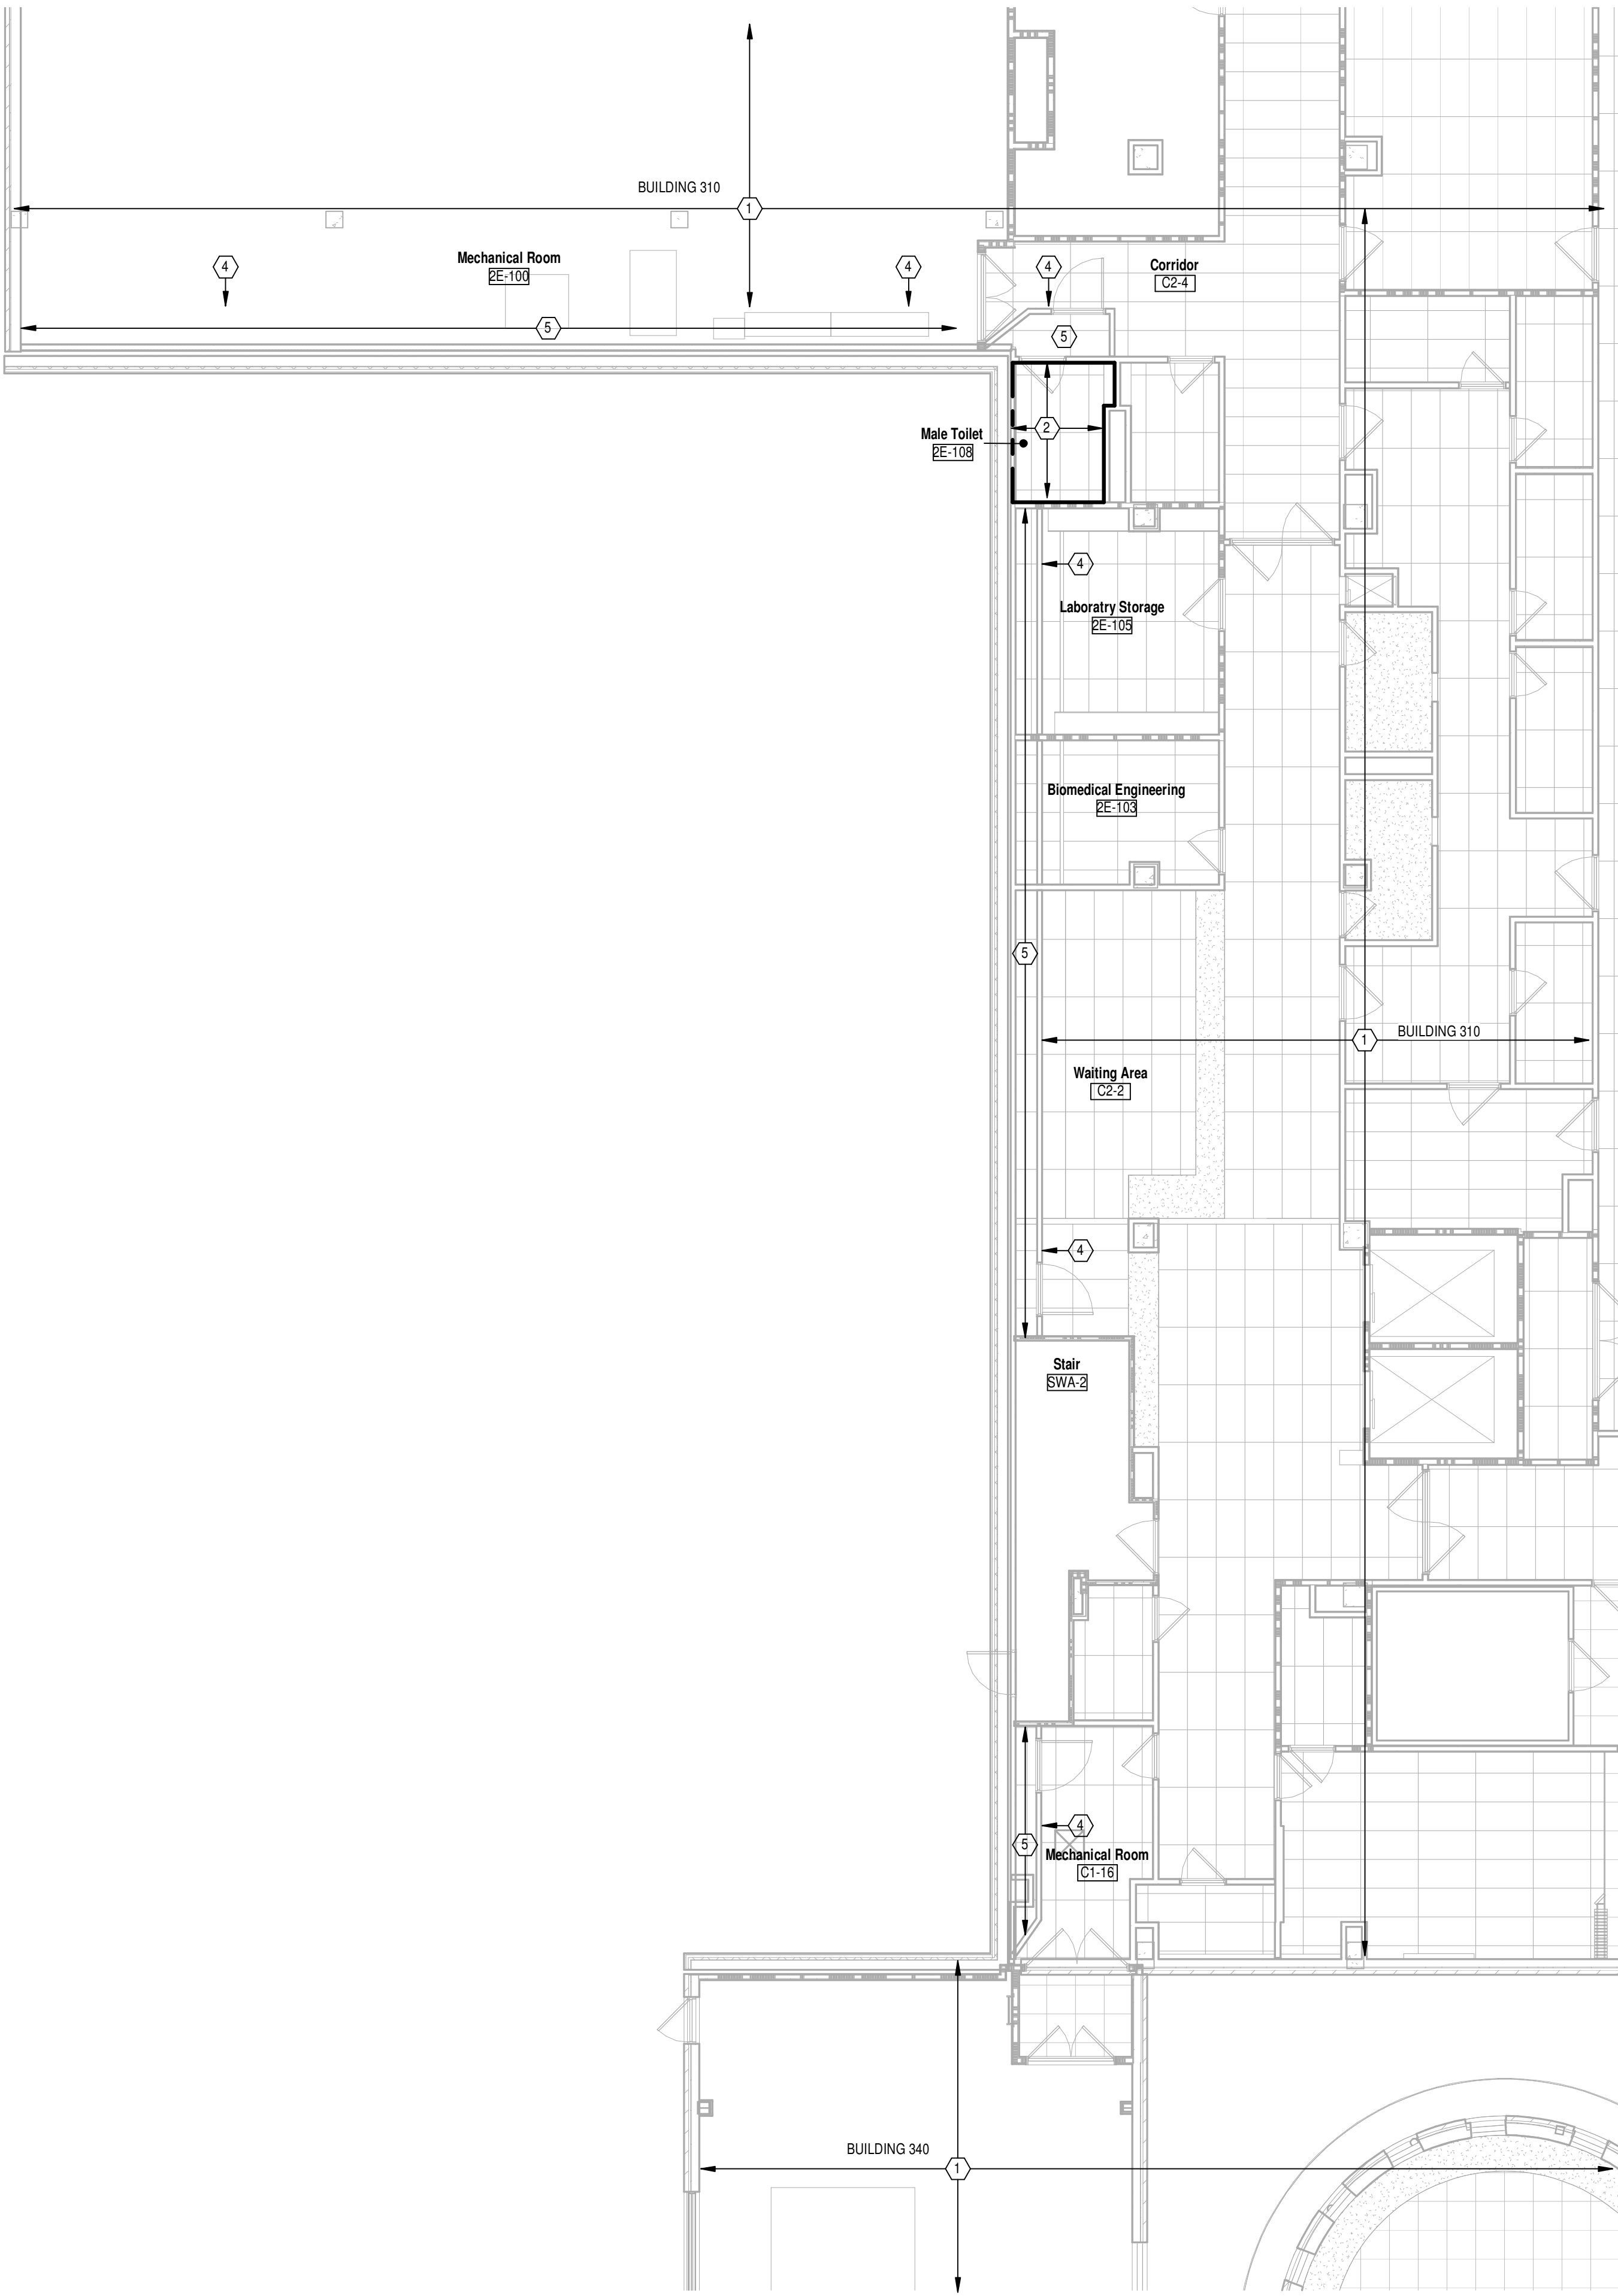

BUILDING 307 SECOND FLOOR PLAN - FIRE SUPPRESSION

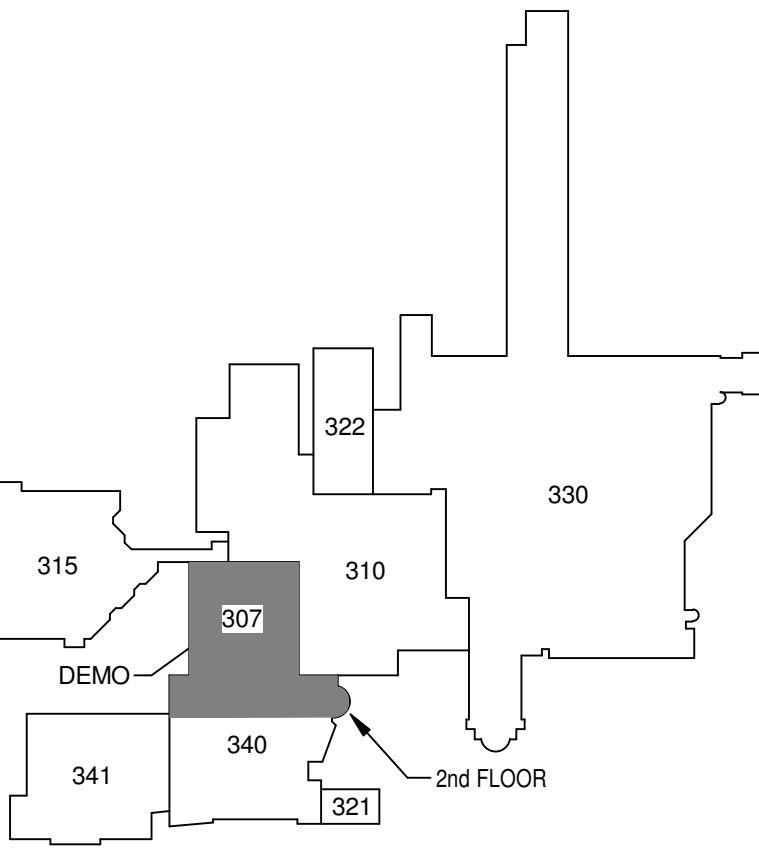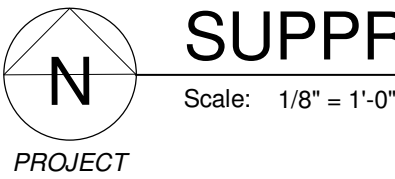

KEY PLAN  
Scale: N.T.S.

5/13/2016 12:08:05 PM

Revisions		Date
1	35% Schematic Design	03.05.2015
2	65% Design Development	04.28.2015
3	95% Owner Review	08.14.2015
4	100% Construction Documents	11.04.2015
5	Bid Set Drawings	01.15.2016

CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

ARCHITECT/ENGINEERS:

**JOHN POE ARCHITECTS**

3131 NEWMARK DRIVE,  
SUITE 200  
MIAMISBURG, OHIO 45342  
937.461.3290 PHONE  
jpae@johnpoe.com

Drawing Title

**SECOND FLOOR PLAN - FIRE SUPPRESSION**

Approved: Project Director

Project Title

**RELOCATE PROSTHETICS AND PODIATRY CLINICS**

Location

**Dayton, Ohio**

Date

**05.16.2016**

Checked

**CSS**

Drawn

**DPB**

Project No.

VA Project No. **552-15-502**

JPA Project No. **14006.00**

Building Number

**307**

Drawing Number

**307FX102**

Dwg. of

Office of Construction and Facilities Management

Department of Veterans Affairs



three inches = one foot  
one and one-half inches = one foot  
one inch = one foot  
three-quarters inch = one foot  
one-half inch = one foot  
three-eighths inch = one foot  
one-quarter inch = one foot  
one-eighth inch = one foot



EXISTING AIR COMPRESSOR

Scale: N.T.S.



EXISTING HOSE REEL

Scale: N.T.S.



EXISTING BUILDING 310 ED SUITE

Scale: N.T.S.




EXISTING BUILDING 310 ED SUITE

Scale: N.T.S.

CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

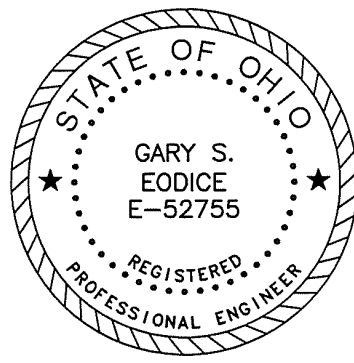

ARCHITECT/ENGINEERS:

JOHN POE ARCHITECTS

3131 NEWMARK DRIVE,  
SUITE 202  
MIAMISBURG, OHIO 45342  
937 461 3290 PHONE  
jpa@johnpoe.com

Drawing Title

FIRST & SECOND FLOOR PLAN -  
REMOVALS

Approved: Project Director

Project Title

RELOCATE PROSTHETICS  
AND PODIATRY CLINICS

Location

Dayton, Ohio

Date

05.16.2016

Checked

CSS

Drawn

DPB

Project No.

VA Project No. 552-15-502  
JPA Project No. 14006.00

Building Number

307

Drawing Number

307PD101

Dwg. of

Office of  
Construction  
and Facilities  
Management




# FULLY SPRINKLERED

## GENERAL NOTES

A REFER TO SHEET P001 FOR LEGEND, SYMBOLS & INDEX OF DRAWINGS.

## PLAN NOTES

- EXISTING TO REMAIN.
- CAP EXISTING DCW SERVICE (SIZE AS INDICATED) ABOVE FIRST FLOOR CEILING INSIDE BUILDING 310.
- CAP EXISTING DHW SERVICE (SIZE AS INDICATED) ABOVE FIRST FLOOR CEILING INSIDE BUILDING 340.
- CAP EXISTING DHWR SERVICE (SIZE AS INDICATED) ABOVE FIRST FLOOR CEILING INSIDE BUILDING 340. PROVIDE BYPASS BETWEEN DHW & DHWR WITH FLOW CONTROLLER SET AT 15 GPM.
- CAP EXISTING SANITARY MAIN (SIZE AS INDICATED) LOCATED IN GRADE BELOW EXISTING B307 FLOOR SLAB AT WALL BETWEEN BUILDING 340 & 307.
- CAP EXISTING STORM MAIN (SIZE AS INDICATED) LOCATED IN GRADE BELOW EXISTING B310 FLOOR SLAB AT WALL BETWEEN BUILDING 307 & 310.
- REMOVAL OF EXISTING PLUMBING SYSTEMS LOCATED IN BUILDING 307 BY GENERAL CONTRACT.
- TEMPORARY CONSTRUCTION PARTITION. REFER TO ARCHITECTURAL PLANS FOR ADDITIONAL INFORMATION.
- REMOVE EXISTING ACRYLIC SHOWER UNIT, SHOWER VALVE AND HEAD TO FACILITATE TEMPORARY CONSTRUCTION PARTITION. CAP SUPPLY, DRAIN, AND VENT CONNECTIONS TO ACCOMMODATE REPLACEMENT OF SHOWER IN SAME LOCATION. UPON COMPLETION OF BUILDING 307 DEMOLITION WORK AND REMOVAL OF TEMPORARY CONSTRUCTION PARTITION, PROVIDE NEW F701 FIXTURE AND MODIFY EXISTING SUPPLY, DRAIN AND VENT CONNECTIONS AS REQUIRED TO COMPLETE INSTALLATION.
- EXISTING WALL-HUNG WATER CLOSET AND LAVATORY SHALL REMAIN OPERABLE THROUGHOUT DEMO AND NEW CONSTRUCTION PHASES.
- PROVIDE PARALLEL PIPING SYSTEMS SUPPORTED FROM STRUCTURE FOR THE 1" O2, 0.75" N AND 0.75" N02 PIPING THAT ARE CURRENTLY SUPPORTED FROM B307/B310 WALL. SWITCH PIPING SYSTEMS OVER TO NEW PARALLEL SYSTEMS AND REMOVE EXISTING O2, N AND N02 PIPING SUPPORTED FROM B307/B310 WALL UPON COMPLETION, TESTING, AND CERTIFICATION OF NEW PARALLEL PIPING SYSTEMS.
- PROVIDE PARALLEL PIPING SYSTEM SUPPORTED FROM STRUCTURE FOR THE 1.25" MA PIPING THAT IS CURRENTLY SUPPORTED FROM B307/B310 - SECOND FLOOR MECHANICAL ROOM WALL. SWITCH MA PIPING SYSTEM OVER TO NEW PARALLEL SYSTEM AND REMOVE EXISTING 1.25" MA PIPING SUPPORTED FROM B307/B310 - SECOND FLOOR MECHANICAL ROOM WALL UPON COMPLETION, TESTING, AND CERTIFICATION OF NEW PARALLEL PIPING SYSTEM.

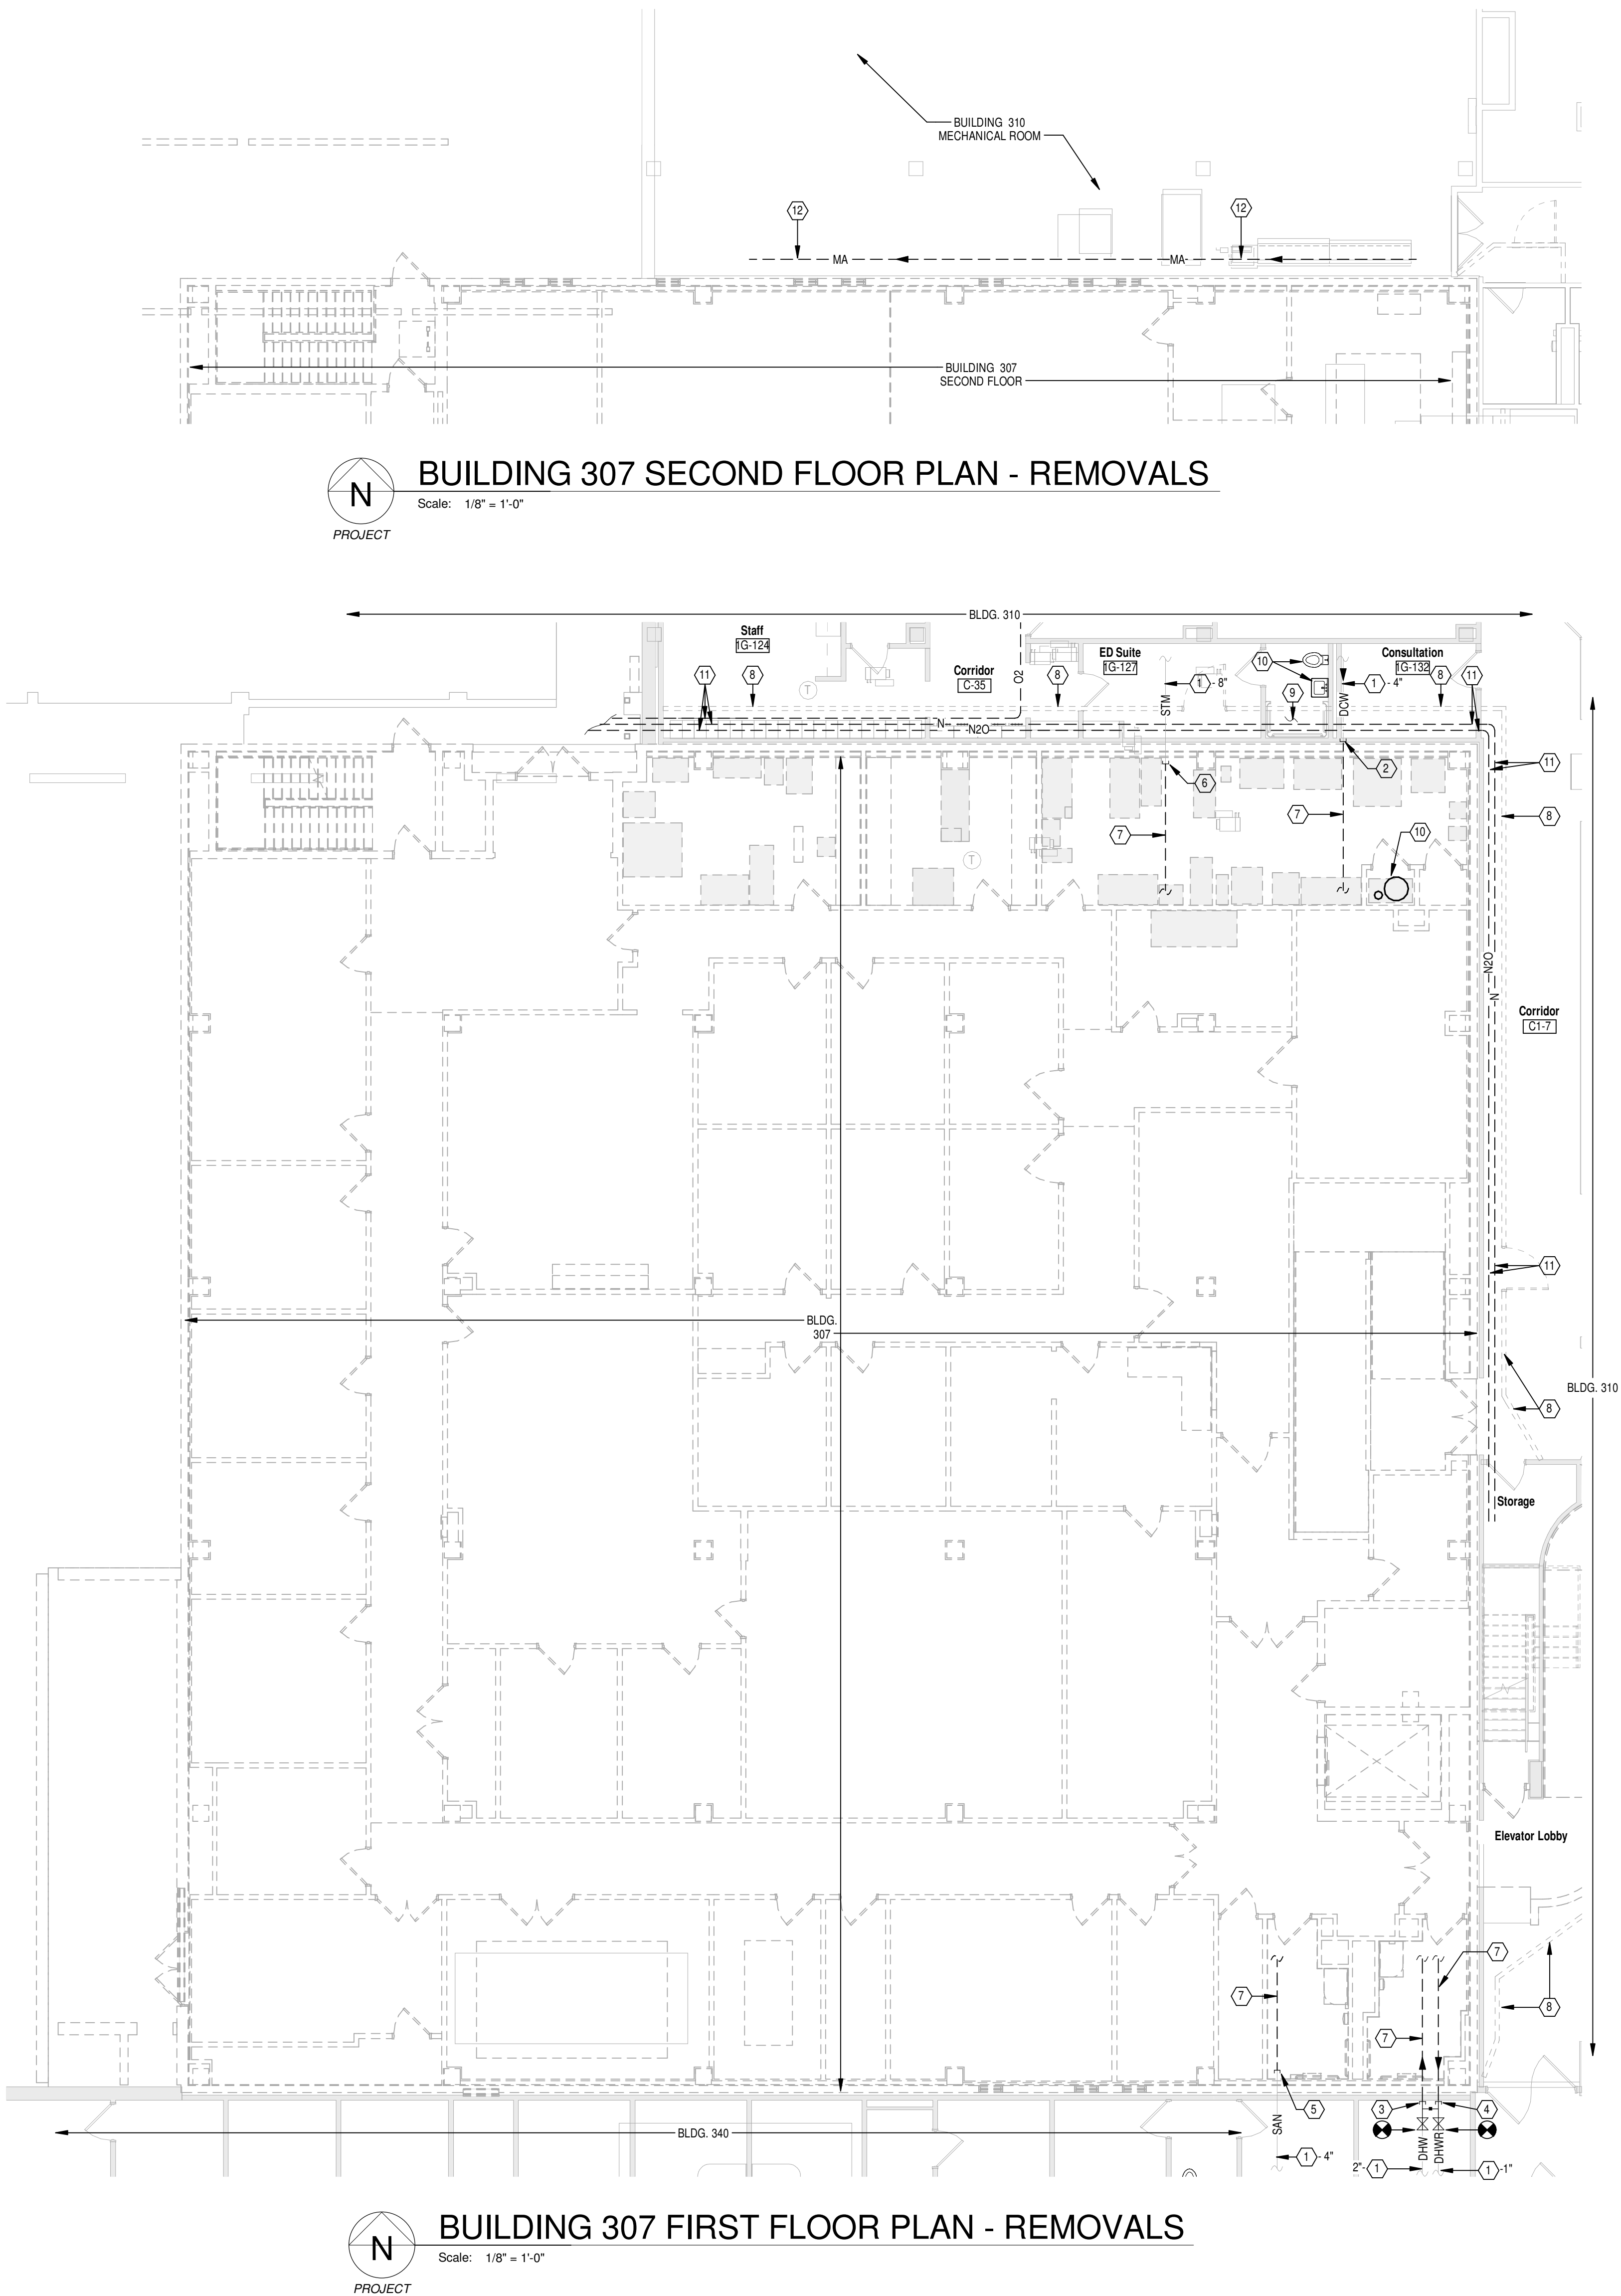

BUILDING 307 FIRST FLOOR PLAN - REMOVALS

Scale: 1/8" = 1'-0"

KEY PLAN

Scale: N.T.S.



FULLY SPRINKLERED

GENERAL NOTES

- A. COORDINATE PHASING VERY CLOSELY WITH COR. STEAM MAY ONLY BE TAKEN OUT OF SERVICE BETWEEN JUNE 1 AND SEPTEMBER 30.  
B. B307 IS BEING DEMOLISHED ALONG WITH ALL HVAC EQUIPMENT WITHIN. ALL UTILITIES ROUTED THRU OR SERVING B307 SHALL BE CAPPED JUST OUTSIDE THE BUILDING OR RE-ROUTED.  
C. REFER TO SHEET M001 FOR LEGEND, SYMBOLS & ADDITIONAL GENERAL NOTES. REFER TO SHEETS M501-M503 FOR DETAILS AND CONTROLS. REFER TO SHEET M601 FOR SCHEDULES.  
D. REFER TO SHEET 340MH101 FOR NEW WORK IN THIS AREA THAT IS REQUIRED PRIOR TO ANY REMOVALS.


PLAN NOTES

1. EXISTING PIPING TO REMAIN.  
2. REMOVE PIPING TO THIS POINT AND CAP.  
3. REMOVE EXISTING PIPING AND ASSOCIATED VALVES, HANGERS, ETC.  
4. PIPING TO BE DEMOLISHED WITH BUILDING.  
5. EXISTING AIR HANDLING UNIT TO BE DEMOLISHED WITH BUILDING.  
6. PIPING EXTENDS DOWN THRU CHASE BELOW GRADE.  
7. EXISTING DUCTWORK TO REMAIN.  
8. REMOVE EXISTING DUCTWORK AND ASSOCIATED HANGERS, DAMPERS, ETC.  
9. REMOVE DUCTWORK TO THIS POINT. REMAINING DUCTWORK TO BE DEMOLISHED WITH BUILDING.  
10. B307 IS BEING DEMOLISHED BY DIVISION 1 ALONG WITH ALL HVAC EQUIPMENT AND UTILITIES WITHIN.  
11. REMOVE PIPING TO THIS POINT. REMAINING PIPING TO BE DEMOLISHED WITH BUILDING.  
12. EXISTING BELOW GRADE PIPING TO REMAIN.  
13. PROVIDE VALVES AS REQUIRED TO ACCOMMODATE PHASING.  
14. PIPING TO BE PROVIDED UNDER THIS PROJECT PRIOR TO REMOVALS ON THIS SHEET. REFER TO SHEET 340MH101.  
15. EXISTING PROSTHETIC EQUIPMENT AND DUST COLLECTOR BEING RELOCATED TO SECOND FLOOR OF B303. REFER TO SHEET 330MH101 FOR NEW LOCATION. NEW DUCTWORK, HOODS, DAMPERS ETC. SHALL MIMIC EXISTING.  
16. REMOVE EXISTING AIR DEVICE AND ASSOCIATED DUCTWORK. REMOVE DUCTWORK TO MAIN AND CAP.  
17. REMOVE EXISTING AIR DEVICE AND ASSOCIATED DUCTWORK AS REQUIRED TO ACCOMMODATE TEMPORARY WALL. CLEAN, STORE AND REPLACE WHEN TEMPORARY WALL IS REMOVED.  
18. ITEM 31 IS NOT CURRENTLY CONNECTED TO THE DUST COLLECTION SYSTEM BUT SHALL BE IN NEW WORK.  
19. THE EQUIPMENT THIS DUCT SERVED WILL HAVE ITS OWN DUST COLLECTOR (OWNER PROVIDED) IN NEW WORK. INFORMATION ONLY - NO WORK REQUIRED.  
20. REMOVE EXISTING AIR DEVICE. PROVIDE NEW AIR DEVICE IN NEW CEILING. EXTEND/MODIFY DUCTWORK AS REQUIRED.


DUST COLLECTOR AND EQUIPMENT

- ① STERNVENT DUST COLLECTOR  
③ BAND SAW  
④ TRAUTMAN BELT/DISC SANDER  
⑤ TRAUTMAN CARVER  
⑥ TRAUTMAN DISC SANDER  
⑦ BENCH GRINDER

NEW PIPING SHOWN ON SHEET 340MH101 SHALL BE INSTALLED AND STEAM SYSTEMS IN B315 SHALL BE OPERATIONAL PRIOR TO ANY REMOVALS ON THIS SHEET.

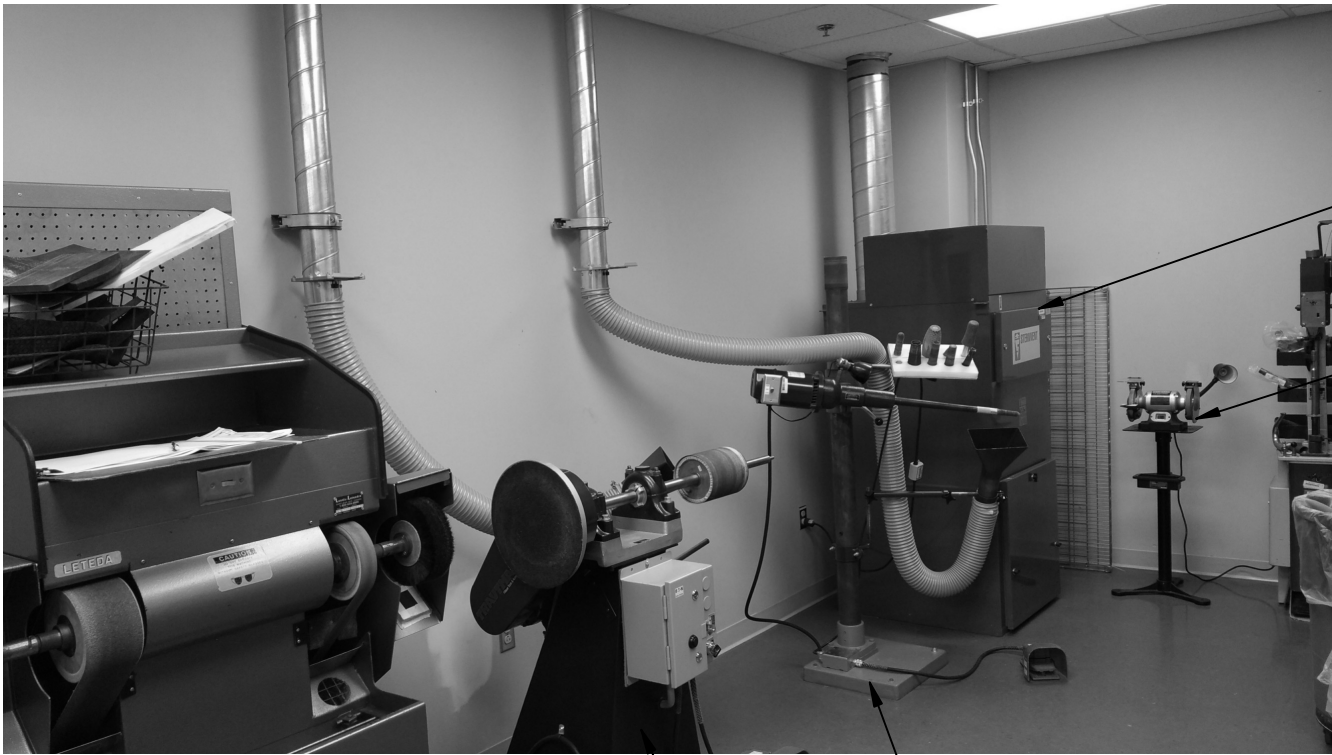

DUST COLLECTOR AND EQUIPMENT

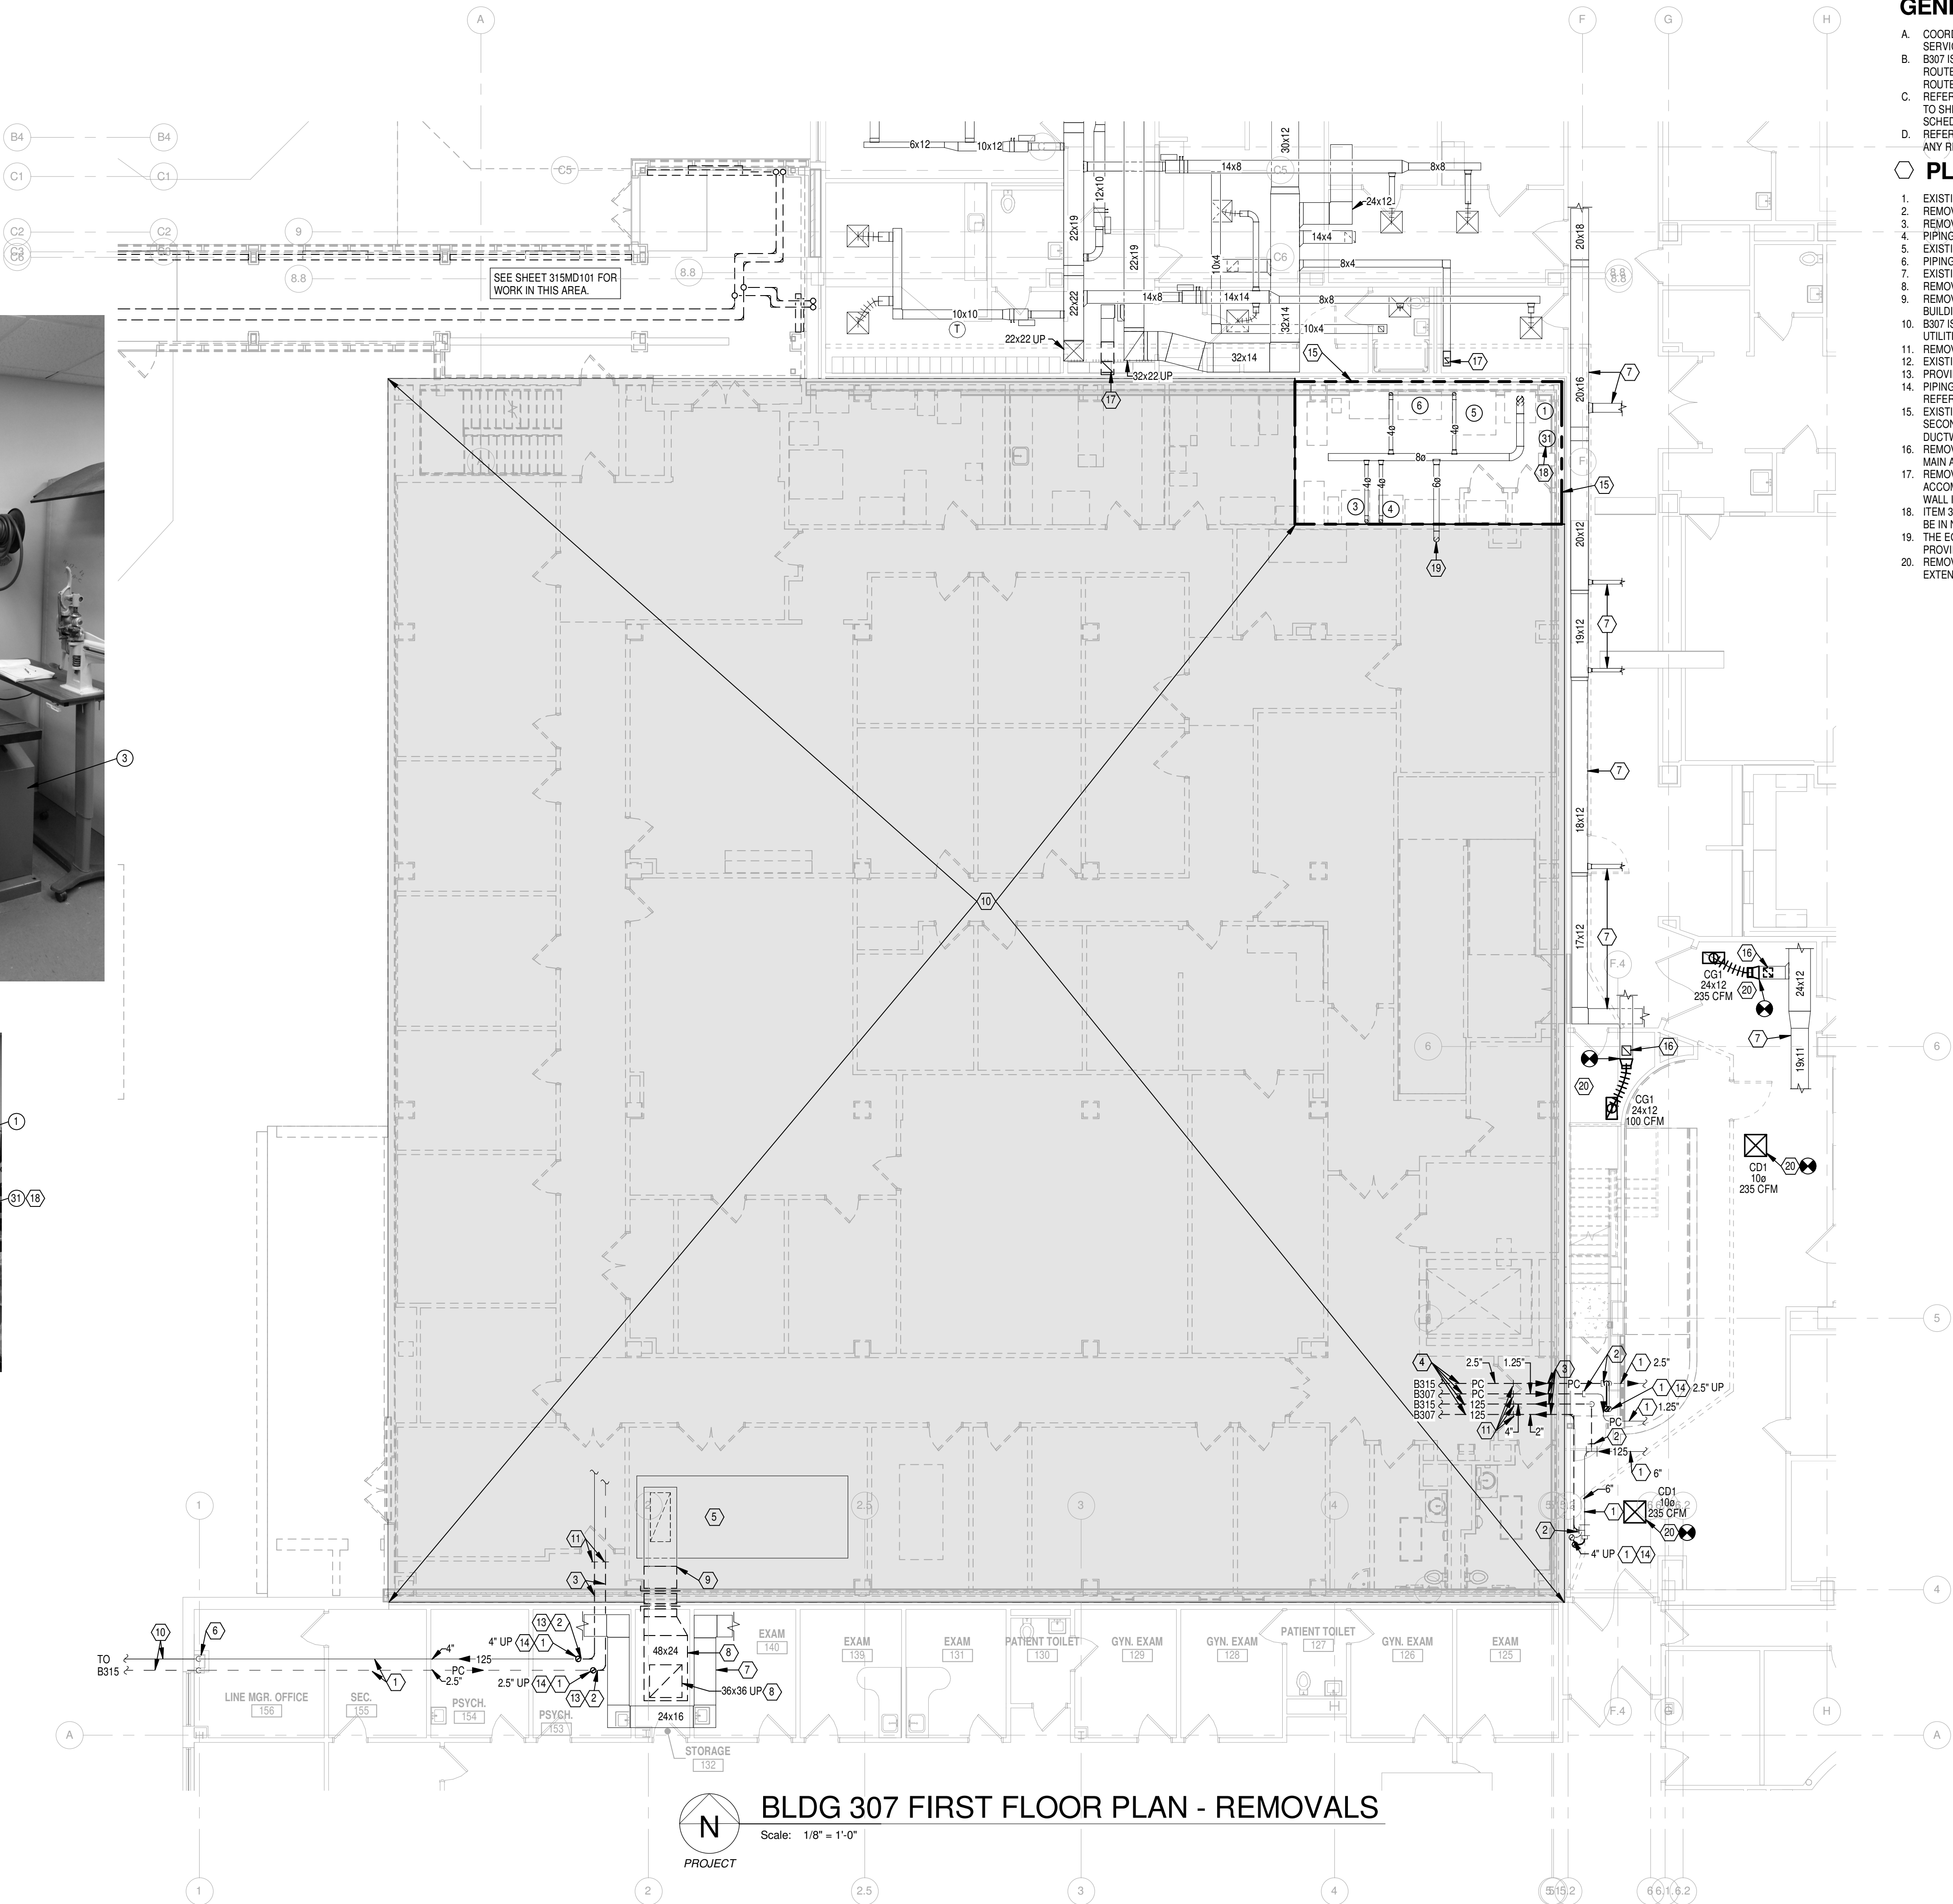


BLDG 307 FIRST FLOOR PLAN - REMOVALS

Scale: 1/8" = 1'-0"

KEY PLAN


Scale: N.T.S.

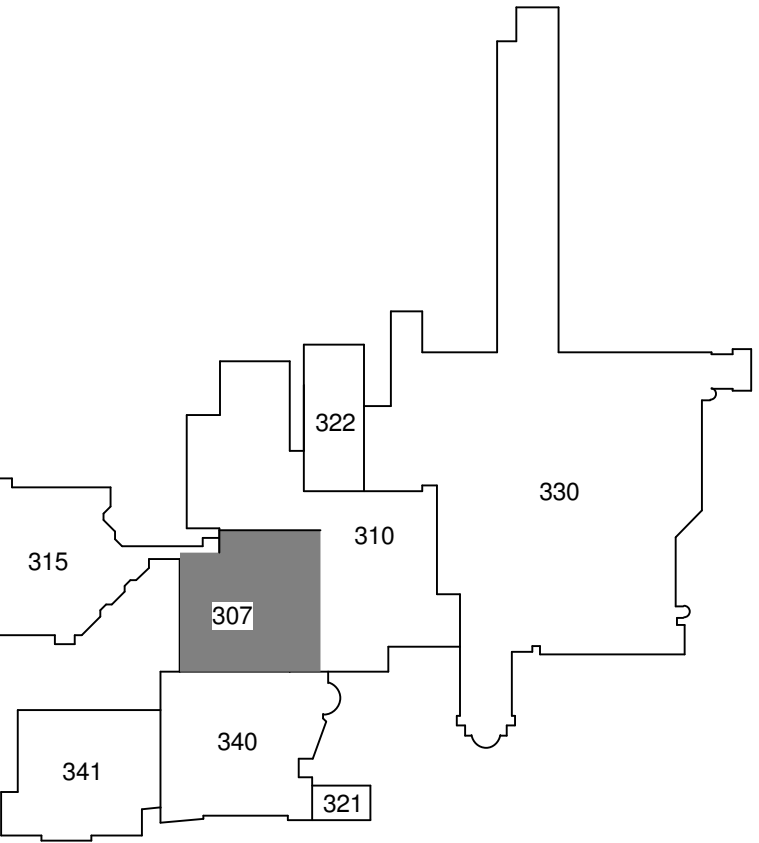

Revisions		Date
1	35% Schematic Design	03.05.2015
2	65% Design Development	04.28.2015
3	95% Owner Review	08.14.2015
4	100% Construction Documents	11.04.2015
5	Bid Set Drawings	01.15.2016

CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

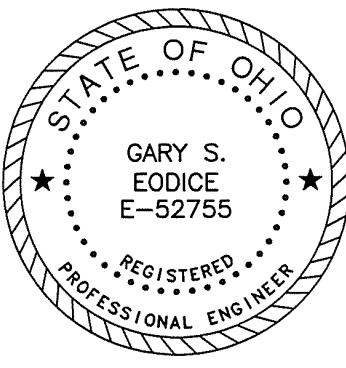

ARCHITECT/ENGINEERS:

JOHN POE ARCHITECTS



3131 NEWMARK DRIVE,  
SUITE 200  
MIAMISBURG, OHIO 45342  
937 461 3290 PHONE  
jpae@johnpoe.com

Drawing Title

FIRST FLOOR PLAN - REMOVALS

Approved: Project Director

Project Title

RELOCATE PROSTHETICS  
AND PODIATRY CLINICS

Location

Dayton, Ohio

Date

05.16.2016

Checked

PCW

Drawn

WJS

Project No.

552-15-502

JPA Project No.

14006.00

Building Number

307

Drawing Number

307MD101

Dwg. of

Office of  
Construction  
and Facilities  
Management



three inches = one foot  
one and one-half inches = one foot  
one inch = one foot  
three-quarters inch = one foot  
one-half inch = one foot  
three-eighths inch = one foot  
one-quarter inch = one foot  
one-eighth inch = one foot

FULLY SPRINKLERED

GENERAL NOTES


- A. COORDINATE PHASING VERY CLOSELY WITH COR. STEAM MAY ONLY BE TAKEN OUT OF SERVICE BETWEEN JUNE 1 AND SEPTEMBER 30.  
B. REFER TO SHEET M001 FOR LEGEND, SYMBOLS & ADDITIONAL GENERAL NOTES. REFER TO SHEETS M501-M503 FOR DETAILS AND CONTROLS. REFER TO SHEET M501 FOR SCHEDULES.

PLAN NOTES

1. B307 IS BEING DEMOLISHED BY DIVISION 1 ALONG WITH ALL HVAC EQUIPMENT AND UTILITIES WITHIN.  
2. REMOVE EXISTING LOUVERED PENTHOUSE AND ASSOCIATED DUCTWORK, ETC. EXISTING CURB TO REMAIN. CAP IN NEW WORK. REFER TO SHEET 340MH101.  
3. EXISTING PIPING TO REMAIN.  
4. REMOVE PIPE BACK TO THIS POINT FOR RECONNECTION IN NEW WORK.  
5. PROVIDE UNION AT POINT OF NEW CONNECTION.  
6. EXISTING TO REMAIN.  
7. REMOVE EXISTING MEDIUM PRESSURE CONDENSATE RETURN PIPING TO ACCOMMODATE INSTALLATION OF NEW WALL. SEE NEW WORK PLAN ON THIS SHEET FOR NEW LOCATION.  
8. PROVIDE MEDIUM PRESSURE CONDENSATE RETURN PIPING. INSTALL PIPING TO ALLOW GRAVITY FLOW. DO NOT LIFT.  
9. REMOVE EXISTING AIR DEVICE AND ASSOCIATED DUCTWORK, ETC.  
10. REMOVE DUCTWORK BACK TO THIS POINT AND CAP.  
11. REMOVE EXISTING AIR DEVICE AND ASSOCIATED DUCTWORK. REMOVE DUCTWORK TO MAIN AND CAP.


BLDG 310 SECOND FLOOR PLAN - NEW WORK

Scale: 1/8" = 1'-0"

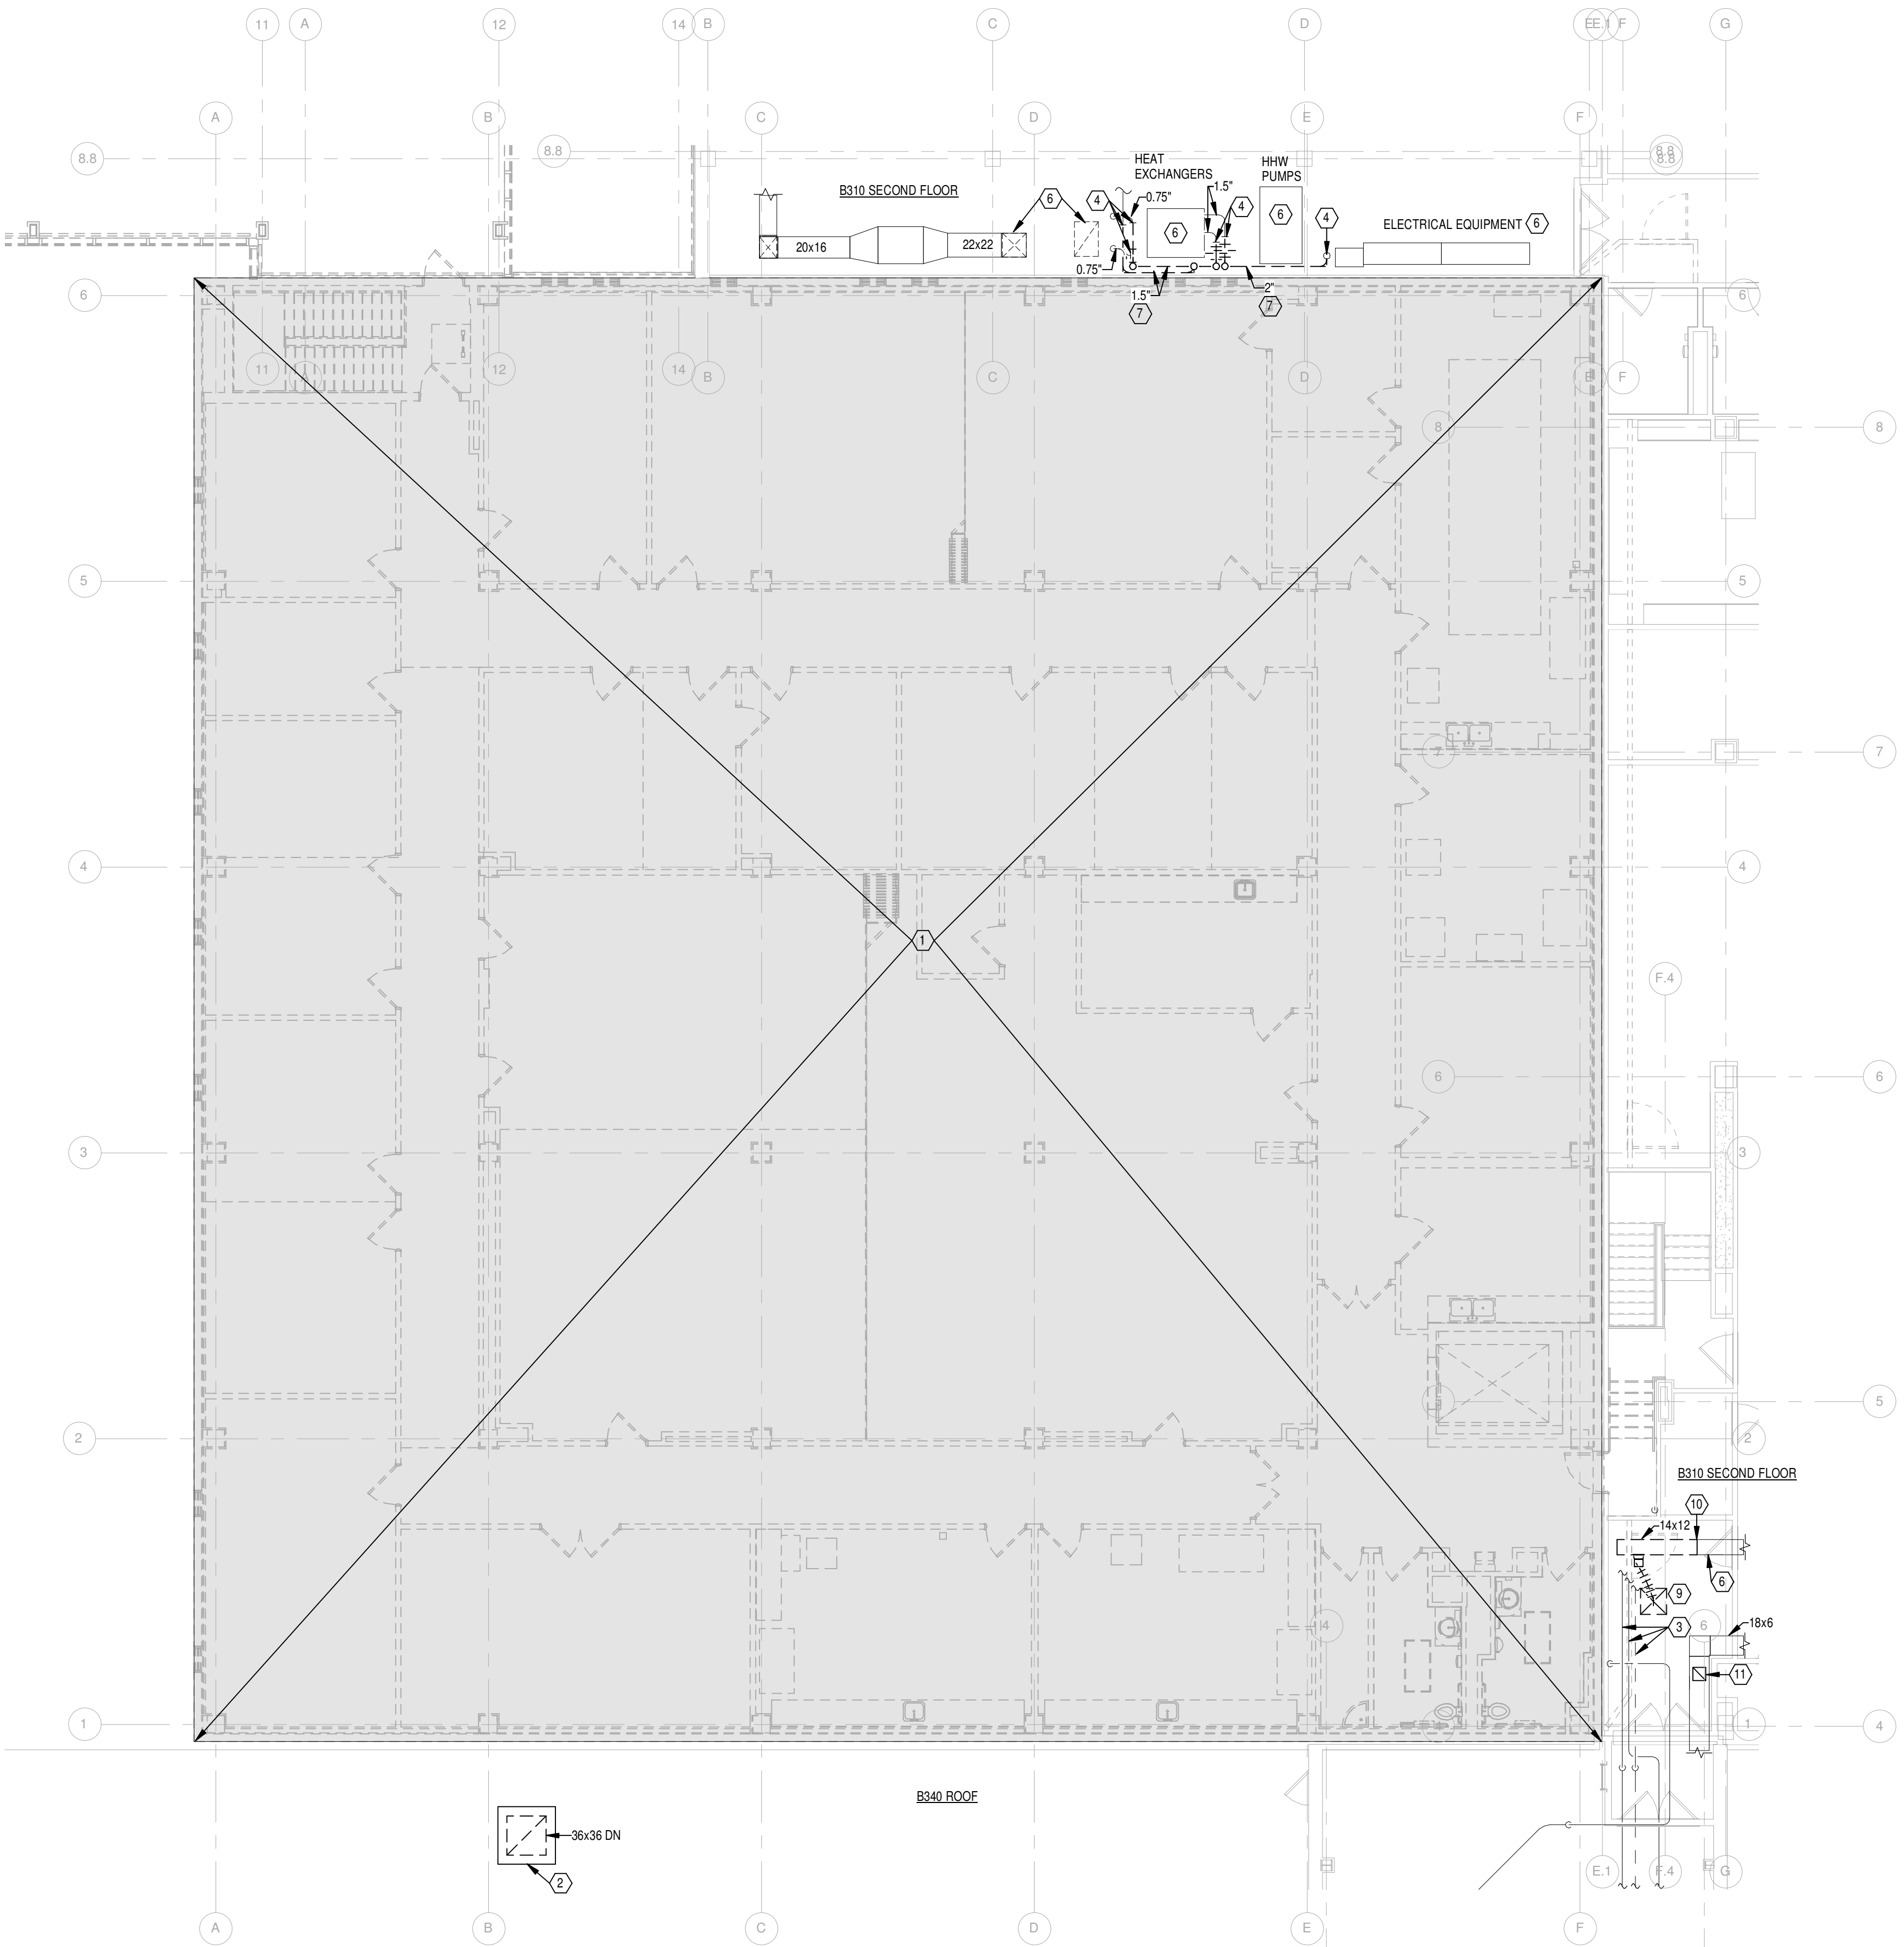


BLDG 307 SECOND FLOOR PLAN - REMOVALS

Scale: 1/8" = 1'-0"



KEY PLAN


Scale: N.T.S.

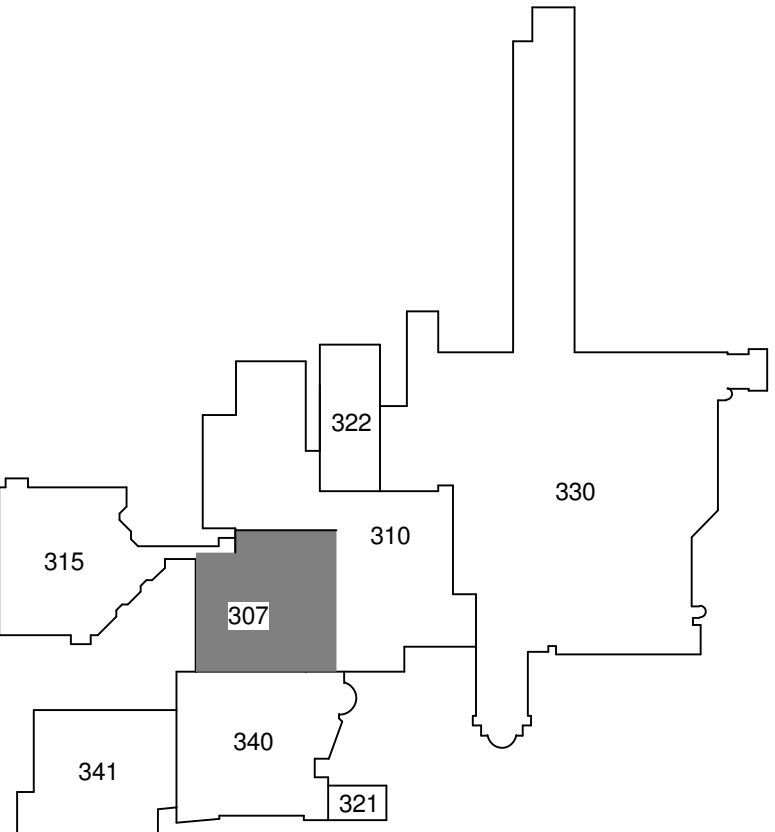

Revisions	Date
1	35% Schematic Design 03.05.2015
2	65% Design Development 04.28.2015
3	95% Owner Review 08.14.2015
4	100% Construction Documents 11.04.2015
5	Bid Set Drawings 01.15.2016

CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

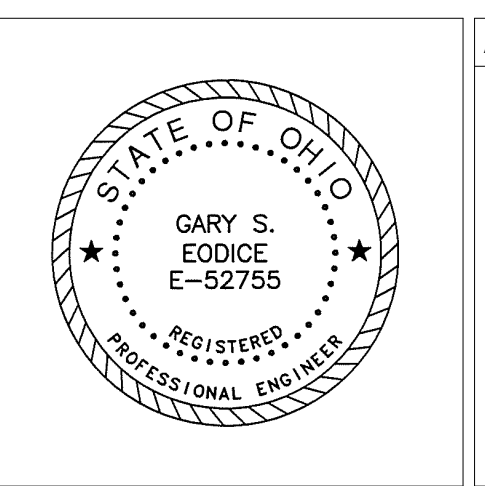

ARCHITECT/ENGINEERS:

**JOHN POE ARCHITECTS**

3131 NEWMARK DRIVE, SUITE 200  
MIAMISBURG, OHIO 45342  
937.461.3290 PHONE  
jpae@johnpoe.com

Drawing Title

**SECOND FLOOR PLAN - REMOVALS AND NEW WORK**

Approved: Project Director

Project Title

**RELOCATE PROSTHETICS AND PODIATRY CLINICS**

Location

**Dayton, Ohio**

Date

**05.16.2016**

Checked

**PCW**

Drawn

**WJS**

Project No.  
VA Project No. 552-15-502  
JPA Project No. 14006.00

Building Number

**307**

Drawing Number

**307MD102**

Dwg. of

Office of Construction and Facilities Management

Department of Veterans Affairs



three inches = one foot  
one and one-half inches = one foot  
one inch = one foot  
three-quarters inch = one foot  
one-half inch = one foot  
three-eighths inch = one foot  
one-quarter inch = one foot  
one-eighth inch = one foot


FULLY SPRINKLERED

GENERAL NOTES

- A. REFER TO SHEET M001 FOR LEGEND, SYMBOLS & ADDITIONAL GENERAL NOTES. REFER TO SHEETS M501-M503 FOR DETAILS AND CONTROLS. REFER TO SHEET M801 FOR SCHEDULES.


PLAN NOTES

1. EXISTING EXHAUST FANS TO BE DEMOLISHED WITH BUILDING.  
2. RECLAIM REFRIGERANT FROM EXISTING CONDENSING UNIT. UNIT TO BE DEMOLISHED WITH BUILDING.  
3. EXISTING AIR HANDLING UNIT TO BE DEMOLISHED WITH BUILDING.  
4. EXIST' IS BEING DEMOLISHED BY DIVISION 1 ALONG WITH ALL HVAC EQUIPMENT AND UTILITIES WITHIN.  
5. REFER TO SHEET 310MH101 FOR WORK IN THIS AREA.

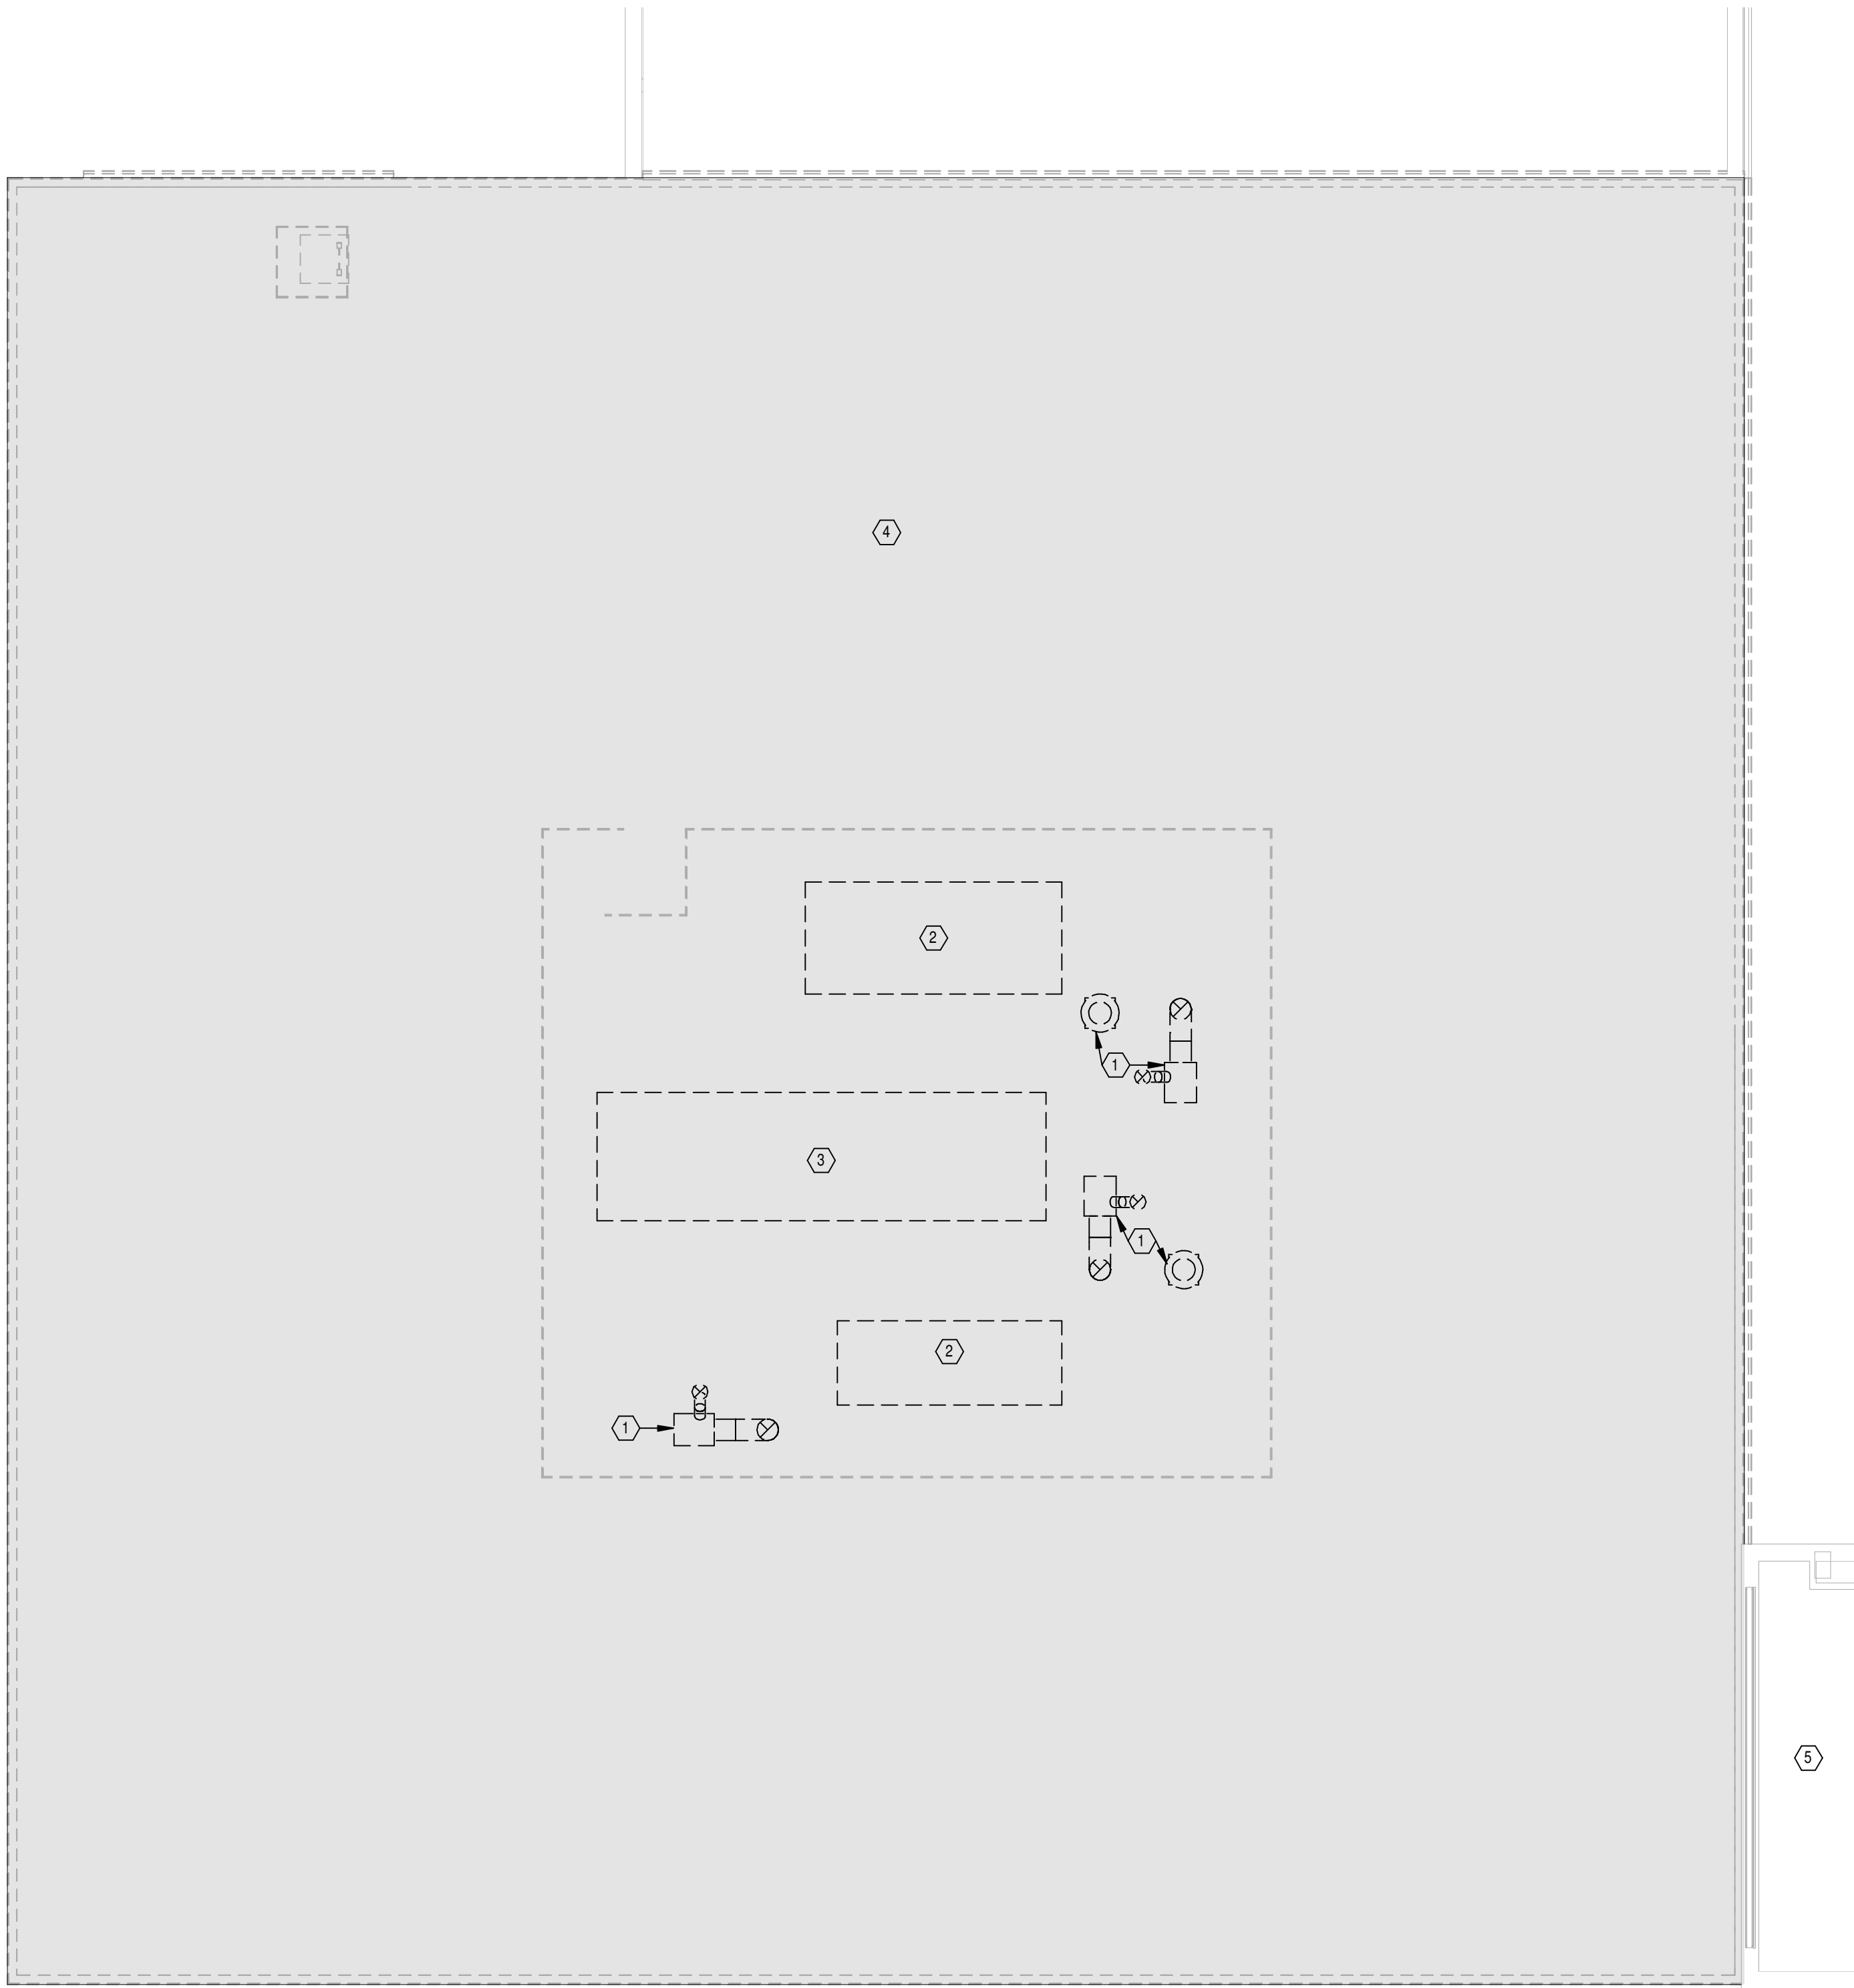

BLDG 307 ROOF PLAN - REMOVALS

Scale: 1/8" = 1'-0"

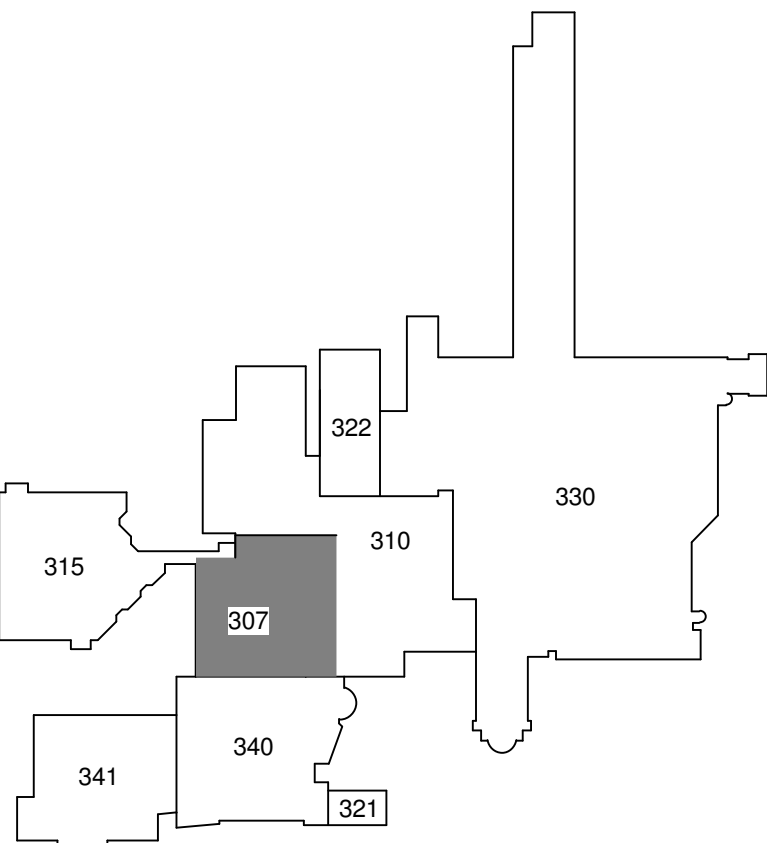


KEY PLAN

Scale: N.T.S.

Revisions		Date
1	35% Schematic Design	03.05.2015
2	65% Design Development	04.28.2015
3	95% Owner Review	08.14.2015
4	100% Construction Documents	11.04.2015
5	Bid Set Drawings	01.15.2016

CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

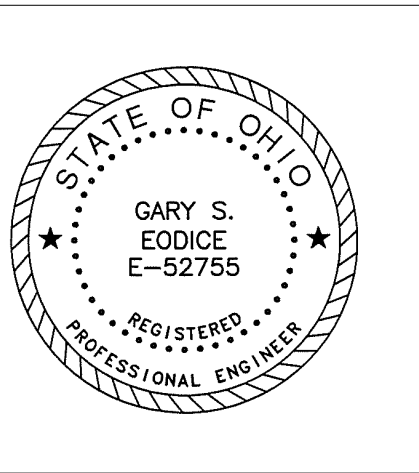

ARCHITECT/ENGINEERS:

**JOHN POE ARCHITECTS**

3131 NEWMARK DRIVE,  
SUITE 200  
MIAMISBURG, OHIO 45342  
937.461.3290 PHONE  
jpae@johnpoe.com

Drawing Title

**ROOF PLAN - REMOVALS**

Approved: Project Director

Project Title

**RELOCATE PROSTHETICS  
AND PODIATRY CLINICS**

Location

**Dayton, Ohio**

Date

**05.16.2016**

Checked

**PCW**

Drawn

**WJS**

Project No.  
VA Project No. **552-15-502**  
JPA Project No. **14006.00**

Building Number

**307**

Drawing Number

**307MD103**

Dwg. of

Office of  
Construction  
and Facilities  
Management

Department of  
Veterans Affairs



three inches = one foot  
one and one-half inches = one foot  
one inch = one foot  
three-quarters inch = one foot  
one-half inch = one foot  
three-eighths inch = one foot  
one-quarter inch = one foot  
one-eighth inch = one foot

FULLY SPRINKLERED

GENERAL NOTES

- A. REFER TO SHEET M001 FOR LEGEND, SYMBOLS & ADDITIONAL GENERAL NOTES.  
B. FIELD VERIFY ALL LOUVER SIZES PRIOR TO ORDERING.


PLAN NOTES

1. REPLACE EXISTING PREFILTERS (1/2) 24x24x2 EVERY MONDAY, WEDNESDAY AND FRIDAY DURING DEMOLITION OF B307. COORDINATE DURATION OF BUILDING DEMOLITION WITH DIVISION 1.  
2. REPLACE EXISTING PREFILTERS (2) 24x24x2 EVERY MONDAY, WEDNESDAY AND FRIDAY DURING DEMOLITION OF B307. COORDINATE DURATION OF BUILDING DEMOLITION WITH DIVISION 1.  
3. VACUUM CLEAN AND MOP LOUVER, OUTSIDE AIR PLENUM/DUCTWORK, AND INSIDE OF AHU UP TO AND INCLUDING FILTER SECTION UPON COMPLETION OF B307 DEMOLITION.  
4. AIR SIDE ECONOMIZER SHALL BE LOCKED OUT DURING B307 DEMOLITION.  
5. REPLACE EXISTING PREFILTERS (1/2) 24x24x2 AND FINAL FILTERS (1/2) 24x24x12 UPON COMPLETION OF B307 DEMOLITION.  
6. REPLACE EXISTING PREFILTERS (2) 24x24x2 AND FINAL FILTERS (2) 24x24x12 UPON COMPLETION OF B307 DEMOLITION.



B310 THIRD FLOOR MECHANICAL ROOM - IAQ PLAN

Scale: 1/8" = 1'-0"

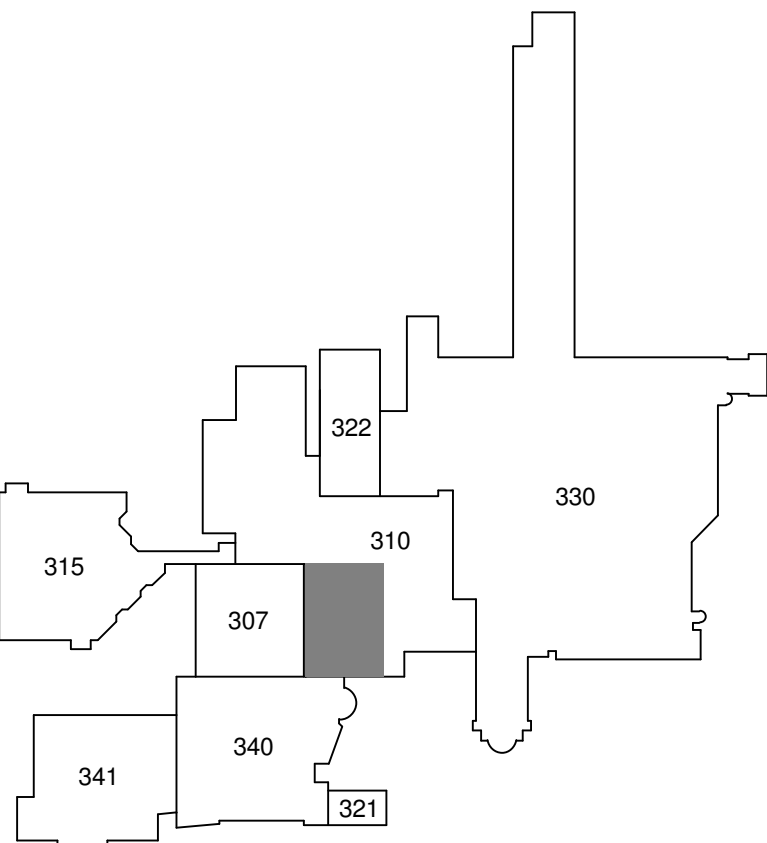


FULLY SPRINKLERED

GENERAL NOTES

- A. REFER TO SHEET M001 FOR LEGEND, SYMBOLS & ADDITIONAL GENERAL NOTES.  
B. FIELD VERIFY ALL FILTER SIZES PRIOR TO ORDERING.


PLAN NOTES

1. REPLACE EXISTING PREFILTERS (4) 24x24x4, (1) 24x12x1 EVERY MONDAY, WEDNESDAY AND FRIDAY DURING DEMOLITION OF B307. COORDINATE DURATION OF BUILDING DEMOLITION WITH DIVISION 1.  
2. VACUUM CLEAN AND MOP LOUVER, OUTSIDE AIR PLENUM/DUCTWORK, AND INSIDE OF AHU UP TO AND INCLUDING FILTER SECTION UPON COMPLETION OF B307 DEMOLITION.  
3. AIR SIDE ECONOMIZER SHALL BE LOCKED OUT DURING B307 DEMOLITION.  
4. REPLACE EXISTING PREFILTERS (4) 24x24x4, (1) 24x12x1 AND FINAL FILTERS (4) 24x24x12, (1) 24x12x12 UPON COMPLETION OF B307 DEMOLITION.

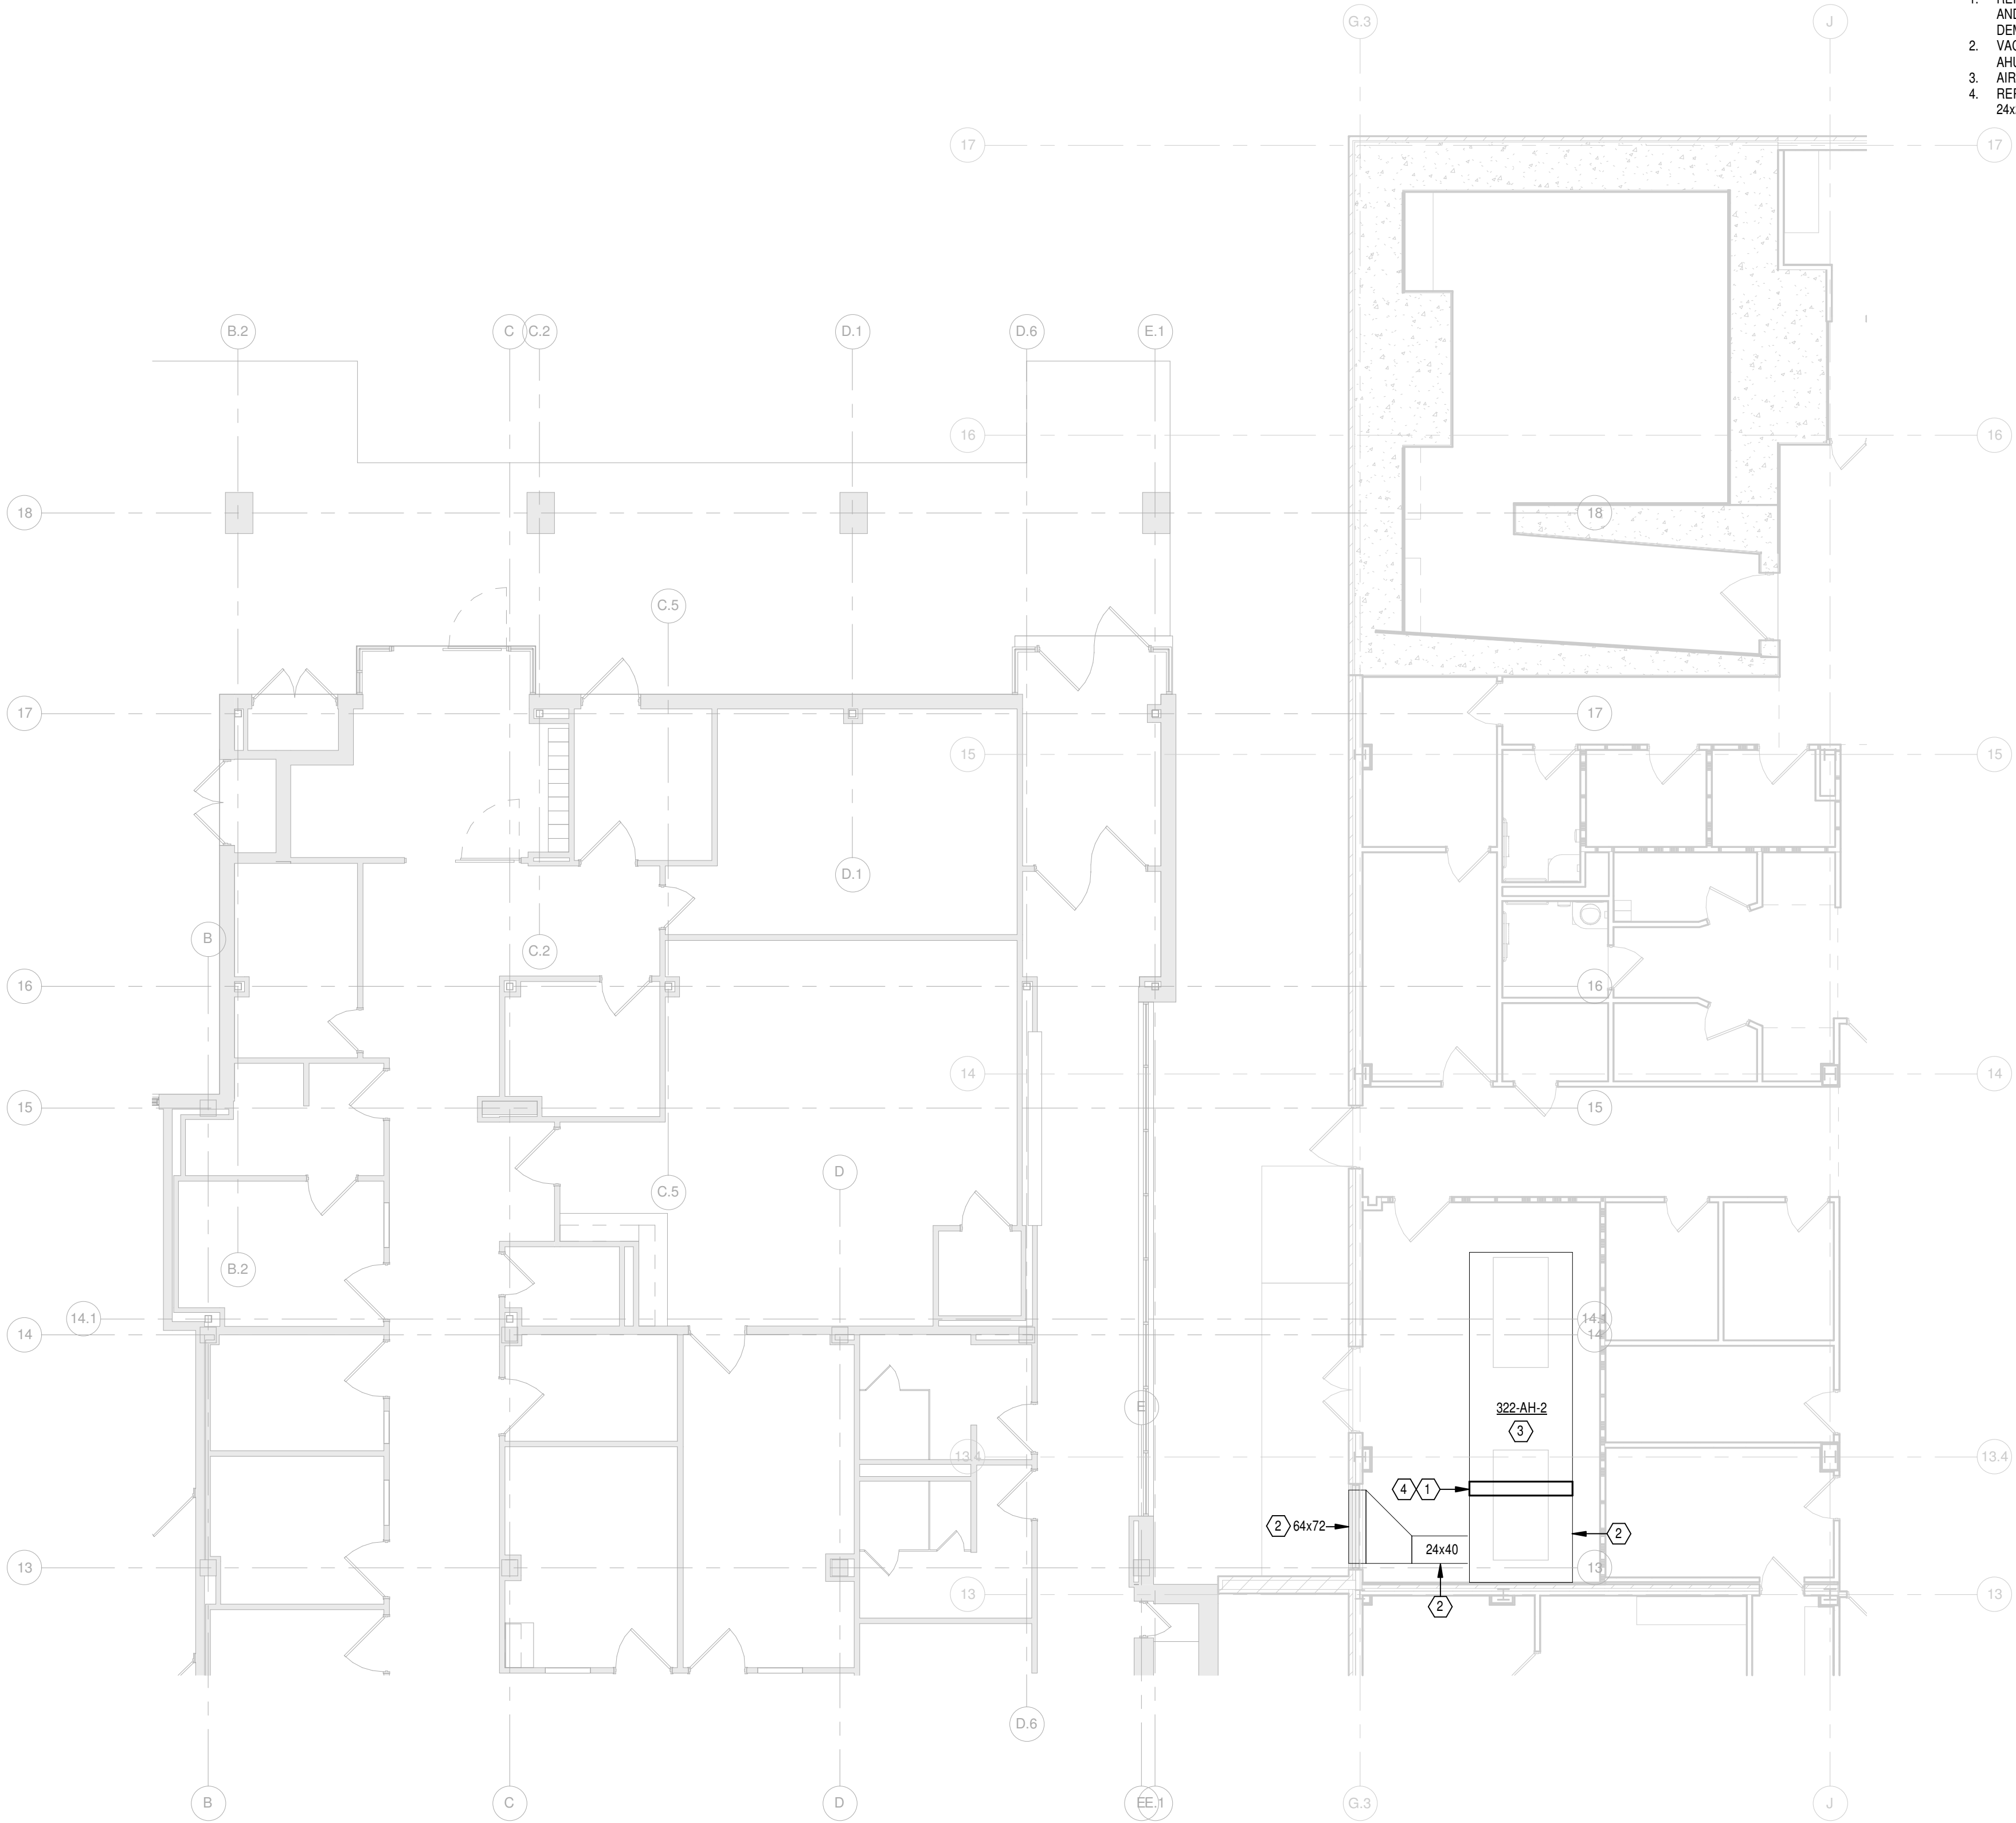

B322 FIRST FLOOR MECHANICAL ROOM - IAQ PLAN

Scale: 1/8" = 1'-0"

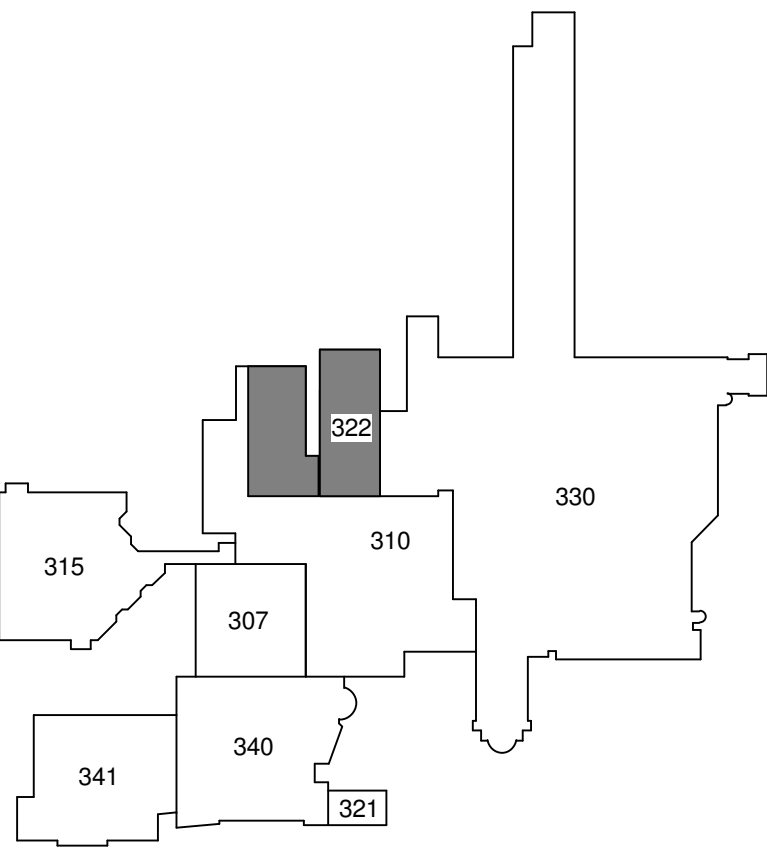

KEY PLAN


Scale: N.T.S.

5/13/2016 11:58:11 AM

Revisions		Date
1	35% Schematic Design	03.05.2015
2	65% Design Development	04.28.2015
3	95% Owner Review	08.14.2015
4	100% Construction Documents	11.04.2015
5	Bid Set Drawings	01.15.2016


CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

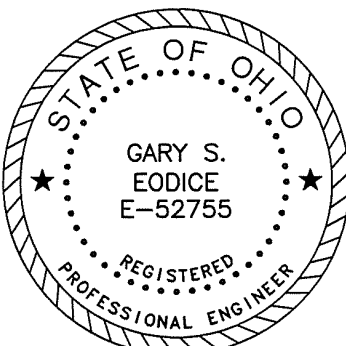

ARCHITECT/ENGINEERS:

JOHN POE ARCHITECTS

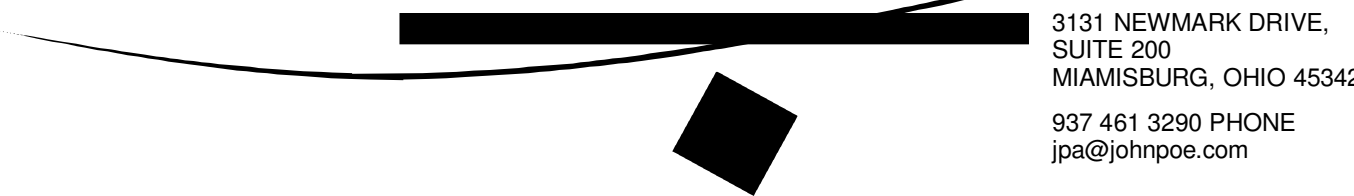

3131 NEWMARK DRIVE,  
SUITE 200  
MIAMISBURG, OHIO 45342  
937 461 3290 PHONE  
jpae@johnpoe.com

Drawing Title

FIRST FLOOR MECHANICAL ROOM  
- IAQ PLAN

Approved: Project Director

Project Title

RELOCATE PROSTHETICS  
AND PODIATRY CLINICS

Location

Dayton, Ohio

Date

05.16.2016

Checked

PCW

Drawn

WJS

Project No.

VA Project No. 552-15-502  
JPA Project No. 14006.00

Building Number

322

Drawing Number

322MH101

Dwg. of

Office of  
Construction  
and Facilities  
Management



FULLY SPRINKLERED

GENERAL NOTES

- A. COORDINATE PHASING VERY CLOSELY WITH COR. STEAM MAY ONLY BE TAKEN OUT OF SERVICE BETWEEN JUNE 1 AND SEPTEMBER 30.  
B. REFER TO SHEET M001 FOR LEGEND, SYMBOLS & ADDITIONAL GENERAL NOTES. REFER TO SHEETS M001-M003 FOR DETAILS AND CONTROLS. REFER TO SHEET M001 FOR SCHEDULES.  
C. REFER TO SHEET 307MD101 FOR REMOVAL WORK IN THIS AREA THAT IS TO TAKE PLACE AFTER NEW WORK IS COMPLETE.

PLAN NOTES

1. EXISTING PIPING TO REMAIN.  
2. EXISTING DUCTWORK TO REMAIN.  
3. EXTEND PIPING DOWN THRU ROOF. PROVIDE PIPE PENETRATION ROOF CURB. REFER TO FIRST FLOOR PLAN ON THIS SHEET FOR CONTINUATION.  
4. PROVIDE FRAME WITH SELF-SUPPORTING CLIPS ON EXTERIOR OF LOUVER TO HOUSE (1/8" 240042) PREFILTERS. REPLACE MEDIA EVERY MONDAY, WEDNESDAY AND FRIDAY DURING DEMOLITION OF B307. COORDINATE DURATION OF BUILDING DEMOLITION WITH DIVISION 1. PROVIDE RAIN HOOD AT TOP OF FRAME. EXTEND OUT 8". CAP EXISTING ROOF CURB WITH SHEET METAL. SEAL WEATHER TIGHT. PROVIDE R30 INSULATION WITH IN CURB.  
5. EXTEND PIPING UP THRU ROOF. REFER TO ROOF PLAN ON THIS SHEET FOR CONTINUATION.  
6. EXTEND PIPE UP THRU SECOND FLOOR. REFER TO ROOF PLAN ON THIS SHEET FOR CONTINUATION.  
7. PIPING EXTENDS DOWN THRU CHASE BELOW GRADE.  
8. EXISTING BELOW GRADE PIPING TO REMAIN.  
9. PROVIDE ROOF PIPING SUPPORTS IN THESE LOCATIONS FOR EACH PIPE INDIVIDUALLY PER DETAIL ON SHEET M503. REDUCE PIPE INSULATION THICKNESS AS REQUIRED AT SUPPORT LOCATIONS ONLY. PROVIDE TRANSITIONS.  
10. PROVIDE ROOF PIPING SUPPORTS IN THESE LOCATIONS FOR EACH PIPE INDIVIDUALLY PER DETAIL ON SHEET M503. REDUCE PIPE INSULATION THICKNESS AS REQUIRED AT SUPPORT LOCATIONS ONLY. PROVIDE TRANSITIONS. OMIT HOLD DOWN LUGS.  
11. EXTEND PIPING DOWN THRU FLOOR. REFER TO FIRST FLOOR PLAN ON THIS SHEET FOR CONTINUATION.  
12. PROVIDE SLEEVES THRU WALL WITH STAINLESS STEEL FACE PLATE TIED INTO WALL AT MORTAR JOINT. PROVIDE RUBBER BOOTS AT PIPE PENETRATIONS THRU FACE PLATE. SEAL AIR TIGHT.  
13. PROVIDE VALVES AS REQUIRED TO ACCOMMODATE PHASING.  
14. PROVIDE PIPE ANCHORS BELOW ROOF.  
15. EXISTING PIPING TO REMAIN WHILE WORK ON THIS SHEET TAKES PLACE. PIPING WILL ULTIMATELY BE DEMOLISHED WITH BUILDING 307.

NEW PIPING SHOWN ON THIS SHEET SHALL BE INSTALLED AND STEAM SYSTEMS IN B315 SHALL BE OPERATIONAL PRIOR TO THE DEMOLITION OF B307.

BUILDING 340 ROOF - NEW WORK


Scale: 1/8" = 1'-0"

BUILDING 340 FIRST FLOOR - NEW WORK

Scale: 1/8" = 1'-0"


KEY PLAN

Scale: N.T.S.

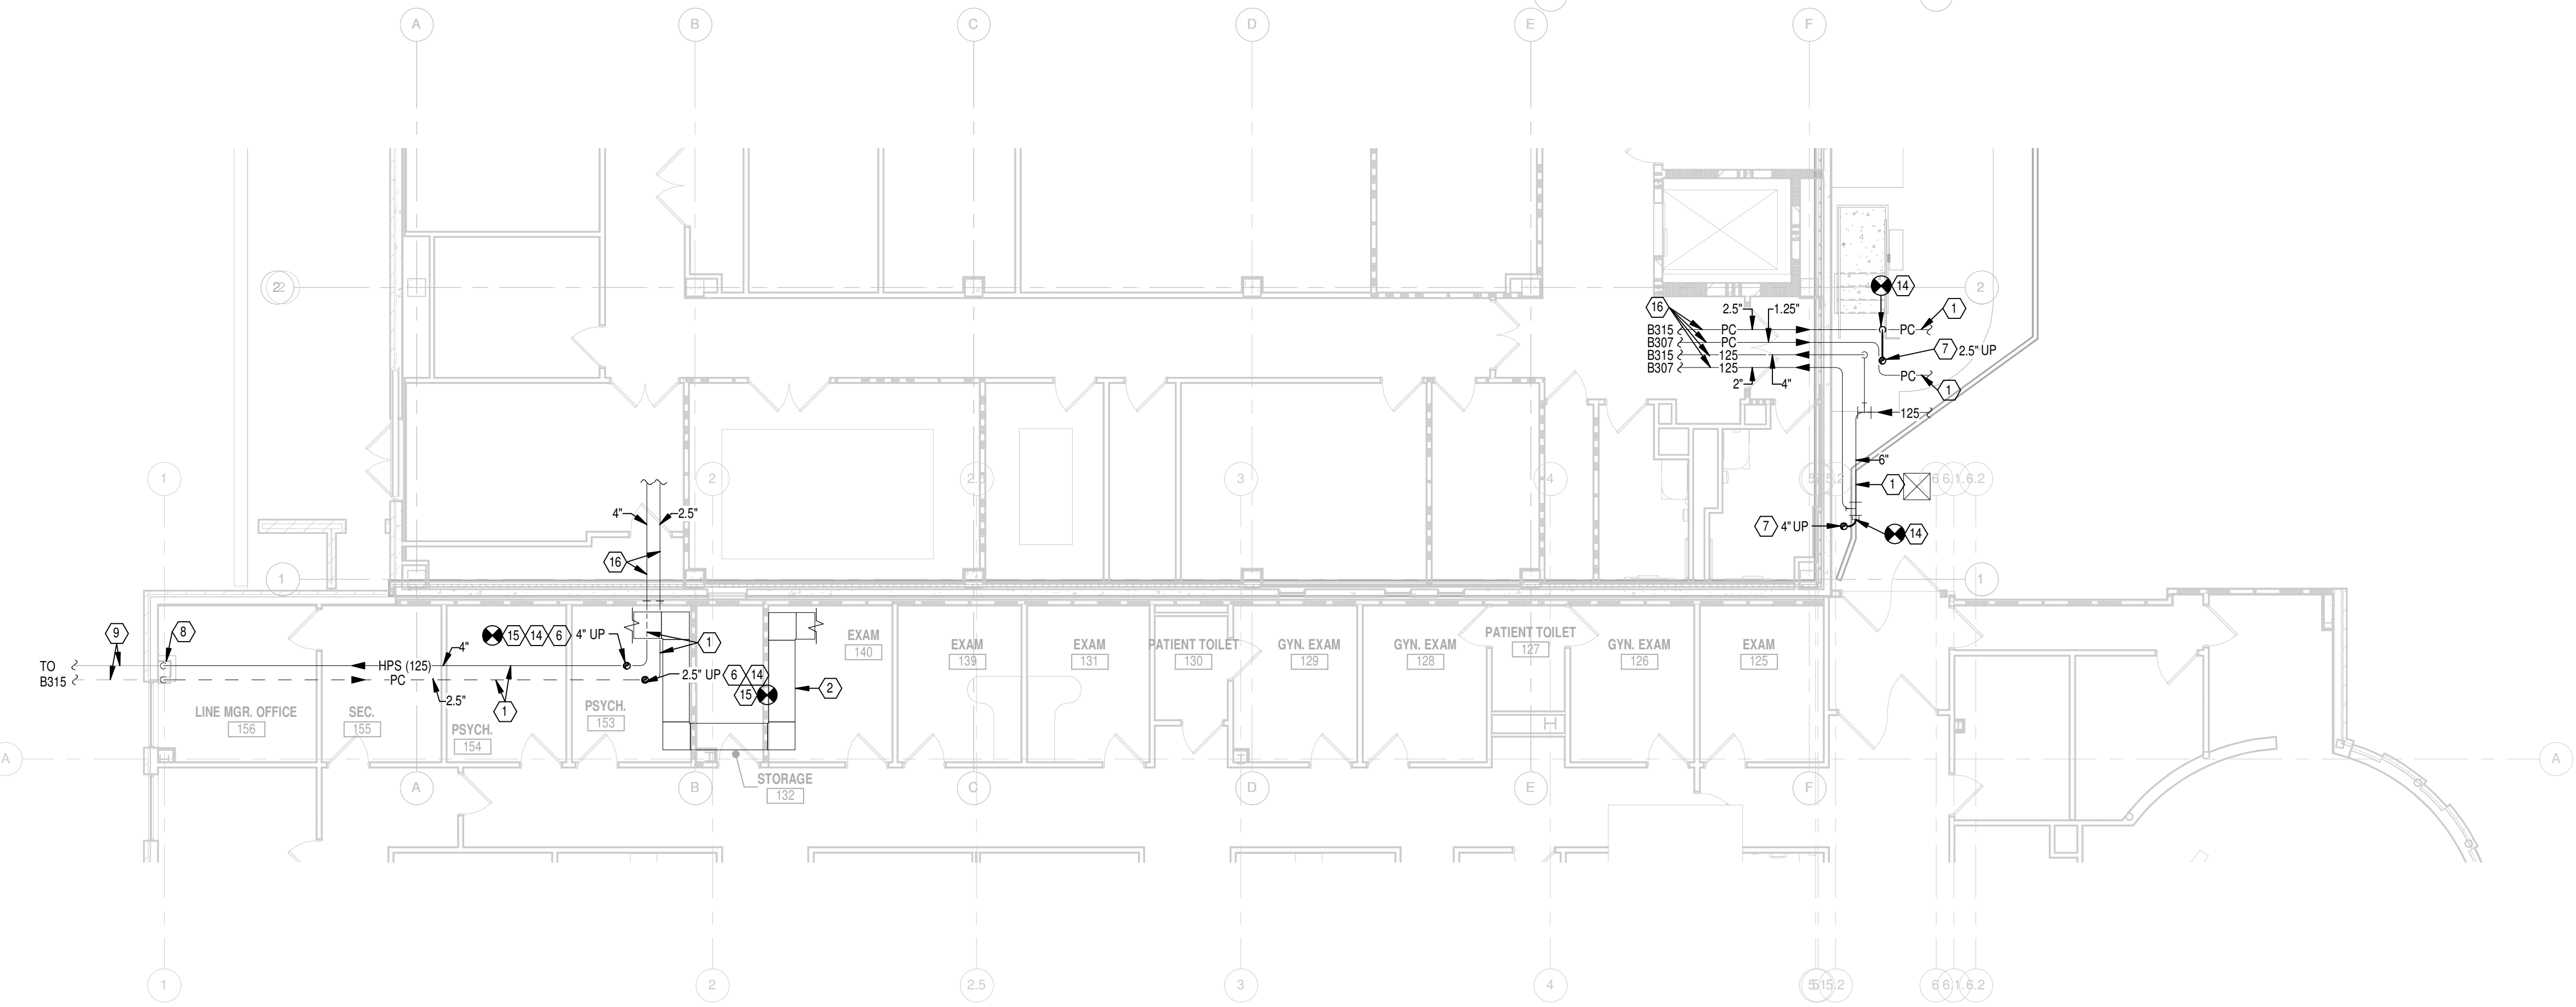

CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

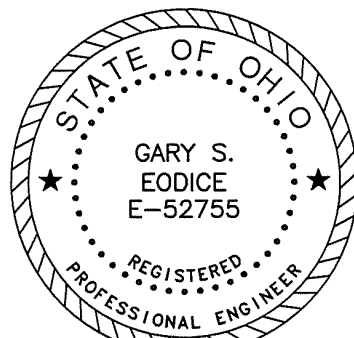

ARCHITECT/ENGINEERS:

JOHN POE ARCHITECTS

3131 NEWMARK DRIVE,  
SUITE 200  
MIAMISBURG, OHIO 45342  
937 461 3290 PHONE  
jpa@johnpoe.com

Drawing Title

PARTIAL FIRST FLOOR PLAN -  
REMOVALS AND NEW WORK

Approved: Project Director

Project Title

RELOCATE PROSTHETICS  
AND PODIATRY CLINICS

Location

Dayton, Ohio

Date

05.16.2016

Checked

PCW

Drawn

WJS

Project No.

VA Project No. 552-15-502  
JPA Project No. 14006.00

Building Number

340

Drawing Number

340MH101

Dwg. of

Office of  
Construction  
and Facilities  
Management



5/13/2016 11:59:40 AM

Revisions		Date
1	35% Schematic Design	03.05.2015
2	65% Design Development	04.28.2015
3	95% Owner Review	08.14.2015
4	100% Construction Documents	11.04.2015
5	Bid Set Drawings	01.15.2016


FULLY SPRINKLERED

GENERAL NOTES

A REFER TO SHEET E001 FOR LEGEND, SYMBOLS & INDEX OF DRAWINGS.


PLAN NOTES

- BUILDING 307 IS GOING TO BE COMPLETELY REMOVED - DISCONNECT BUILDING FROM ELECTRIC SERVICE AND ALL OTHER SOURCES OF POWER. ALL ELECTRICAL ITEMS ARE TO BE DEMOLISHED.
- LOCATION OF ELECTRICAL SWITCHBOARD DISCONNECT FROM TRANSFORMER AND REMOVE WIRING
- SHELTER CIRCUIT 4EGB 28.30.32. DISCONNECT SHELTER.

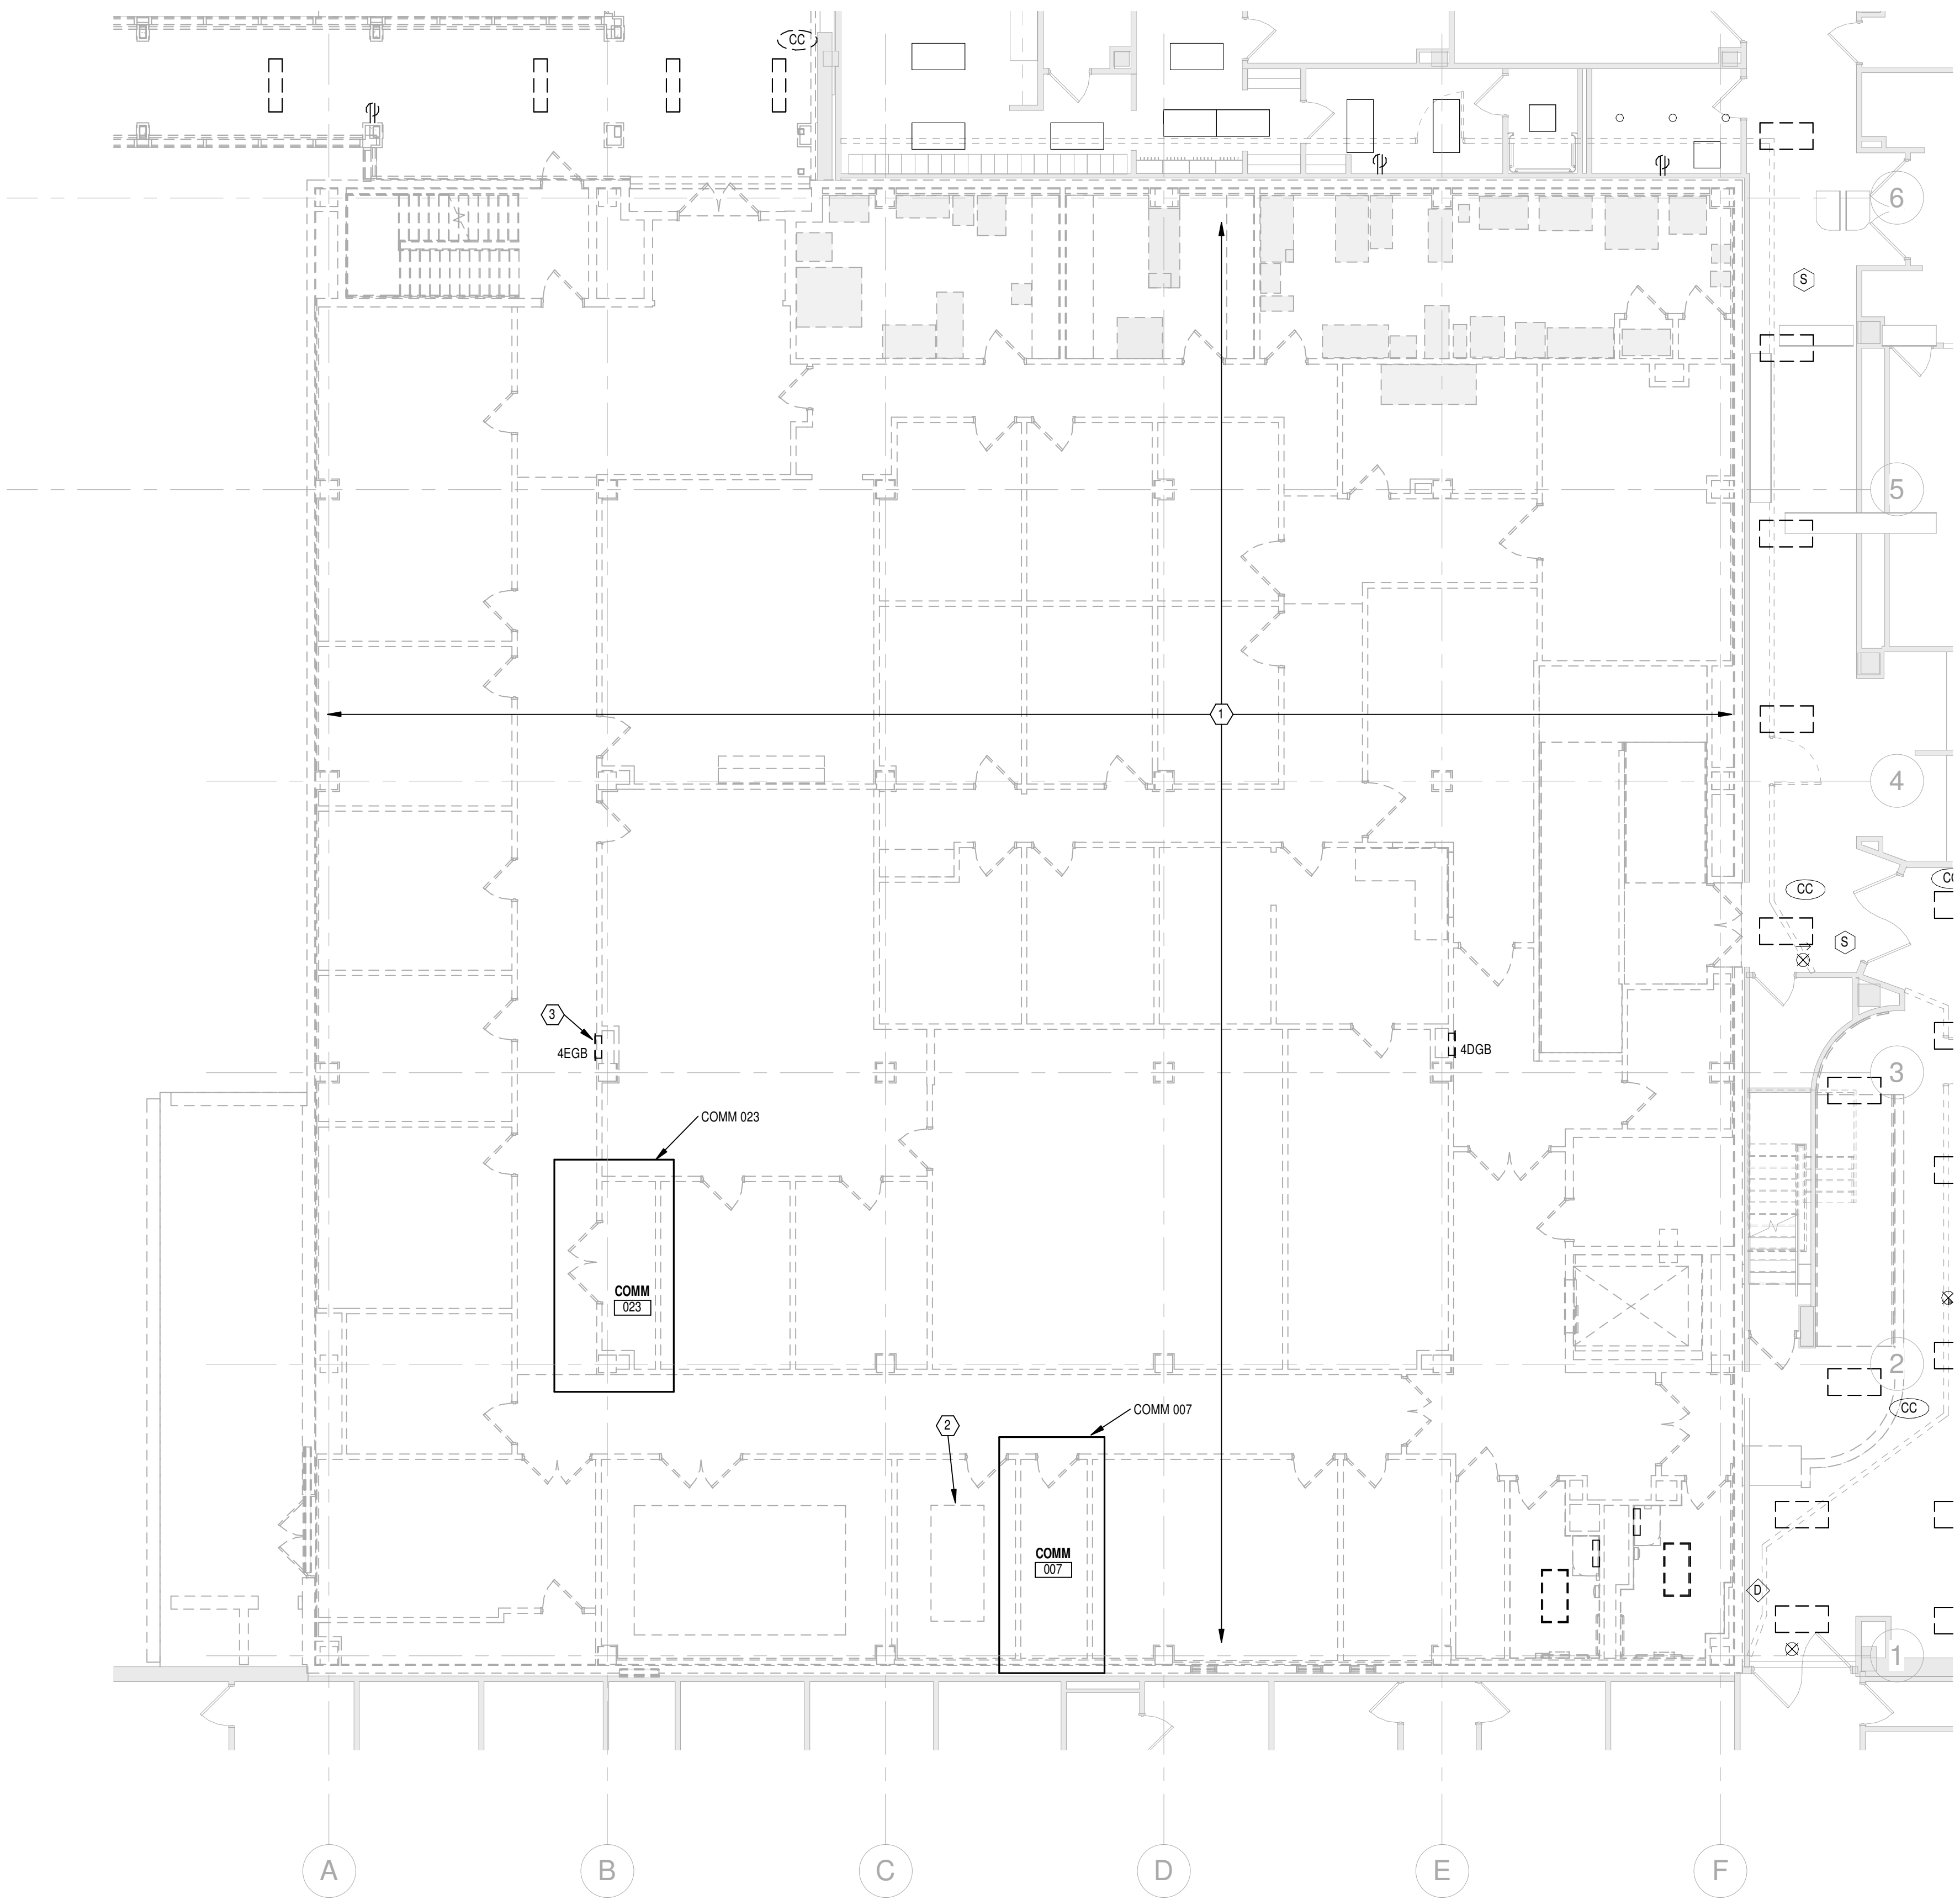

BLDG 307 FIRST FLOOR PLAN - REMOVALS

Scale: 1/8" = 1'-0"

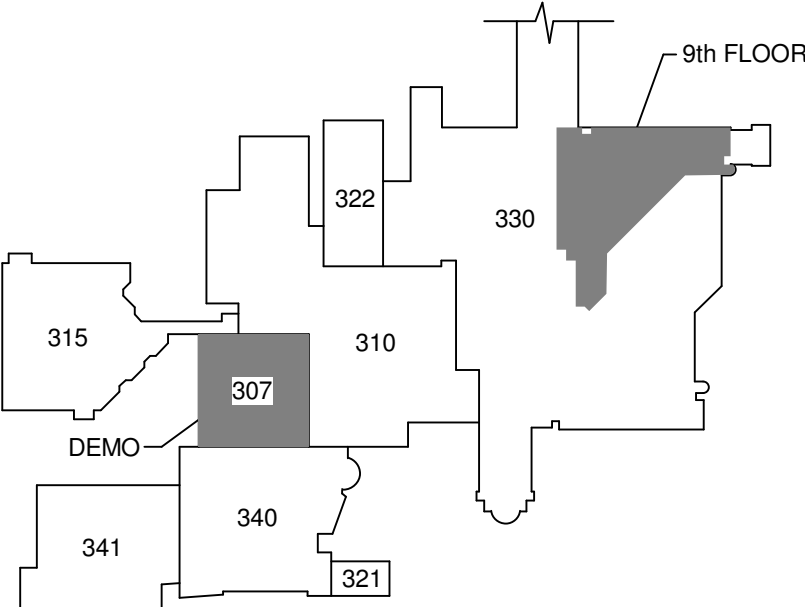

KEY PLAN


Scale: N.T.S.

5/13/2016 11:29:39 AM

Revisions		Date
1	35% Schematic Design	03.05.2015
2	65% Design Development	04.28.2015
3	95% Owner Review	08.14.2015
4	100% Construction Documents	11.04.2015
5	Bid Set Drawings	01.15.2016

CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

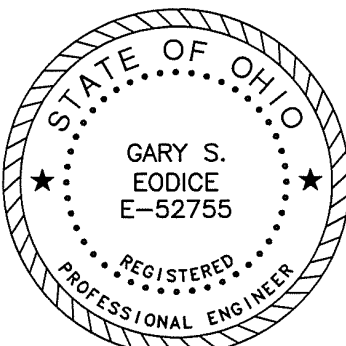

ARCHITECT/ENGINEERS:

JOHN POE ARCHITECTS



3131 NEWMARK DRIVE,  
SUITE 200  
MIAMISBURG, OHIO 45342  
937 461 3290 PHONE  
jpae@johnpoe.com

Drawing Title

FIRST FLOOR PLAN - REMOVALS

Approved: Project Director

Project Title

RELOCATE PROSTHETICS  
AND PODIATRY CLINICS

Location

Dayton, Ohio

Date

05.16.2016

Checked

MSG

Drawn

SC

Project No.  
VA Project No. 552-15-502  
JPA Project No. 14006.00

Building Number  
307

Drawing Number

307ED101

Dwg. of

Office of  
Construction  
and Facilities  
Management






FULLY SPRINKLERED


GENERAL NOTES  
A REFER TO SHEET E001 FOR LEGEND, SYMBOLS & INDEX OF DRAWINGS.

- PLAN NOTES
- BUILDING 307 IS GOING TO BE COMPLETELY REMOVED - DISCONNECT BUILDING FROM ELECTRIC SERVICE AND ALL OTHER SOURCES OF POWER. ALL ELECTRICAL ITEMS ARE TO BE DEMOLISHED.
  - TEMPORARY CONSTRUCTION WALL, TEMPORARILY SUPPORT LIGHT FIXTURES AND OTHER DEVICES IN CEILING TO ALLOW CEILING TO BE REMOVED FOR INSTALLATION OF TEMPORARY CONSTRUCTION WALL. RELOCATE LIGHTS INSIDE OF WALL. REPLACE IN CEILING AT END OF PROJECT.
  - NUMEROUS BRANCH CIRCUIT CONDUITS ARE SUPPORTED ON THE WALL ABOVE THE CEILING. RESUPPORT THESE CONDUITS FROM THE STRUCTURE ABOVE. PROVIDE ALL NECESSARY STRUT AND PIPE STRAPS.
  - NUMEROUS DATA CABLES RUN ALONG THIS WALL ABOVE THE CEILING. RESUPPORT THESE CABLE USING J-HOOKS, STRUT, ETC. FROM THE STRUCTURE ABOVE.
  - PROVIDE A \$1000.00 ALLOWANCE IN THE BASE BID TO RESUPPORT ELECTRICAL CABLES, CABLE TRAY, CONDUITS AND JUNCTION BOXES ATTACHED TO THE EXTERIOR WALL OF BUILDING 307.
  - RELOCATE FIRE ALARM PULL STATION TO NORTH SIDE OF THE MECHANICAL ROOM DOOR.
  - MOTOR CONTROL CENTER, SWITCHBOARD, PANEL, TRANSFORMER AND DISCONNECT TO REMAIN. RESUPPORT ANY CONDUITS, PANELS ETC CONNECTED TO THE BUILDING 307 WALL. TEMPORARY WALL TO BE BUILT BEHIND THIS EQUIPMENT.

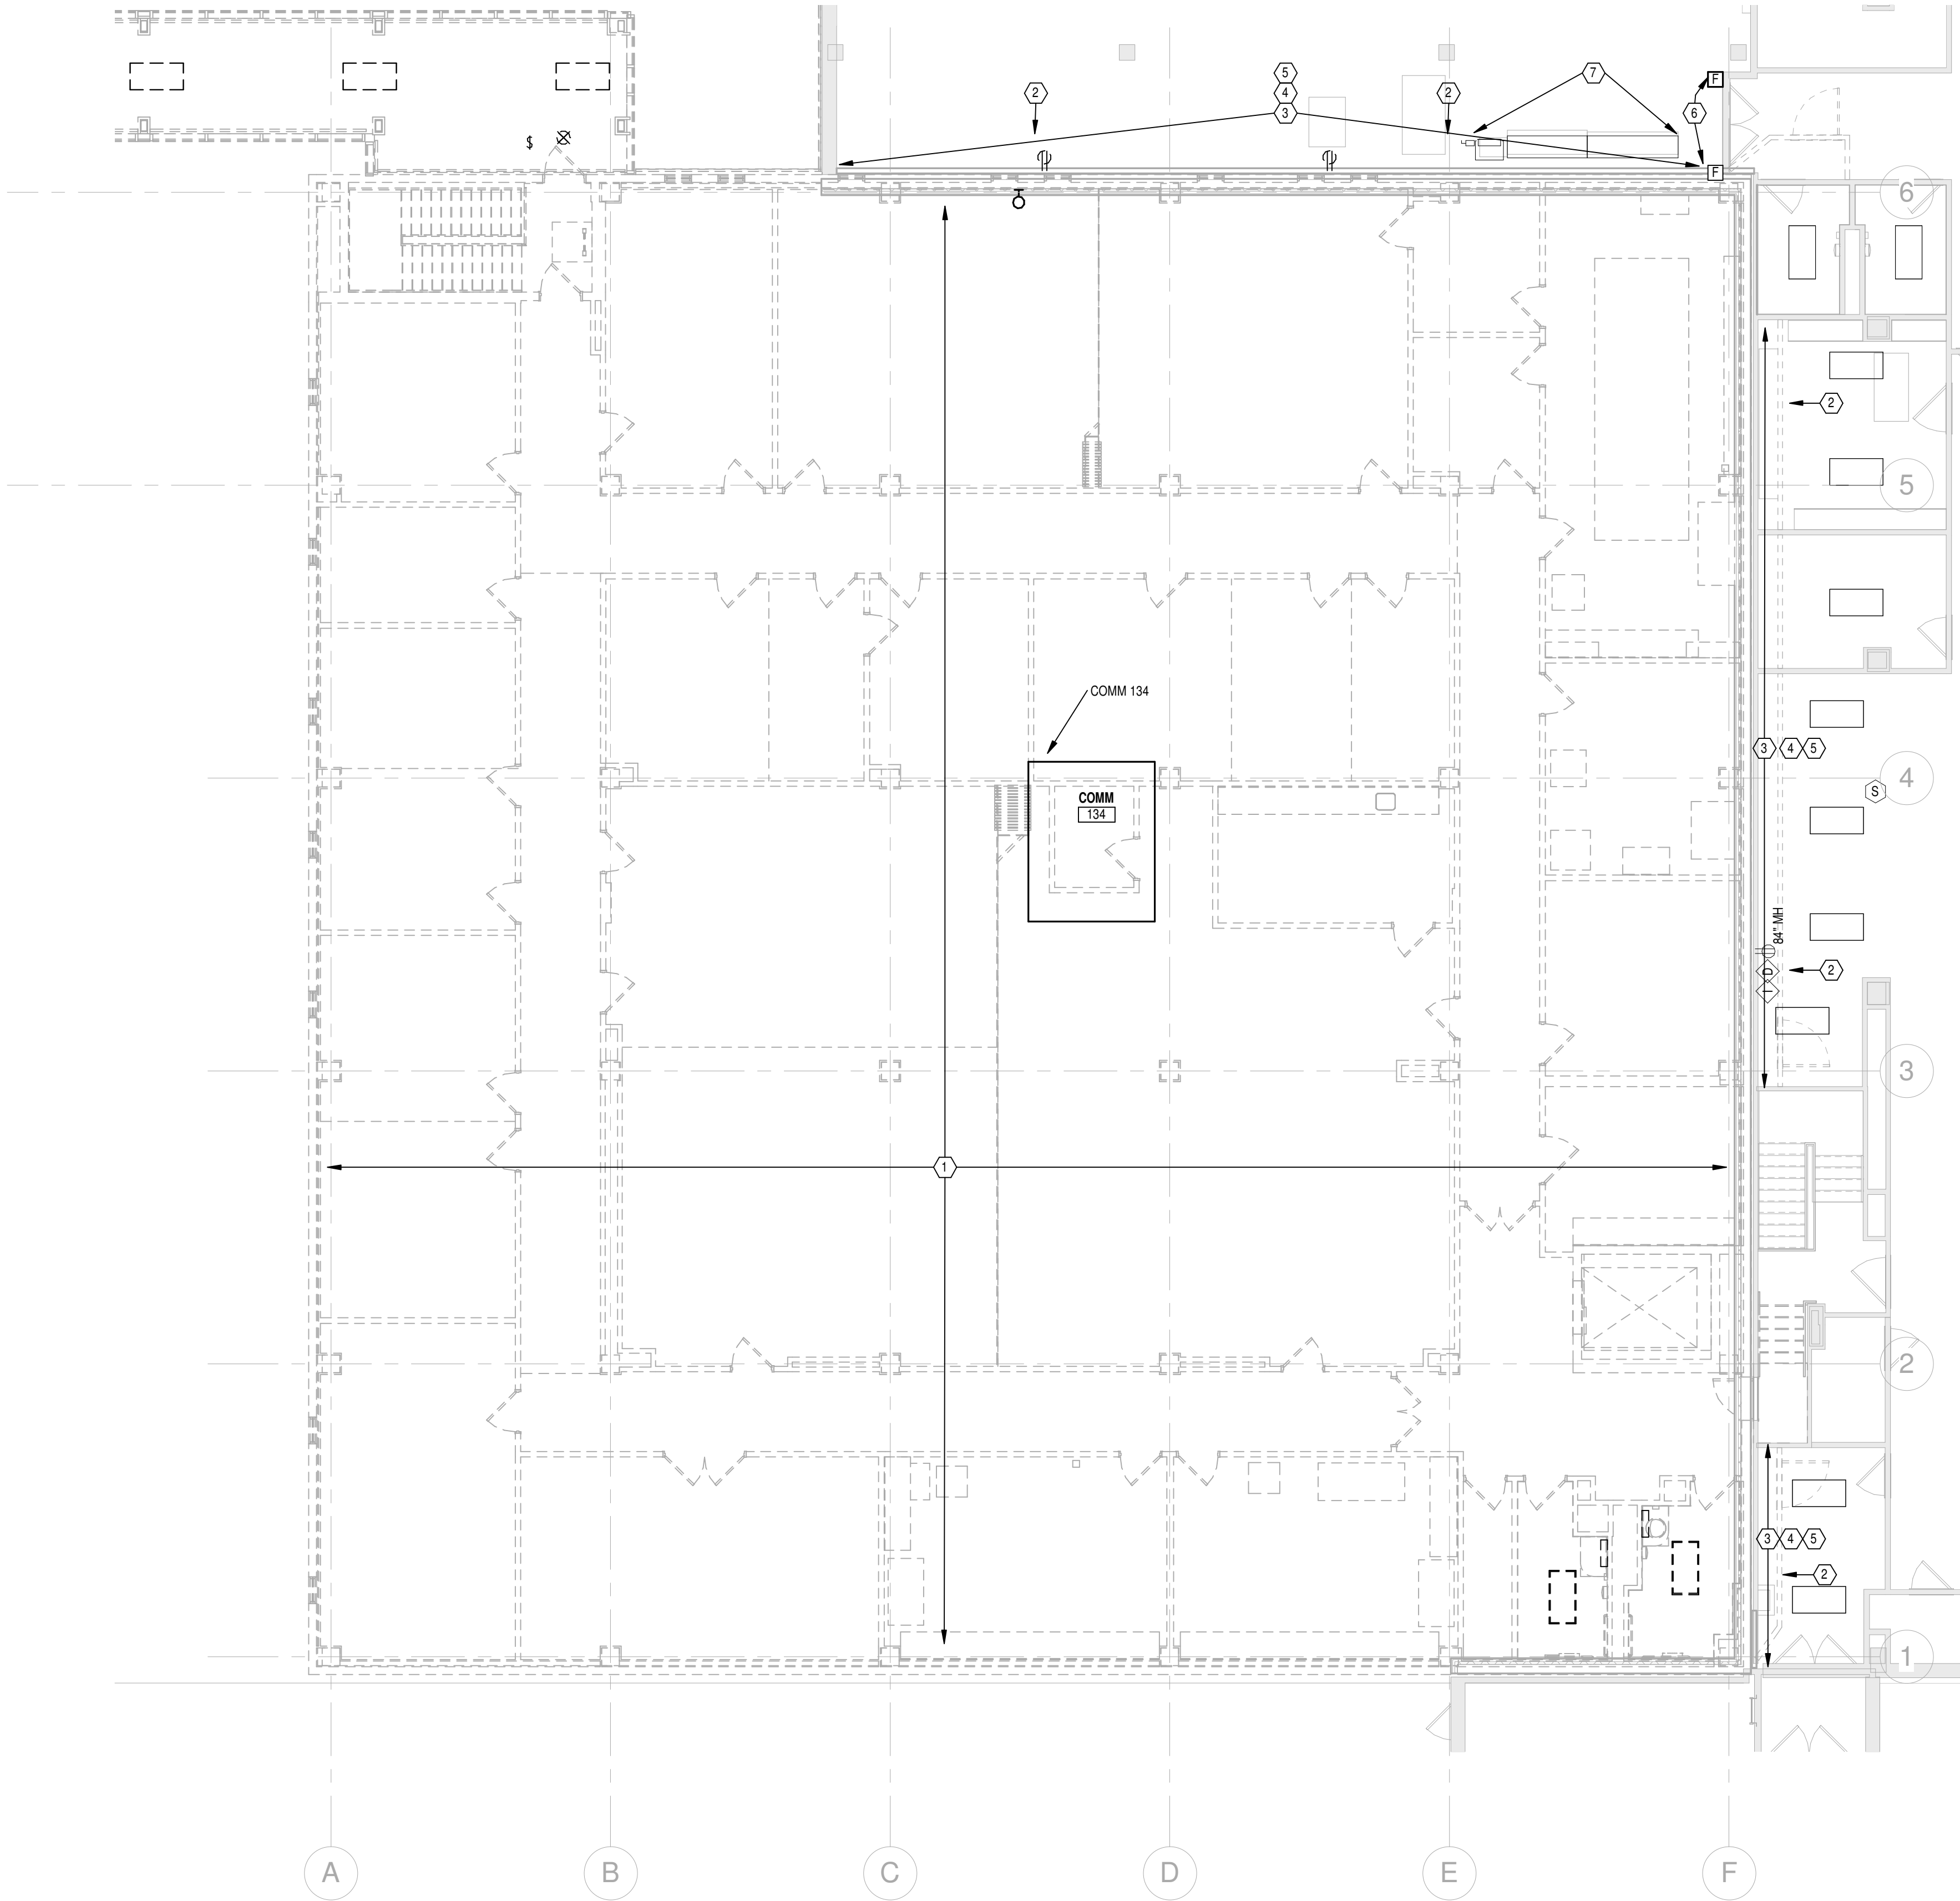

BLDG 307SECOND FLOOR PLAN - REMOVALS

Scale: 1/8" = 1'-0"

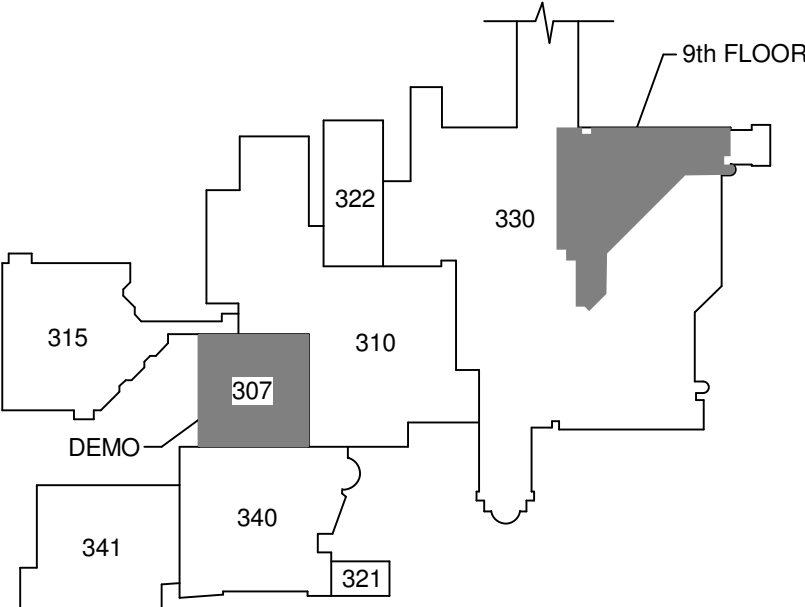


KEY PLAN

Scale: N.T.S.

Revisions		Date
1	35% Schematic Design	03.05.2015
2	65% Design Development	04.28.2015
3	95% Owner Review	08.14.2015
4	100% Construction Documents	11.04.2015
5	Bid Set Drawings	01.15.2016


CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

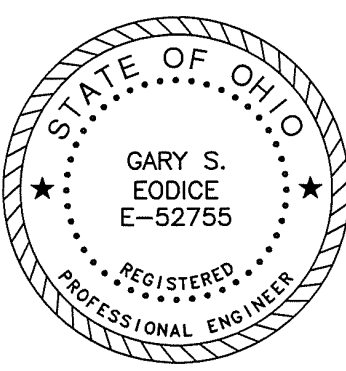

ARCHITECT/ENGINEERS:

JOHN POE ARCHITECTS

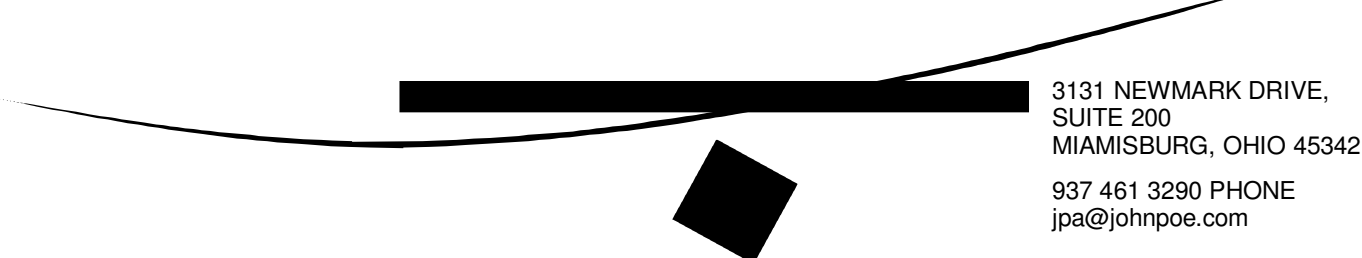

3131 NEWMARK DRIVE,  
SUITE 200  
MIAMISBURG, OHIO 45342  
937.461.3290 PHONE  
jpae@johnpoe.com

Drawing Title

SECOND FLOOR PLAN -  
REMOVALS

Approved: Project Director

Project Title

RELOCATE PROSTHETICS  
AND PODIATRY CLINICS

Location

Dayton, Ohio

Date

05.16.2016

Checked

MSG

Drawn

SC

Project No.

VA Project No. 552-15-502  
JPA Project No. 14006.00

Building Number  
307

Drawing Number

307ED102

Dwg. of

Office of  
Construction  
and Facilities  
Management




three inches = one foot  
one and one-half inches = one foot  
one inch = one foot  
three-quarters inch = one foot  
one-half inch = one foot  
three-eighths inch = one foot  
one-quarter inch = one foot  
one-eighth inch = one foot


FULLY SPRINKLERED

GENERAL NOTES  
A REFER TO SHEET E001 FOR LEGEND, SYMBOLS & INDEX OF DRAWINGS.

PLAN NOTES  
1. BUILDING 307 IS GOING TO BE COMPLETELY REMOVED - DISCONNECT BUILDING FROM ELECTRIC SERVICE AND ALL OTHER SOURCES OF POWER. ALL ELECTRICAL ITEMS ARE TO BE DEMOLISHED.

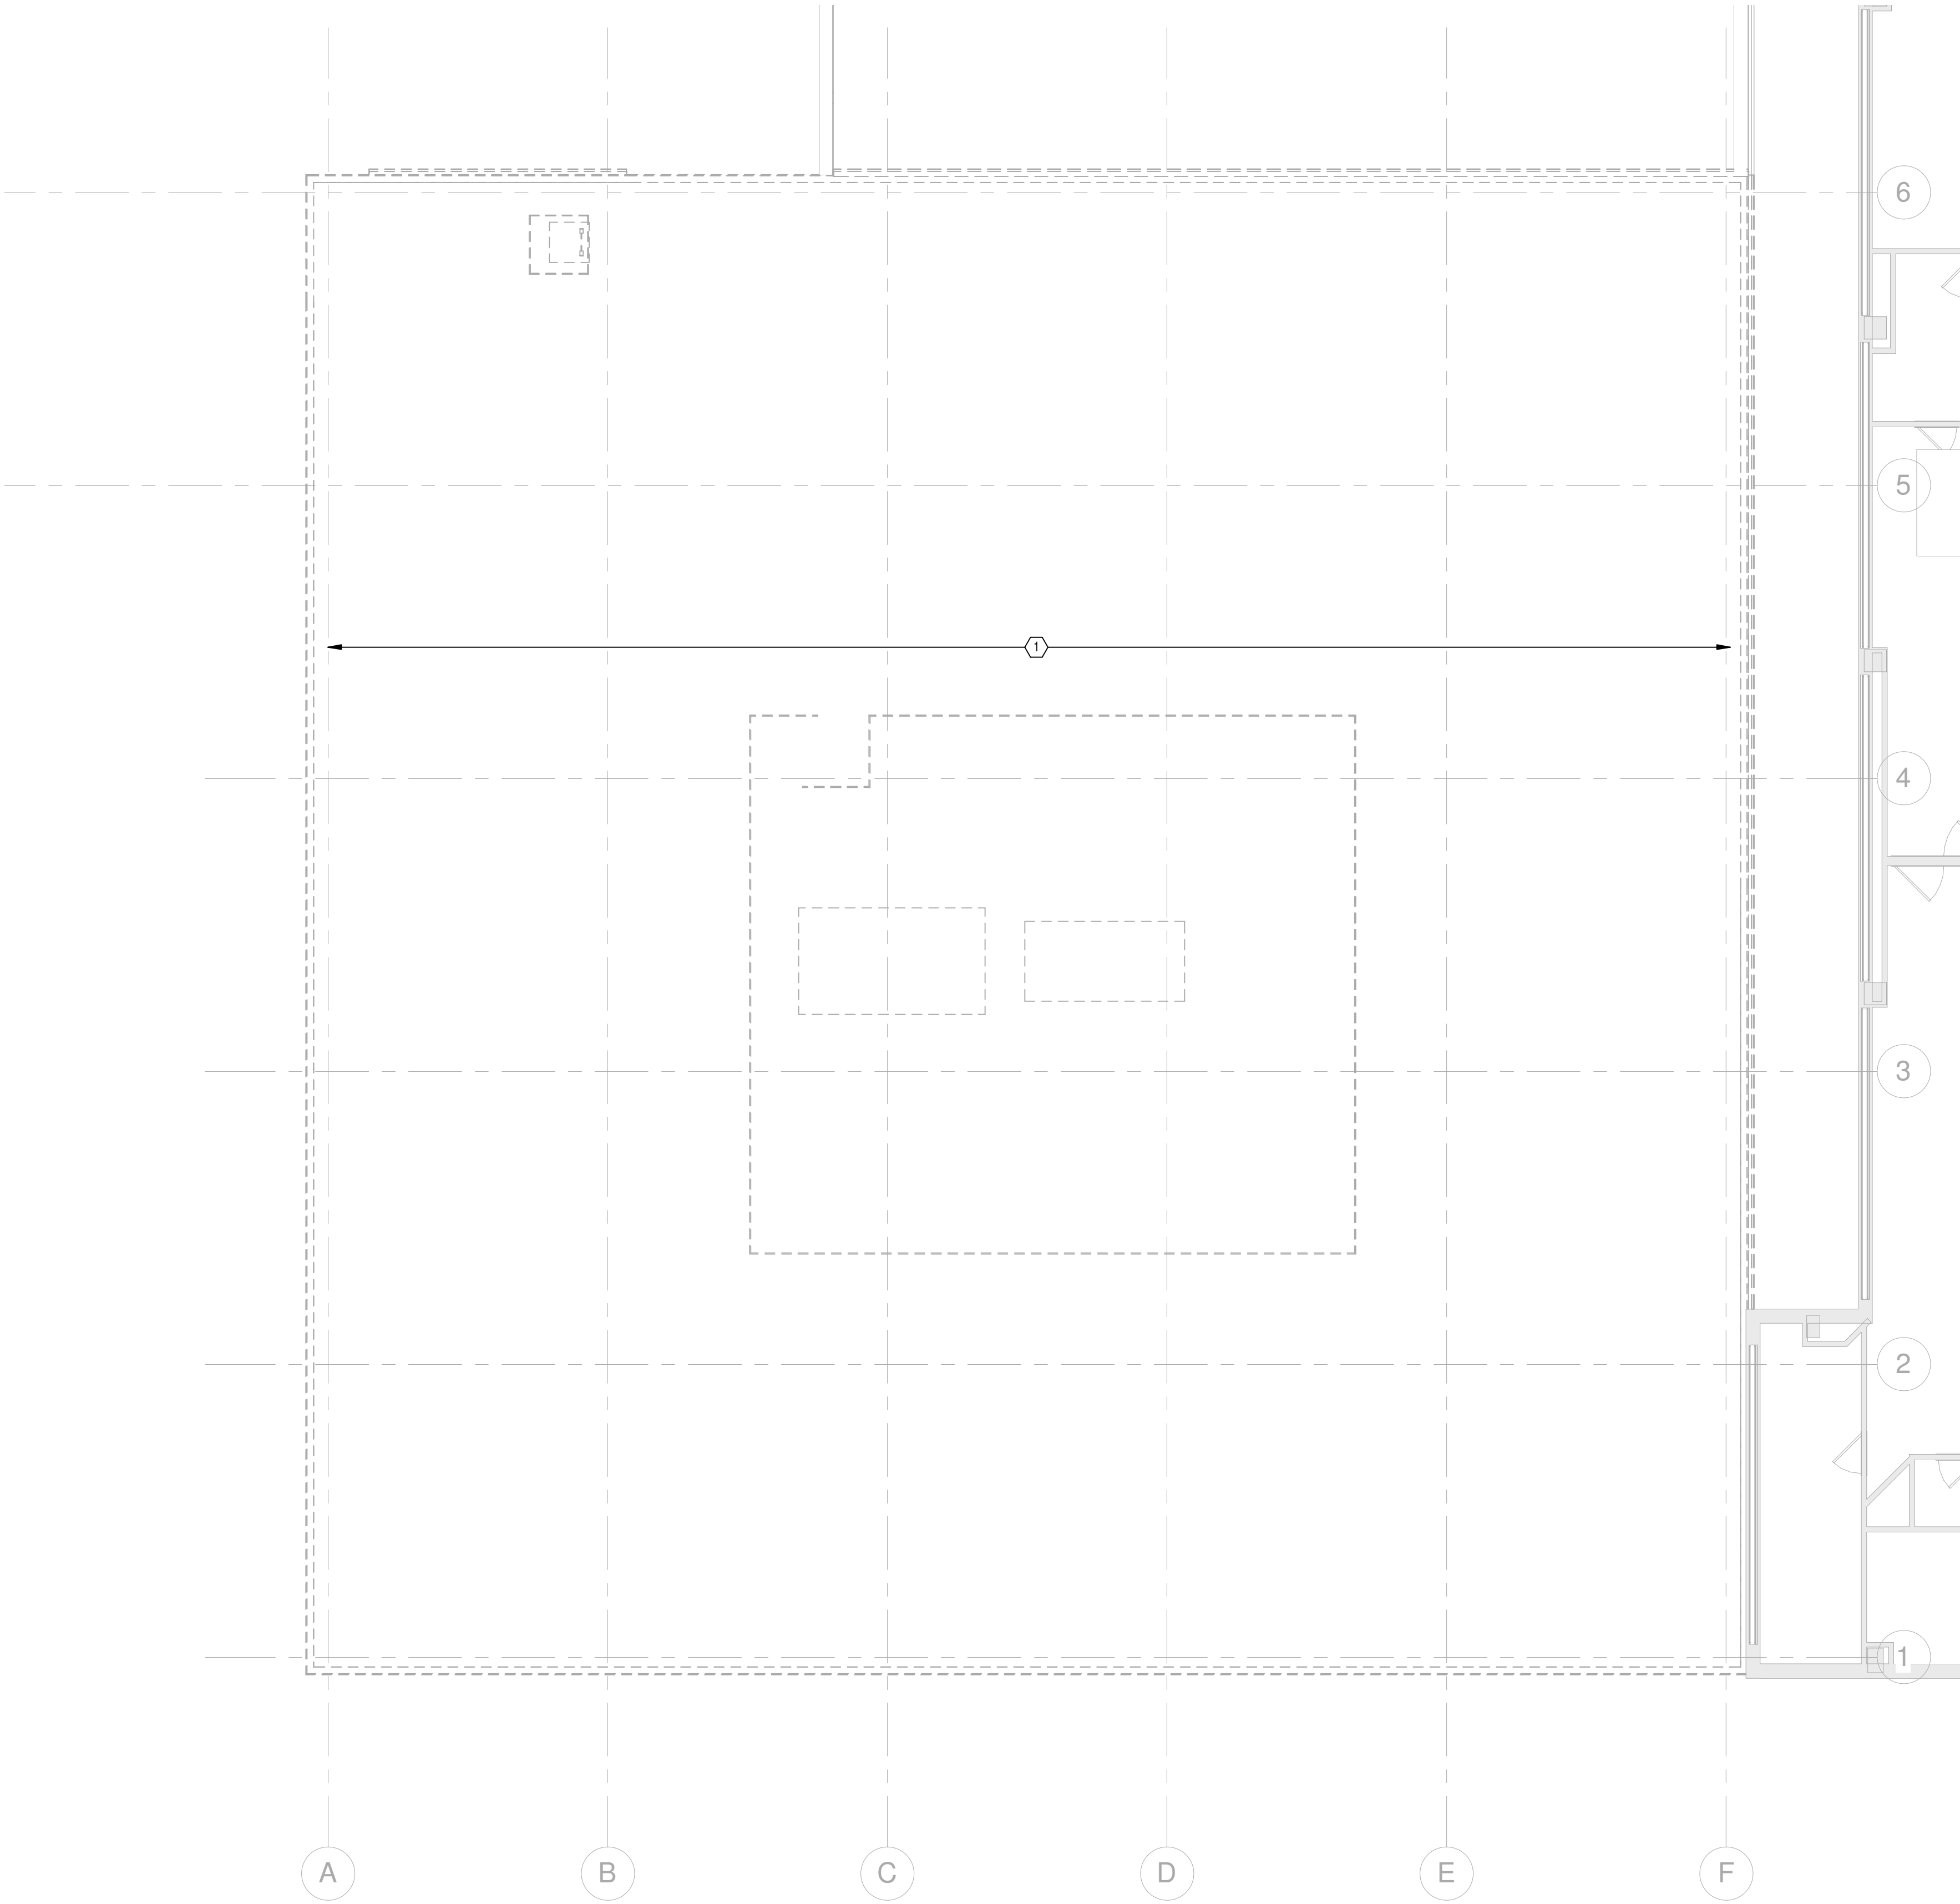

BLDG 307 ROOF PLAN - REMOVALS  
Scale: 1/8" = 1'-0"

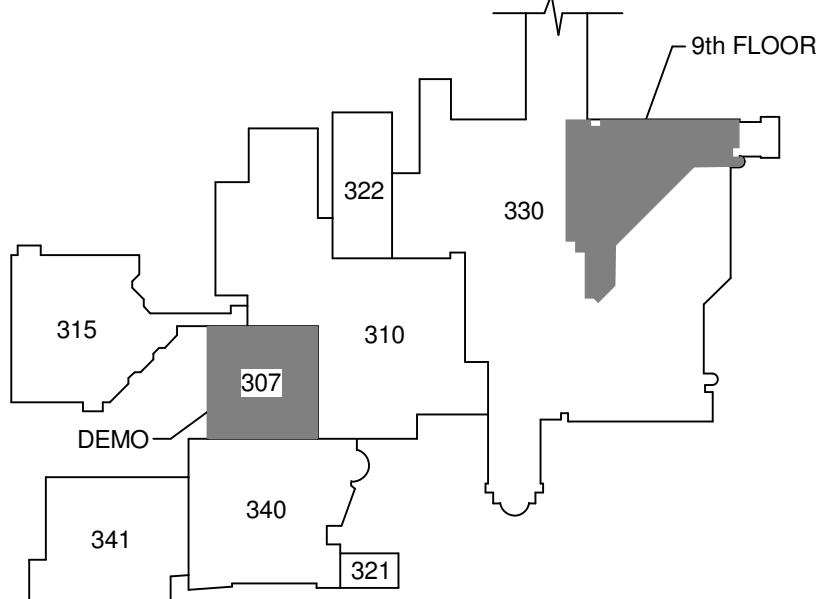

KEY PLAN  
Scale: N.T.S.

Revisions	CONSULTANTS:	ARCHITECT/ENGINEERS:	Drawing Title	Project Title	Project No.
1	<b>Heapy Engineering</b> MEP Design Technology Planning Commissioning Energy <i>Nationally Recognized Leader in Sustainability</i> 1400 W Dorothy Lane, Dayton, OH 45409-1310 Ph 937-224-0861 Fax 937-224-5777 www.heapy.com Heapy Project No.: 2014-04034 Firm License No.: Q1528	 GARY S. EODICE E-52755 REGISTERED PROFESSIONAL ENGINEER	ROOF PLAN - REMOVALS	RELOCATE PROSTHETICS AND PODIATRY CLINICS	VA Project No. 552-15-502
2					JPA Project No. 14006.00
3					Building Number 307
4					Drawing Number 307ED103
5					Dwg. of
Date	5/13/2016 11:29:50 AM	Approved: Project Director	Date 05.16.2016	Checked MSG	Drawn SC


Office of  
Construction  
and Facilities  
Management



FULLY SPRINKLERED

GENERAL NOTES  
A REFER TO SHEET E001 FOR LEGEND, SYMBOLS & INDEX OF DRAWINGS.

- PLAN NOTES
- TEMPORARY CONSTRUCTION WALL. TEMPORARILY SUPPORT LIGHT FIXTURES, SMOKE DETECTORS, ACCESS POINTS, CAMERAS, SMOKE DETECTORS AND OTHER DEVICES IN CEILING TO ALLOW CEILING TO BE REMOVED FOR INSTALLATION OF TEMPORARY CONSTRUCTION WALL. RELOCATE LIGHTS INSIDE OF WALL.
  - RESUPPORT 2" FEEDER CONDUIT FROM STRUCTURE ABOVE.
  - NUMEROUS BRANCH CIRCUIT CONDUITS ARE SUPPORTED ON THE WALL ABOVE THE CEILING. RESUPPORT THESE CONDUITS FROM THE STRUCTURE ABOVE. PROVIDE ALL NECESSARY STRUT AND PIPE STRIPS.
  - NUMEROUS DATA CABLES RUN ALONG THIS WALL ABOVE THE CEILING. RESUPPORT THESE CABLE USING J-HOOKS, STRUT, ETC. FROM THE STRUCTURE ABOVE. PROVIDE A \$1000.00 ALLOWANCE IN THE BASE BID TO RESUPPORT ELECTRICAL CABLES, CABLE TRAY, CONDUITS AND JUNCTION BOXES ATTACHED TO THE EXTERIOR WALL OF BUILDING 307.
  - RESUPPORT JUNCTION BOX FROM STRUCTURE ABOVE.

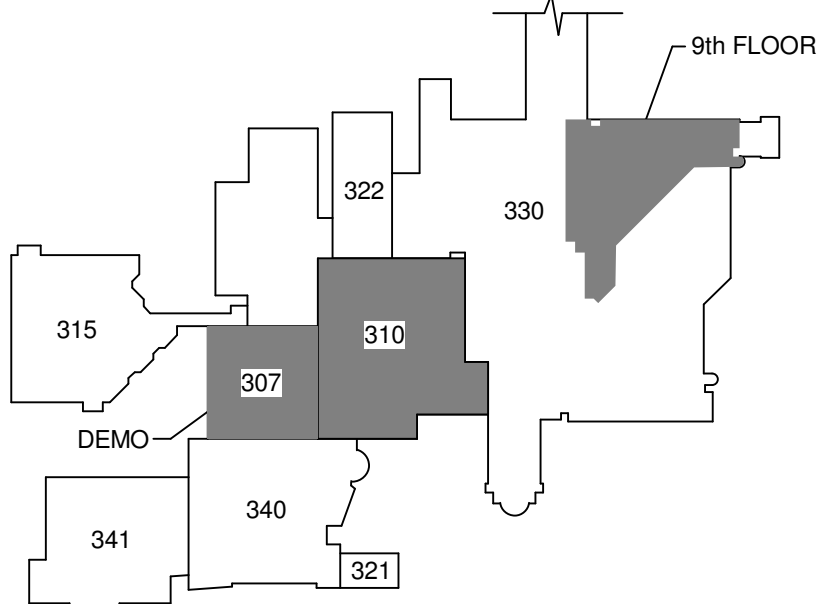


BLDG 310 FIRST FLOOR PLAN - REMOVALS

Scale: 1/8" = 1'-0"

Revisions	Date
1	35% Schematic Design 03.05.2015
2	65% Design Development 04.28.2015
3	95% Owner Review 08.14.2015
4	100% Construction Documents 11.04.2015
5	Bid Set Drawings 01.15.2016

CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

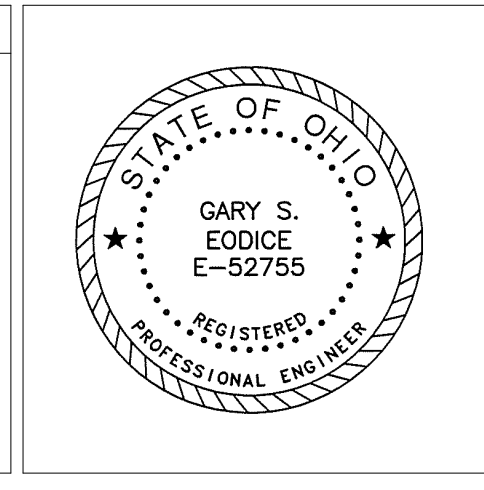

ARCHITECT/ENGINEERS:

**JOHN POE ARCHITECTS**  
3131 NEWMARK DRIVE, SUITE 200  
MIAMISBURG, OHIO 45342  
937 461 3290 PHONE  
jpa@johnpoe.com

Drawing Title

**FIRST FLOOR PLAN - REMOVALS**

Approved: Project Director

Project Title	RELOCATE PROSTHETICS AND PODIATRY CLINICS
Location	Dayton, Ohio
Date	05.16.2016
Checked	MSG
Drawn	SC
Project No.	VA Project No. 552-15-502
JPA Project No.	14006.00
Building Number	307
Drawing Number	310ED101
Dwg.	of
Office of Construction and Facilities Management Department of Veterans Affairs	


FULLY SPRINKLERED

GENERAL NOTES

A REFER TO SHEET E001 FOR LEGEND, SYMBOLS & INDEX OF DRAWINGS.


PLAN NOTES

- CIRCUIT SECURITY LIGHTING TO SPARE CIRCUIT IN BUILDING 310.
- WIPE NEW LIGHT FIXTURES IN SAME LOCATION AND CIRCUITS UPON REMOVAL OF TEMPORARY WALL.



BLDG 310 FIRST FLOOR PLAN - LIGHTING

Scale: 1/8" = 1'-0"

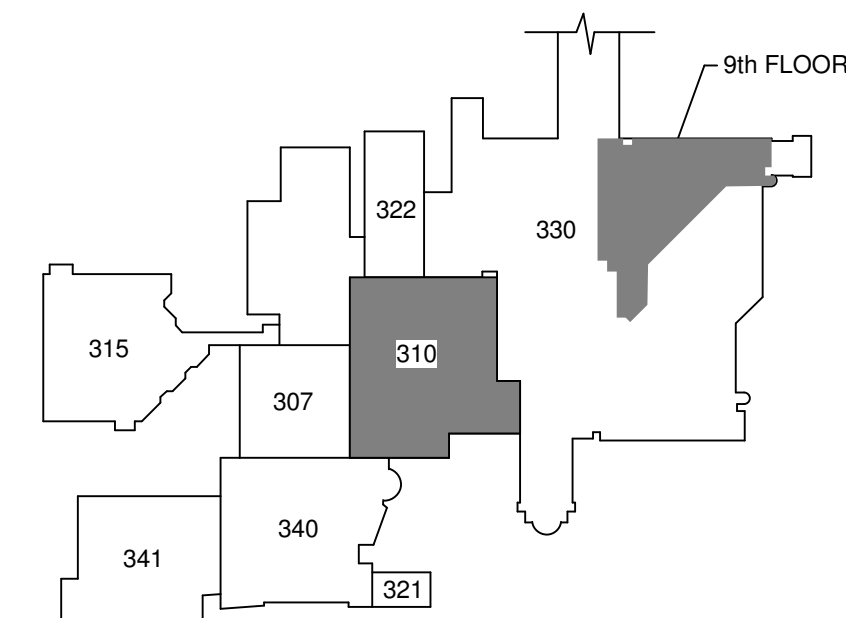


KEY PLAN

Scale: N.T.S.

Revisions	Date
1	35% Schematic Design 03.05.2015
2	65% Design Development 04.28.2015
3	95% Owner Review 08.14.2015
4	100% Construction Documents 11.04.2015
5	Bid Set Drawings 01.15.2016


CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

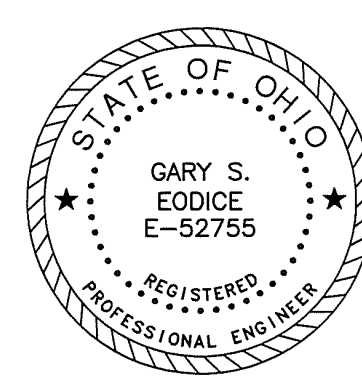

ARCHITECT/ENGINEERS:

JOHN POE ARCHITECTS

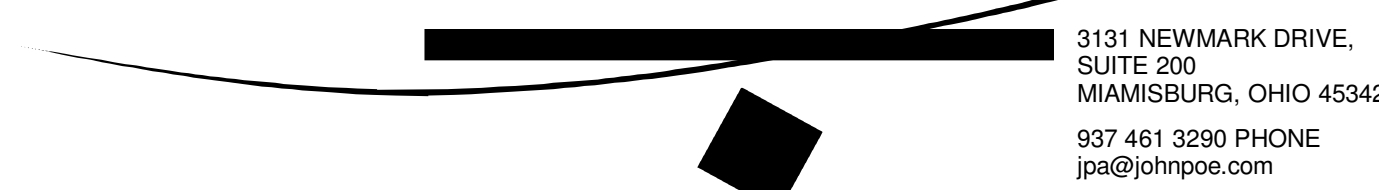

3131 NEWMARK DRIVE,  
SUITE 200  
MIAMISBURG, OHIO 45342  
937 461 3290 PHONE  
jpae@johnpoe.com

Drawing Title

FIRST FLOOR PLAN - LIGHTING

Approved: Project Director

Project Title

RELOCATE PROSTHETICS  
AND PODIATRY CLINICS

Location

Dayton, Ohio

Date

05.16.2016

Checked

MSG

Drawn

SC

Project No.  
VA Project No. 552-15-502  
JPA Project No. 14006.00

Building Number

307

Drawing Number

310EL101

Dwg. of

Office of  
Construction  
and Facilities  
Management



Department of  
Veterans Affairs




FULLY SPRINKLERED

GENERAL NOTES

A REFER TO SHEET E001 FOR LEGEND, SYMBOLS & INDEX OF DRAWINGS.


PLAN NOTES

- EXISTING SIGNALS CLOSET. PROVIDE NEW FIBER/COPPER BACKBONE CABLING AND TERMINATION EQUIPMENT AS DETAILED ON SHEET E701.
- RELOCATE DATA OUTLET TO OPPOSITE WALL.
- PROVIDE NEW CABLING ABOVE EXISTING CEILING. PROVIDE NEW CABLE MANAGEMENT J-HOOKS. COORDINATE ROUTING WITH EXISTING UTILITIES ABOVE CEILING.
- PROVIDE TWO (2) UL LISTED FIRE RATED ASSEMBLIES. RE-ENTERABLE CABLE PATHWAYS (2" CONDUIT EQUIVALENT AREA) THROUGH WALL ABOVE CEILING.
- EXISTING SIGNALS CLOSET. PROVIDE NEW CATV BACKBONE CABLING AND TERMINATION EQUIPMENT AS DETAILED ON SHEET E701.
- REFER TO SHEET 340ET101 FOR CONTINUATION.
- PROVIDE UL LISTED FIRE RATED ASSEMBLY. RE-ENTERABLE CABLE PATHWAYS (4" CONDUIT EQUIVALENT AREA) THROUGH WALL ABOVE CEILING.
- DELETE EXISTING DATA OUTLET.
- REINSTALL SPEAKERS, ACCESS POINTS, SMOKE ALARMS, CAMERAS ETC. IN CORRIDOR CEILING UPON REMOVAL OF TEMPORARY WALL.

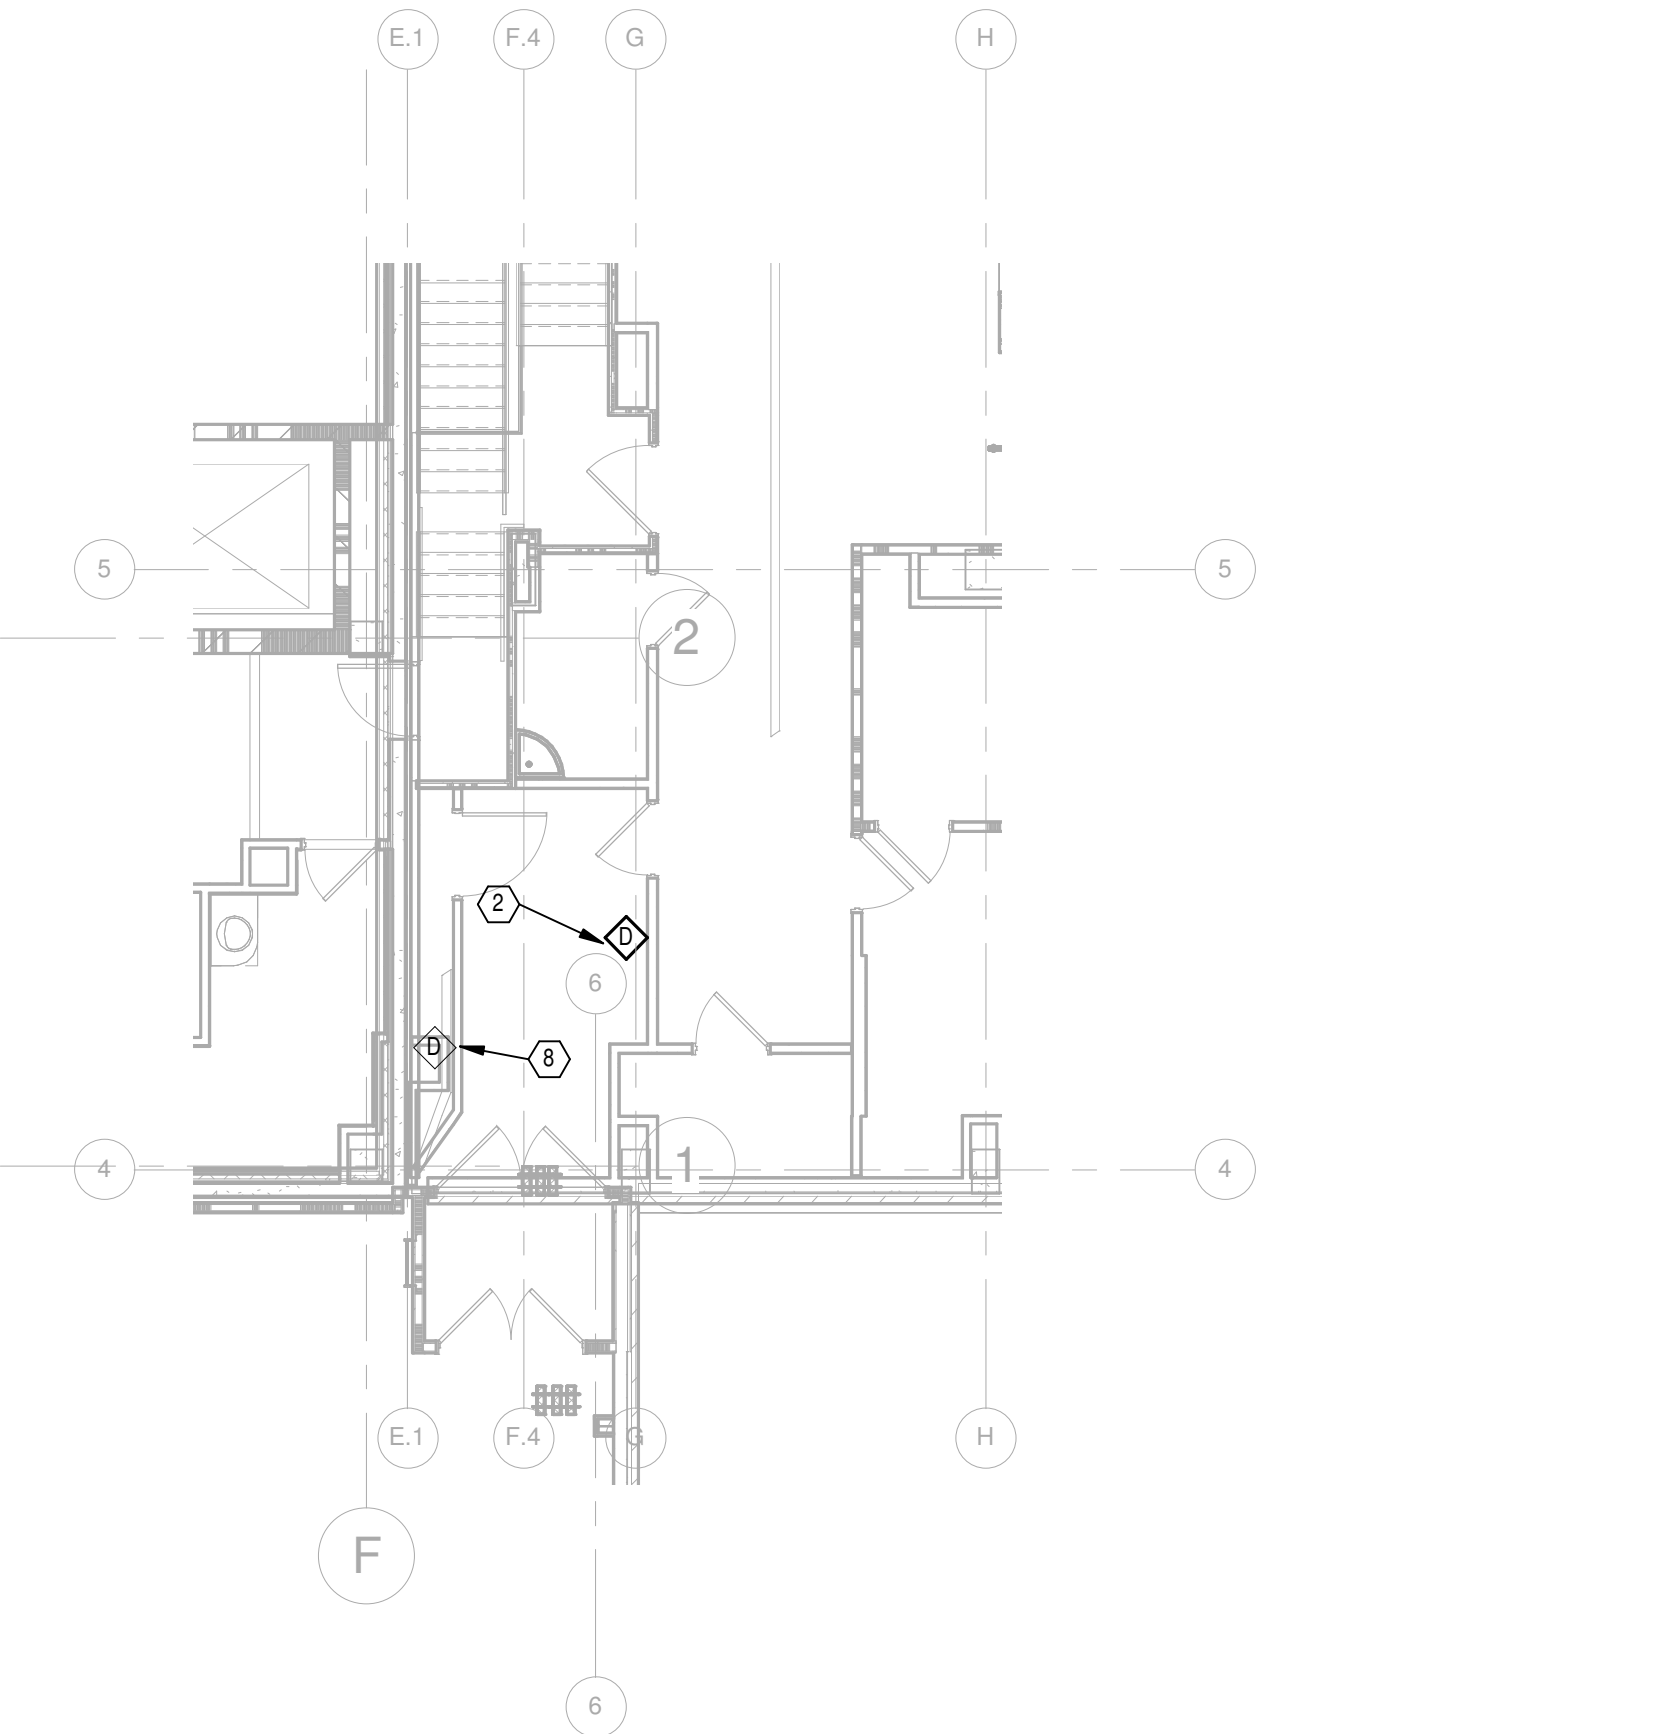


BLDG 310-02-TECHNOLOGY - PARTIAL

Scale: 1/8" = 1'-0"

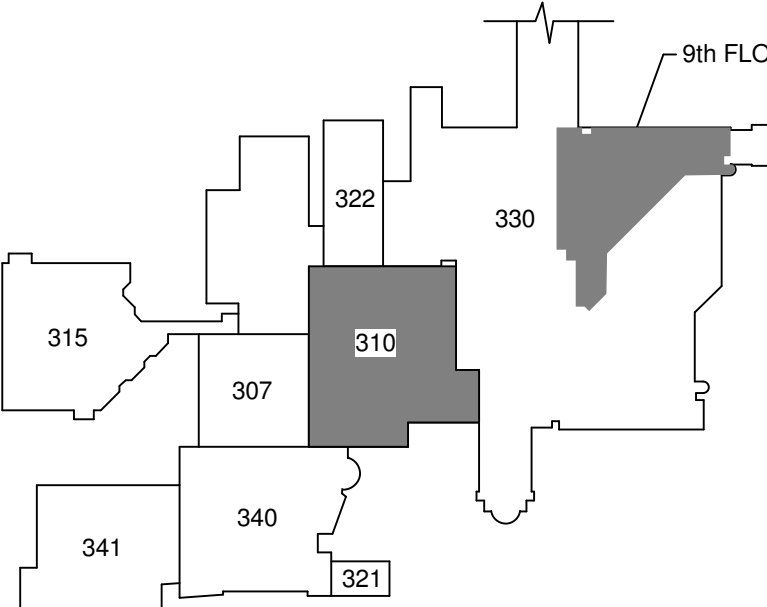

KEY PLAN

Scale: N.T.S.

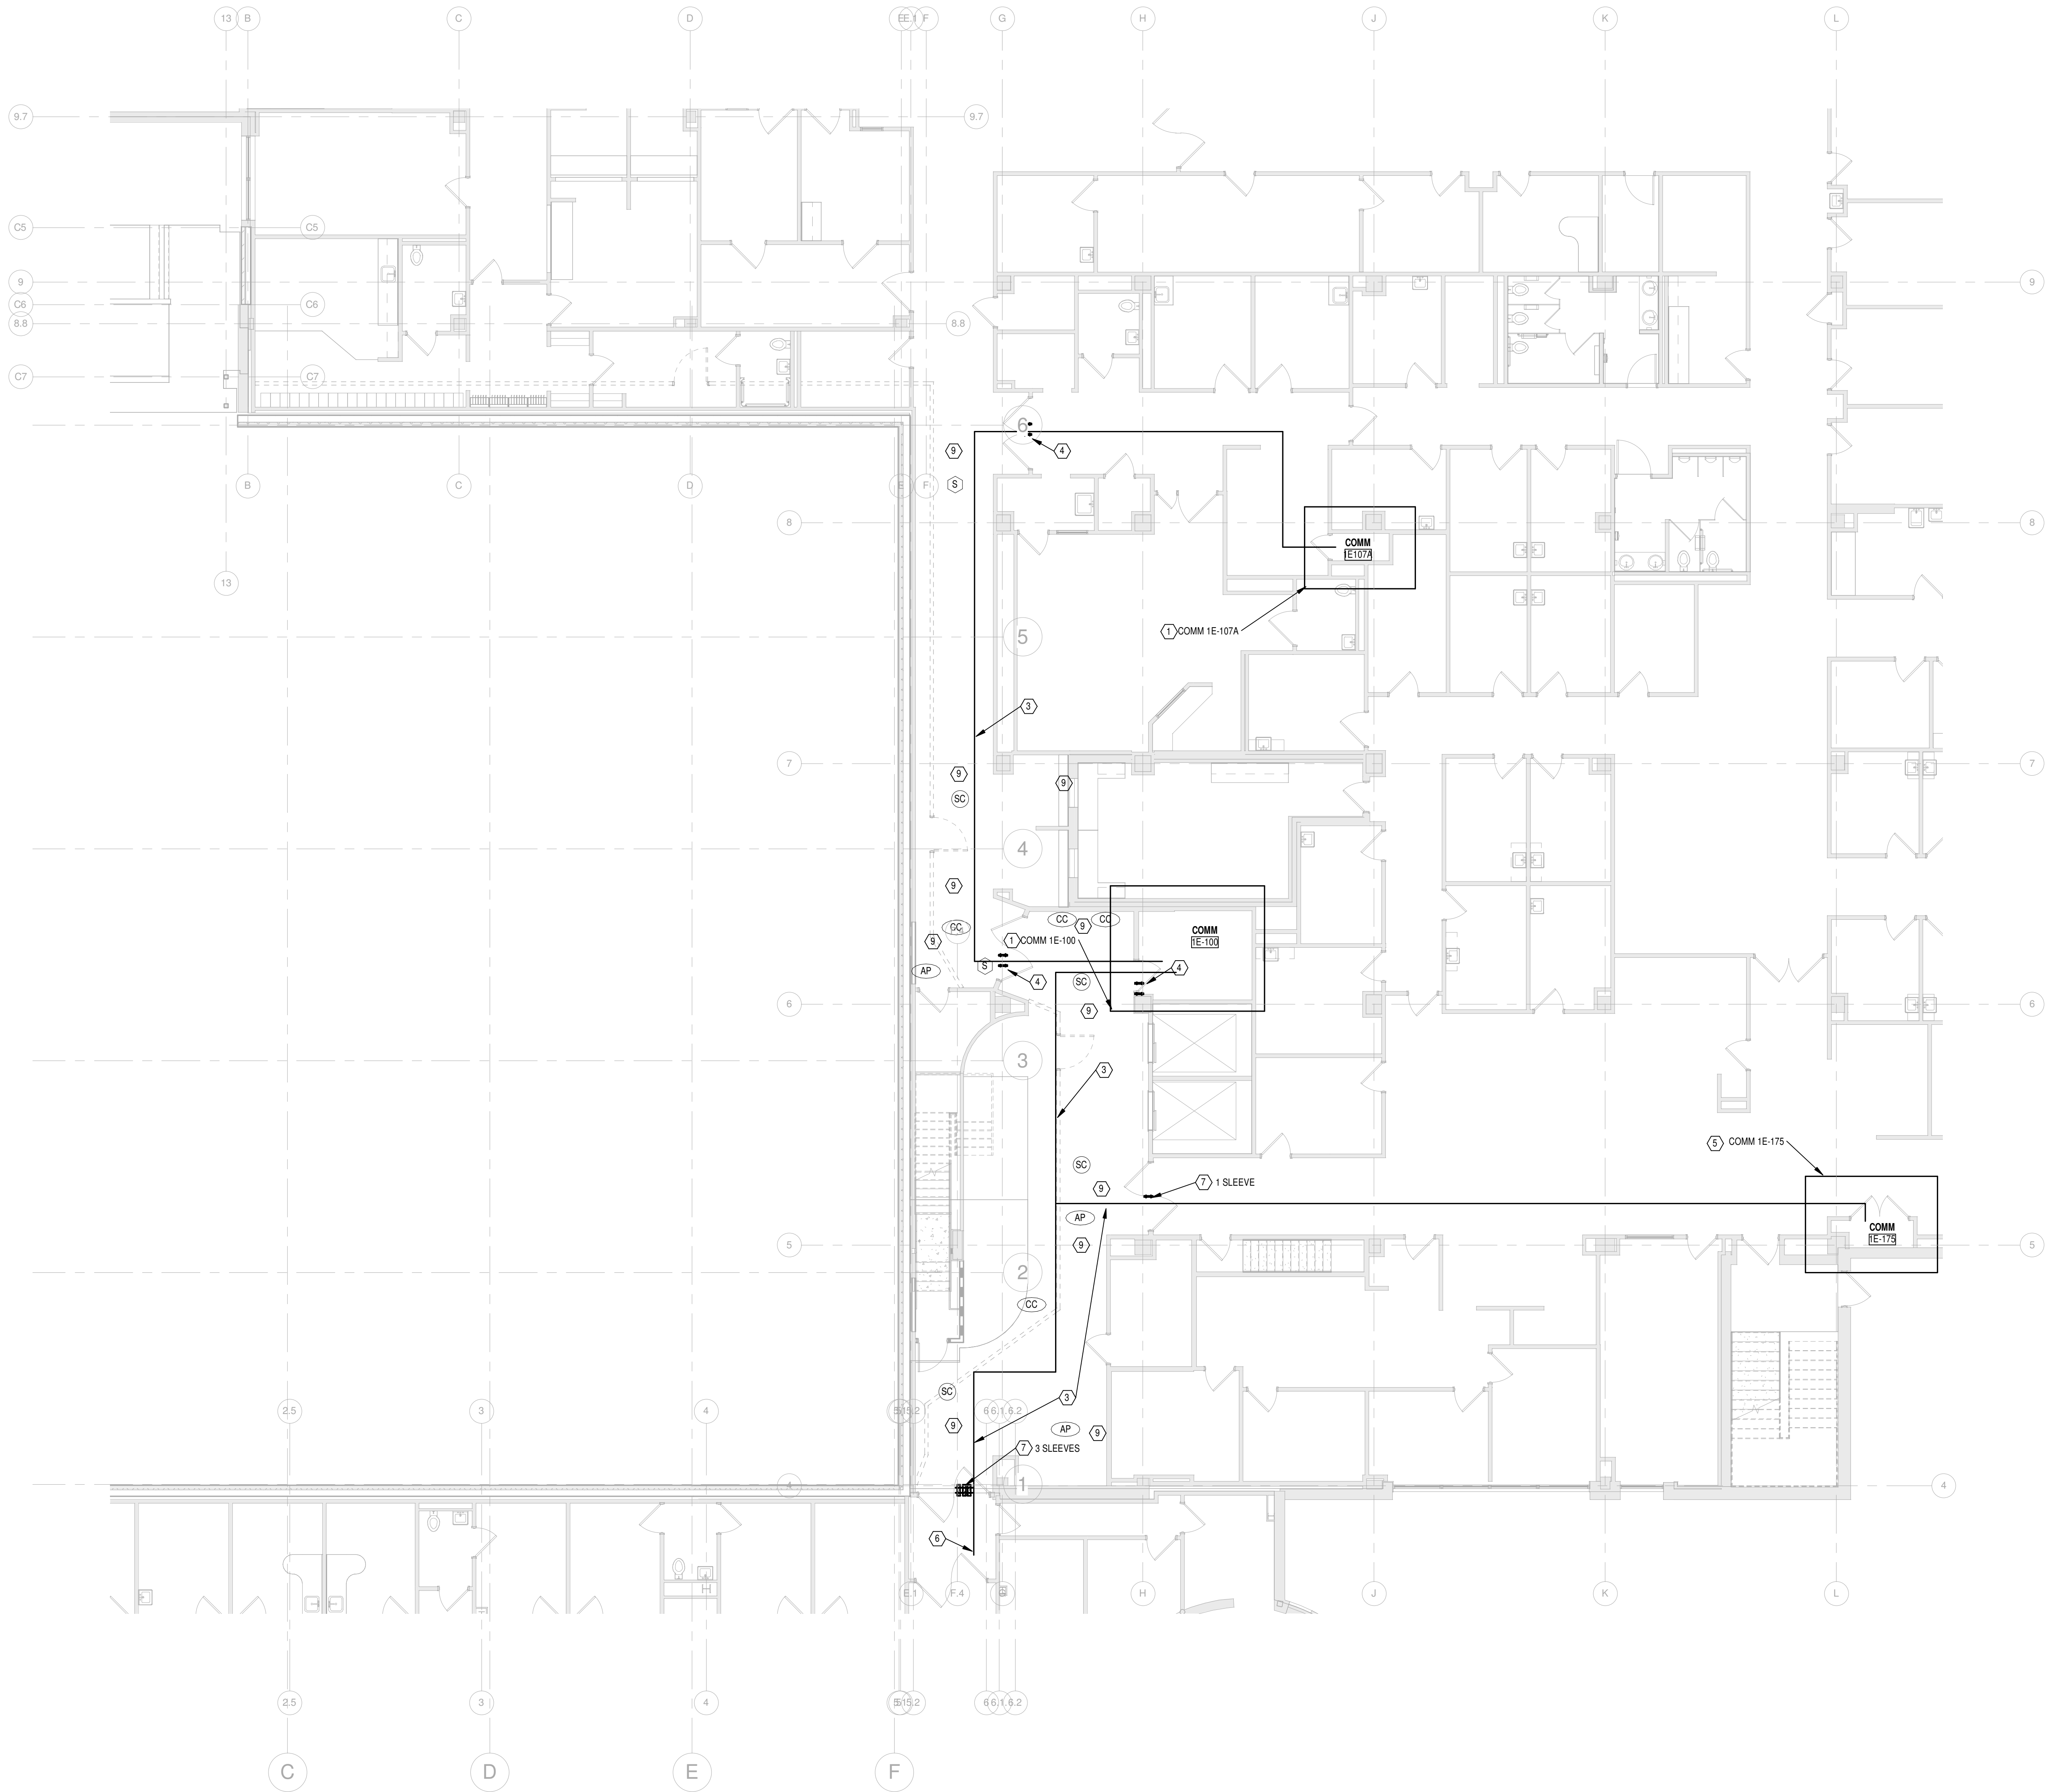

BLDG 310 FIRST FLOOR PLAN - TECHNOLOGY


Scale: 1/8" = 1'-0"

5/13/2016 11:30:19 AM

Revisions	Date
1	35% Schematic Design 03.05.2015
2	65% Design Development 04.28.2015
3	95% Owner Review 08.14.2015
4	100% Construction Documents 11.04.2015
5	Bid Set Drawings 01.15.2016

CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

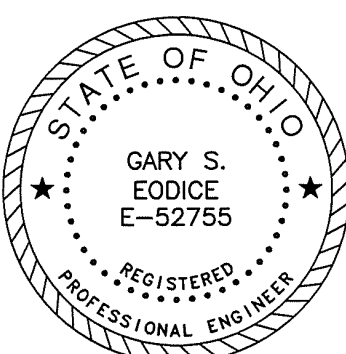

ARCHITECT/ENGINEERS:

JOHN POE ARCHITECTS



3131 NEWMARK DRIVE,  
SUITE 200  
MIAMISBURG, OHIO 45342  
937 461 3290 PHONE  
jpa@johnpoe.com

Drawing Title

FIRST FLOOR PLAN -  
TECHNOLOGY

Approved: Project Director

Project Title

RELOCATE PROSTHETICS  
AND PODIATRY CLINICS

Location

Dayton, Ohio

Date

05.16.2016

Checked

MSG

Drawn

SC

Project No.

552-15-502

JPA Project No.

14006.00

Building Number

307

Drawing Number

310ET101

Dwg. of

Office of  
Construction  
and Facilities  
Management




FULLY SPRINKLERED

GENERAL NOTES

A REFER TO SHEET E001 FOR LEGEND, SYMBOLS & INDEX OF DRAWINGS.


PLAN NOTES

- EXISTING SIGNALS CLOSET. PROVIDE NEW CATV BACKBONE CABLING AND TERMINATION EQUIPMENT AS DETAILED ON SHEET E701.
- REFER TO SHEET 310ET101 FOR CONTINUATION.
- PROVIDE NEW CABLING ABOVE EXISTING CEILING. PROVIDE NEW CABLE MANAGEMENT J-HOOKS. COORDINATE ROUTING WITH EXISTING UTILITIES ABOVE CEILING.
- PROVIDE UL LISTED FIRE RATED ASSEMBLY, RE-ENTERABLE CABLE PATHWAYS (4" CONDUIT EQUIVALENT AREA) THROUGH WALL ABOVE CEILING.
- REFER TO SHEET 341ET101 FOR CONTINUATION.

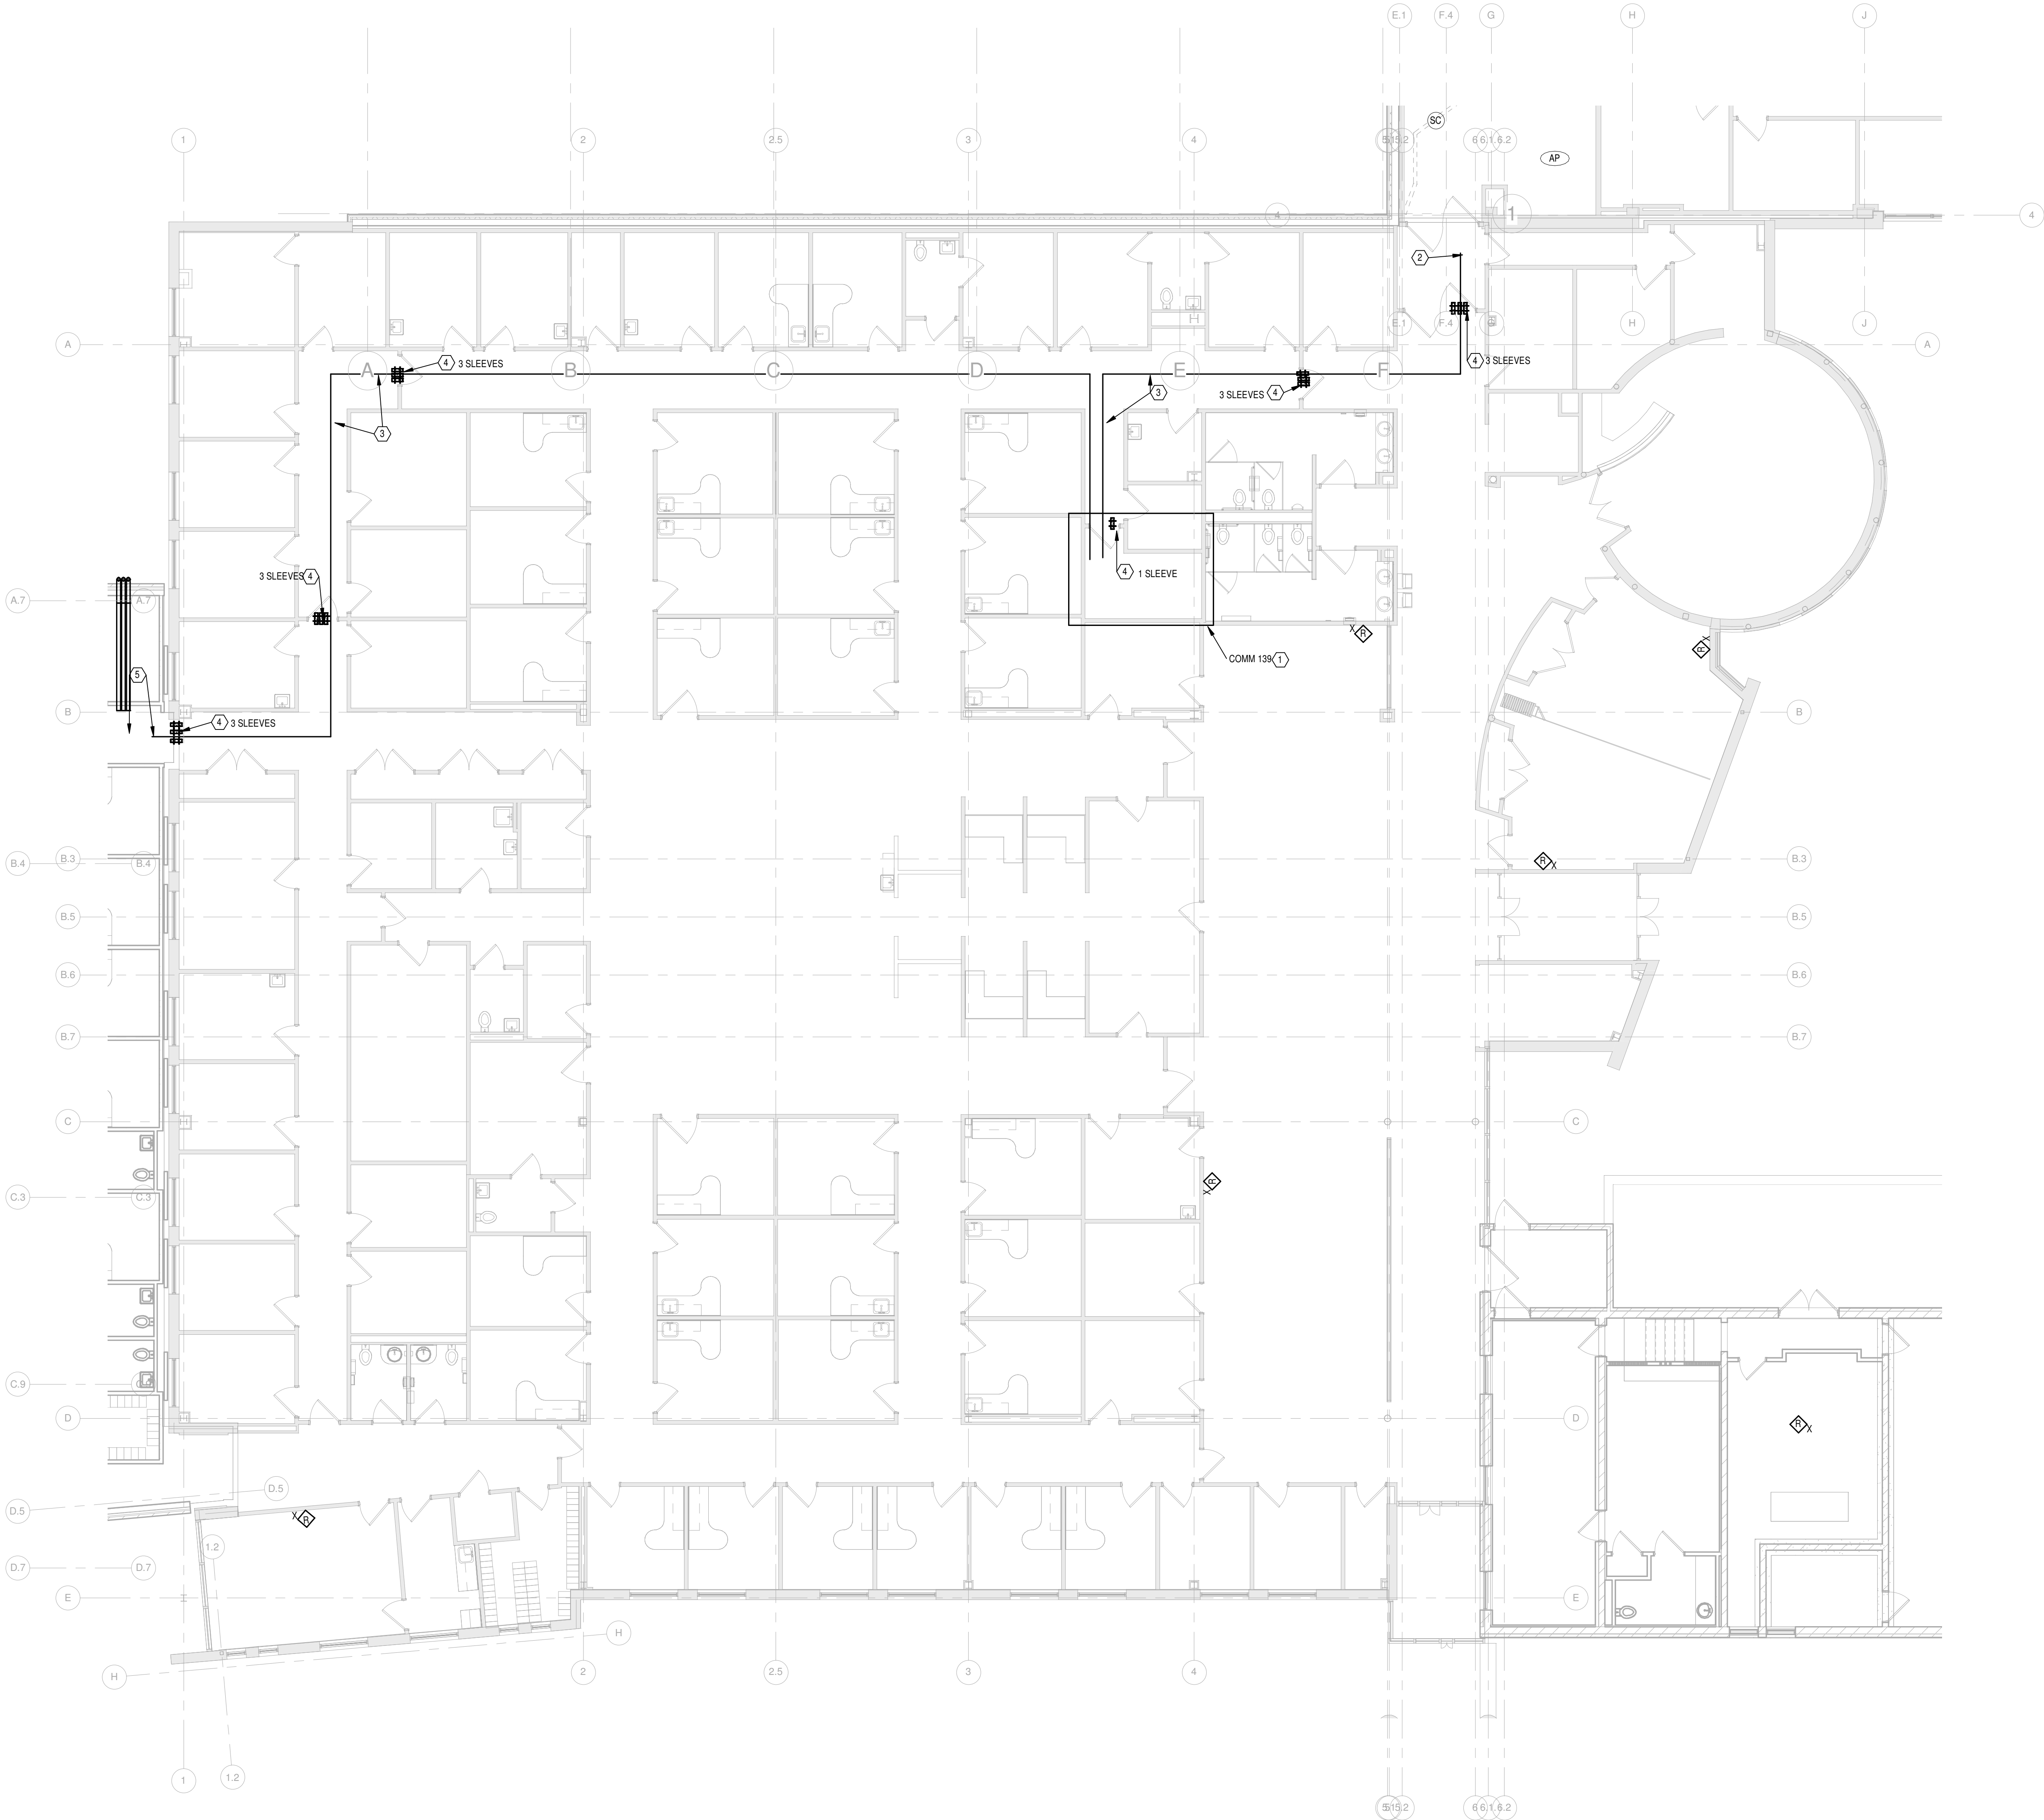

BLDG 340 FIRST FLOOR PLAN - TECHNOLOGY

Scale: 1/8" = 1'-0"

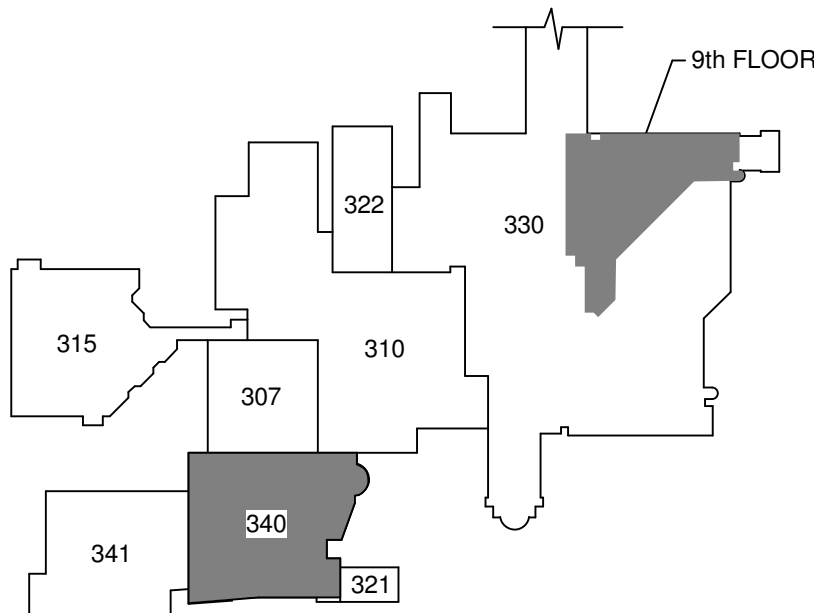

KEY PLAN


Scale: N.T.S.

5/13/2016 11:32:03 AM

Revisions		Date
1	35% Schematic Design	03.05.2015
2	65% Design Development	04.28.2015
3	95% Owner Review	08.14.2015
4	100% Construction Documents	11.04.2015
5	Bid Set Drawings	01.15.2016

CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

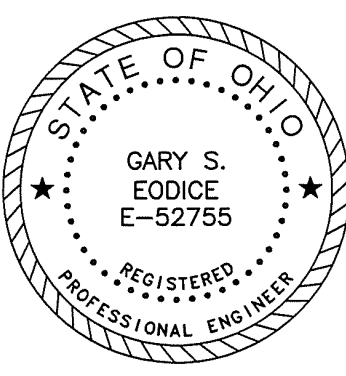

ARCHITECT/ENGINEERS:

JOHN POE ARCHITECTS

3131 NEWMARK DRIVE,  
SUITE 200  
MIAMISBURG, OHIO 45342  
937 461 3290 PHONE  
jpa@johnpoe.com

Drawing Title

FIRST FLOOR PLAN -  
TECHNOLOGY

Approved: Project Director

Project Title

RELOCATE PROSTHETICS  
AND PODIATRY CLINICS

Location

Dayton, Ohio

Date

05.16.2016

Checked

MSG

Drawn

SC

Project No.  
VA Project No. 552-15-502  
JPA Project No. 14006.00

Building Number  
307

Drawing Number

340ET101

Dwg. of

Office of  
Construction  
and Facilities  
Management




FULLY SPRINKLERED

GENERAL NOTES


A REFER TO SHEET E001 FOR LEGEND, SYMBOLS & INDEX OF DRAWINGS.

PLAN NOTES

- EXISTING SIGNALS CLOSET. PROVIDE NEW CATV BACKBONE CABLING AND TERMINATION EQUIPMENT AS DETAILED ON SHEET E701. REFER TO SHEET 340ET101 FOR CONTINUATION.
- PROVIDE NEW CABLING ABOVE EXISTING CEILING. PROVIDE NEW CABLE MANAGEMENT J-HOOKS. COORDINATE ROUTING WITH EXISTING UTILITIES ABOVE CEILING.
- PROVIDE ONE (1) UL LISTED FIRE RATED ASSEMBLY, RE-ENTERABLE CABLE PATHWAYS (2" CONDUIT EQUIVALENT AREA) THROUGH WALL ABOVE CEILING.
- PROVIDE 3/4" CONDUITS FROM BUILDING EXTERIOR, EXTENDED HIGH ACROSS ELECTRICAL ROOM AND OUT INTO ABOVE CORRIDOR CEILING FOR TELECOM CABLING.
- REFER TO PLAN E5002 FOR CONTINUATION.

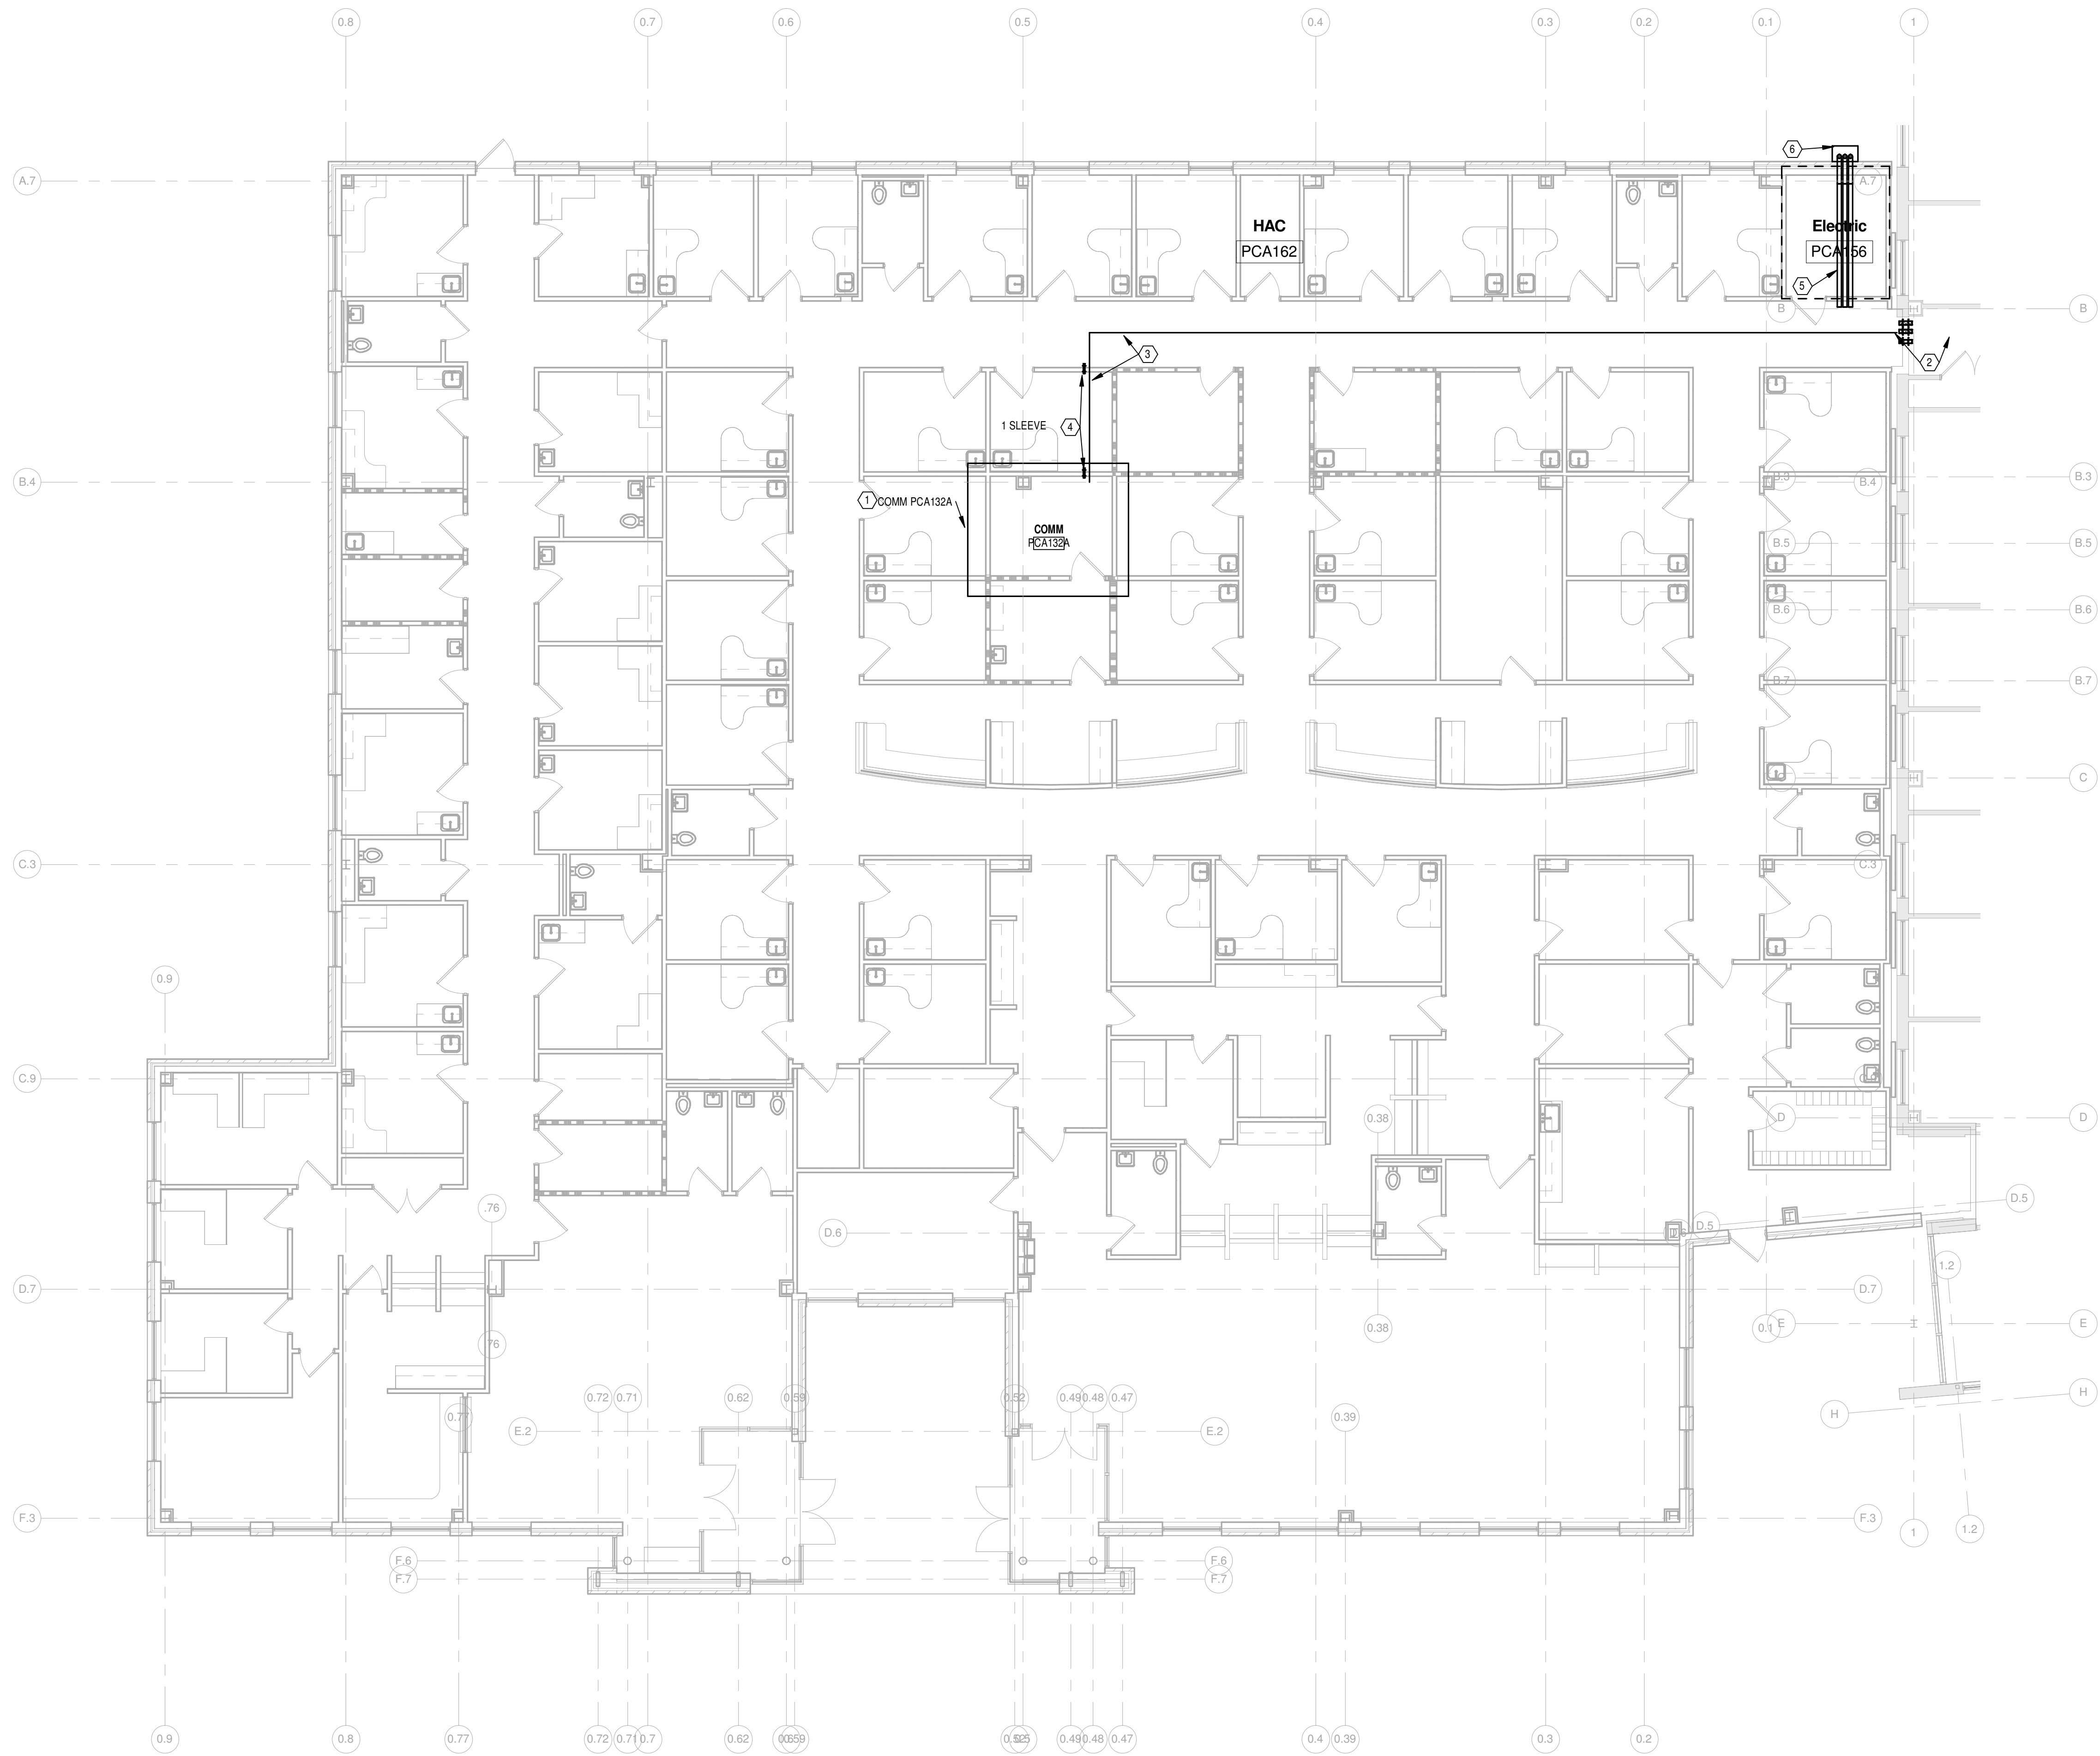

BLDG 341 FIRST FLOOR PLAN - TECHNOLOGY  
Scale: 1/8" = 1'-0"

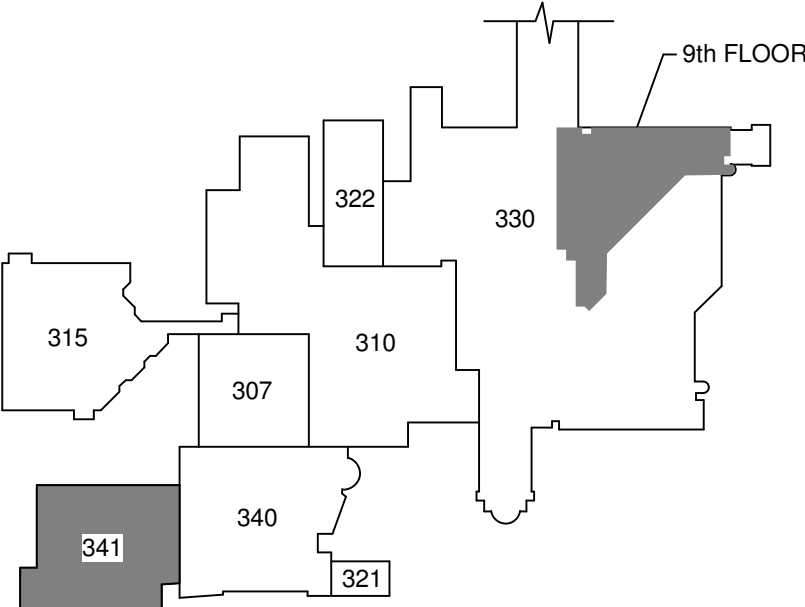

KEY PLAN  
Scale: N.T.S.

Revisions	Date
1	35% Schematic Design 03.05.2015
2	65% Design Development 04.28.2015
3	95% Owner Review 08.14.2015
4	100% Construction Documents 11.04.2015
5	Bid Set Drawings 01.15.2016

CONSULTANTS:

**Heapy Engineering**  
MEP Design Technology Planning Commissioning Energy  
*Nationally Recognized Leader in Sustainability*  
1400 W Dorothy Lane, Dayton, OH 45409-1310  
Ph 937-224-0861 Fax 937-224-5777 www.heapy.com  
Heapy Project No.: 2014-04034 Firm License No.: Q1528

ARCHITECT/ENGINEERS:

**JOHN POE ARCHITECTS**

3131 NEWMARK DRIVE, SUITE 200  
MIAMISBURG, OHIO 45342  
937 461 3290 PHONE  
jpa@johnpoe.com

Drawing Title

**FIRST FLOOR PLAN - TECHNOLOGY**

Approved: Project Director

Project Title

**RELOCATE PROSTHETICS AND PODIATRY CLINICS**

Location

**Dayton, Ohio**

Date

**05.16.2016**

Checked

**MSG**

Drawn

**JDK**

Project No.  
VA Project No. 552-15-502  
JPA Project No. 14006.00

Building Number

**307**

Drawing Number

**341ET101**

Dwg. of

Office of Construction and Facilities Management  
Department of Veterans Affairs